

**Fuel cell electric vehicle as a power plant**

**Fully renewable integrated transport and energy system design and analysis for smart city areas**

Oldenbroek, Vincent; Verhoef, Leendert; van Wijk, Ad

**DOI**

[10.1016/j.ijhydene.2017.01.155](https://doi.org/10.1016/j.ijhydene.2017.01.155)

**Publication date**

2017

**Document Version**

Accepted author manuscript

**Published in**

International Journal of Hydrogen Energy

**Citation (APA)**

Oldenbroek, V., Verhoef, L., & van Wijk, A. (2017). Fuel cell electric vehicle as a power plant: Fully renewable integrated transport and energy system design and analysis for smart city areas. *International Journal of Hydrogen Energy*, 42(12), 8166-8196. <https://doi.org/10.1016/j.ijhydene.2017.01.155>

**Important note**

To cite this publication, please use the final published version (if applicable).  
Please check the document version above.

**Copyright**

Other than for strictly personal use, it is not permitted to download, forward or distribute the text or part of it, without the consent of the author(s) and/or copyright holder(s), unless the work is under an open content license such as Creative Commons.

**Takedown policy**

Please contact us and provide details if you believe this document breaches copyrights.  
We will remove access to the work immediately and investigate your claim.

## Fuel cell electric vehicle as a power plant: fully renewable integrated transport and energy system design and analysis for smart city areas

Vincent Oldenbroek<sup>a,\*</sup>, Leendert A. Verhoef<sup>b</sup>, Ad J.M. van Wijk<sup>a</sup>

<sup>a</sup> Energy Technology Section, Department of Process and Energy, Delft University of Technology, Leeghwaterstraat 39, Delft 2628 CB, The Netherlands

<sup>b</sup> Green Office, Delft University of Technology, Van Den Broekweg 2, Delft 2628 CS, The Netherlands

\*Corresponding author. Tel.: +31 (0) 15 27 83884.

E-mail address: v.d.w.m.oldenbroek@tudelft.nl (V.Oldenbroek)

### Abstract

Reliable and affordable future zero emission power, heat and transport systems require efficient and versatile energy storage and distribution systems. This paper answers the question whether for city areas, solar and wind electricity together with fuel cell electric vehicles as energy generators and distributors and hydrogen as energy carrier, can provide a 100% renewable, reliable and cost effective energy system, for power, heat, and transport. A smart city area is designed and dimensioned based on European statistics. Technological and cost data is collected of all system components, using existing technologies and well-documented projections, for a Near Future and Mid Century scenario. An energy balance and cost analysis is performed. The smart city area can be balanced requiring 20% of the car fleet to be fuel cell vehicles in a Mid Century scenario. The system levelized cost in the Mid Century scenario is 0.09 €/kWh for electricity, 2.4 €/kg for hydrogen and specific energy cost for passenger cars is 0.02 €/km. These results compare favorably with other studies describing fully renewable power, heat and transport systems.

### Highlights

- Smart city area design for fully renewable and reliable energy and transport.
- Detailed statistical analysis of European characteristics for an average city area.
- Fuel cell electric vehicles provide transport, energy distribution and balancing.
- Wind, solar, electricity and hydrogen are the only energy sources and carriers.
- Scenario analysis shows the design results in affordable energy and transport.

### Keywords

Smart City, Fuel Cell Electric Vehicle, Vehicle-to-Grid, Hydrogen Production, Energy analysis, Cost Analysis

### Nomenclature

| Abbreviation |                          |
|--------------|--------------------------|
| AF           | annuity factor           |
| BEV          | battery electric vehicle |
| CoE          | cost of energy           |
| CC           | annual capital cost      |
| C&C          | compression and cooling  |

|                      |  |
|----------------------|--|
| DOE                  | department of energy                                     |
| €                    | euro   |
| EC                   | energy consumption                                       |
| EP                   | energy production  |
| EU                   | european union   |
| EUR                  | euro   |
| FC-DLC               | fuel cells dynamic load cycle                            |
| FCEV                 | fuel cell electric vehicle                               |
| H <sub>2</sub>       | hydrogen   |
| h                    | hours  |
| HFS                  | hydrogen fueling station                                 |
| HHV                  | higher heating value                                     |
| IC                   | installed investment cost                                |
| LED                  | light emitting diode                                     |
| LT                   | economic lifetime  |
| NEDC                 | new european driving cycle                               |
| OM                   | annual percentage of operation and maintenance costs     |
| O&M                  | operation and maintenance                                |
| OMC                  | Annual operation and maintenance costs                   |
| PEM                  | proton exchange membrane                                 |
| PEMFC                | proton exchange membrane fuel cell                       |
| Q                    | installed component capacity                             |
| SCoE                 | specific cost of energy                                  |
| SEC                  | specific energy consumption                              |
| SLCoE                | system levelized cost of energy                          |
| TC                   | total annual capital and operation and maintenance costs |
| TSCoE <sub>SCA</sub> | smart city area total system cost of energy              |
| USD                  | united states dollar                                     |
| US                   | united states of america                                 |
| V2G                  | vehicle-to-grid  |
| W                    | wind   |
| WACC                 | weighted average cost of capital                         |

|           |                            |
|-----------|----------------------------|
| Subscript |                            |
| dir       | direct                     |
| e         | electricity                |
| FCEV      | fuel cell electric vehicle |
| H         | hydrogen                   |
| HFS       | hydrogen fueling station   |
| i         | component number           |
| n         | total number of components |
| S         | from solar                 |
| surp      | surplus                    |
| TTW       | tank-to-wheel              |
| veh       | vehicle                    |
| W         | from wind                  |

|              |            |
|--------------|------------|
| Greek symbol |            |
| η            | efficiency |

# 1 Introduction

The urgency to significantly reduce the impacts of climate change is felt around the globe. December 12, 2015, 195 governments agreed on a long-term goal of keeping the increase in global average temperature to well below 2°C above pre-industrial levels and aim to limit the increase to 1.5°C [1].

In view of these goals both the energy and transport systems need to change into zero emission systems. Both systems need to become clean while remaining reliable and affordable. This will require major technological, organizational and social changes in both the energy and the transport system. We envisage major transitions in and integration of both systems.

The transition in the electricity system will be from fossil fueled power plants to renewables. However, the intermittent nature of many renewables such as wind and solar require a more flexible electricity system, which may be provided by flexibility in demand, electricity storage, electricity conversion into fuels, chemicals or heat and (distributed) smart grids [2].

The major technological transition in the transport system will be from combustion engines to electric engines. The electricity will be provided by batteries or fuel cells that can produce electricity with high efficiencies from a fuel such as hydrogen. In addition, an electricity charging infrastructure and/or hydrogen fueling infrastructure is needed to accommodate the introduction of electric vehicles.

Until today both the electricity and transport system have developed independently from each other. However, the integration of these two systems may solve major problems related to the separate transitions described above, and create synergies benefiting both systems [3–9]. To our knowledge, no such comprehensive study has been performed up to now. Many studies and pilot projects investigate (stand-alone) renewable energy systems using hydrogen as energy storage and stationary fuel cells for re-conversion of the stored hydrogen [10–30]. Some studies use the produced hydrogen for transport [3,12,31–39] or solely use the fuel cell in the vehicle as an electric generator [40–42] without considering hydrogen production. None of the aforementioned studies integrates grid connected hydrogen fuel cell powered transport, renewable electricity and hydrogen production and hydrogen reconversion on the scale of a smart city area, analyzing energy demand and cost of energy in different time frames.

Balancing excess and shortage of electricity can be handled in three ways:

Power to Power. At moments of excess electricity generated by renewables, the electricity can be *stored* in batteries of electric vehicles which are connected to the grid. When there is a shortage of power production by renewables, the stored electricity in car batteries could be used to feed into the grid. At present the electricity stored in batteries of a car is between 10 and 90 kWh.

Power to Gas and Power to Chemicals [30]. At moments of excess electricity by renewables the electricity can be *converted* into hydrogen. The hydrogen can be stored under pressure and transported by boat and/or truck to car fueling stations as a clean fuel. Hydrogen has a high energy density, 39 kWh/kg (HHV). Pressurized hydrogen tanks in present fuel cell cars contain 5 to 6 kg hydrogen [43]. Hydrogen can also be used as a feedstock to produce chemicals and other fuels such as ammonia, methanol, methane, and formic acid.

Gas to Power. At moments of electricity shortage, the fuel cells in vehicles could *supply* electricity to the grid [40,42,44–51], using the hydrogen stored in their tank. Fuel cells can produce electricity from hydrogen with a high efficiency. Peak energy efficiencies of the present PEM fuel cells in the cars are about 51.5% (HHV) in part load, with United States (US) Department of Energy (DOE) targets of 60.0% (HHV) [52,53]. One kilogram of hydrogen can therefore supply between 20 and 25 kWh to the electricity system.

Cars have sufficient power to influence the energy system world-wide. Summarizing an analysis done by [54]: Worldwide power plant capacity is about 5.000 GW. At present the typical fuel cell of a car has a capacity of about 100 kW, sufficient to power on average 100 European homes. Every year worldwide more than 80 million new cars are sold. The number of new cars multiplied by 100 kW capacity per fuel cell per car, would amount to 8.000 GW new power production capacity on the road every year. In a renewable electricity production system, fuel cell cars can therefore provide all necessary flexible electricity production capacity.

Hydrogen can be produced from all kind of renewable energy sources, such as biogas, biomass, direct sunlight or renewable electricity [55–59]. Also hydrogen can be produced far from load centers [60]. It can be stored and transported by boat and truck to these load centers, mainly associated with urbanized areas [61]. For example floating wind turbines far in the ocean at very high wind speed locations, can produce electricity which is converted into hydrogen by electrolysis and shipped to the load centers [62,63]. This creates flexibility in supply and demand for renewable energy production both geographically and in time and avoids huge investments in electricity transmission lines between renewable energy generation sites and demand centers [64].

Market introduction of Fuel Cell Electric Vehicles (FCEVs) is gaining momentum [65–68]. Many scenarios show substantial penetration of fuel cell vehicles in the coming decades [52,69–76]. The Japanese government wants to create a market for hydrogen and fuel cell cars, with projected annual market size increasing to 800,000 fuel cell electric vehicles sold in 2030 [77]. Similar in Germany, a program is initiated to build 400 hydrogen fueling stations in the coming years in Germany, combined with car fleet development [78,79].

Studies [80] show strong evidence of achievable cost reductions for hydrogen technologies, to approx. 30 USD/kWh for automotive PEM fuel cell systems in production volumes of 500,000/year; with comparable cost reduction for hydrogen generation cost [80]. But also hydrogen storage tank costs, electrolyzer costs and compressor costs will decrease considerably in the coming decades, based on technology improvements but primarily on increasing production volumes [52].

Inspired by the concept of a “Hydrogen Economy” [31,65,81–87], the question arises: *Can solar and wind electricity together with fuel cell electric vehicles and hydrogen as energy carrier, provide a 100% renewable, reliable and cost effective energy system, for power, heat, and transport for smart city areas?* To get insights and answers to this question, this study performs the design, energy balance, and cost analysis of an integrated electricity and transport system, based on renewable electricity production, hydrogen as an intermediate energy carrier and fuel cell electric vehicles for transport and providing all the necessary flexibility for the electricity system, in two time frames: Near Future and Mid Century.

## 2 Methodology

### 2.1 Approach

The research is performed in five steps:

- 1) Design and dimensioning of a fully autonomous renewable and reliable integrated transport and energy system for a smart city area based on European statistics. Requirements are listed in section 2.2.
- 2) Analyzing annual energy demand for the designed smart city area in two time frames: a Near Future (around 2020) and Mid Century scenario (around 2050), see section 2.3.
- 3) Calculating the annual energy balance by matching energy demand with solar and wind electricity production, energy storage in the two scenarios, see section 2.4. Selection of technologies for the components of the energy system in the smart city area and analyzing their technological and economical characteristics in two time frames.
- 4) Calculating cost of energy for the two time frames, by calculating in section 2.5
  - a) Smart city area total system cost of energy
  - b) System levelized cost of energy
  - c) Specific cost of energy
- 5) Sensitivity analysis for the cost of energy in the Mid Century scenario for a wide range of key assumptions and parameters used, see section 2.6.

### 2.2 System design requirements and dimensioning

A fully autonomous renewable and reliable energy and transport system is designed for a smart city area. The smart city area energy and transport system is designed in such a way that it fulfills the following design requirements:

- uses only electricity and hydrogen as energy carriers and is all electric in end use
- uses only hydrogen to power all road transport vehicles
- is an average European city area.
- is integrated into existing infrastructure and buildings
- does not require a new-build underground infrastructure, for example an underground hydrogen pipeline network
- uses abundant renewable energy sources in Europe: solar and wind only
- is independent of High and Medium Voltage electricity grids, natural gas and district heating grids or expansion of these.

Section 3 describes the design and dimensioning of such an energy system starting by a statistical analysis of the European characteristics for an average city area. The dimensioning includes a wide range of aspects defining a city area, for example the number of inhabitants and households, floor and roof area of buildings, road transport vehicles and refueling stations.

## 2.3 Analyzing energy demand

The annual energy demand of such an integrated transport and energy system for a smart city area started by a statistical analysis of the European Union (EU) energy consumption in buildings and for road transport, see section 4. Building energy consumption consists of heating, cooling and electrical appliances in the residential sector and the services sector. Road transport energy consumption analysis looks into average transport kilometers per vehicle type and its energy consumption. For such an average city area, the Near Future and Mid Century energy demand in buildings and for transport, are based on statistical historical data and studies about future energy efficiency improvement in end use, use of different technologies such as heat pumps for heating and by replacing conventional internal combustion powered road vehicles by hydrogen powered fuel cell electric vehicles.

The two scenarios can be characterized as follows:

- The Near Future scenario uses *current state of the art* renewable and hydrogen technology and current energy demand for buildings and transport. It is already an all-electric energy system in the end use, which means space heating is done via heat pumps fulfilling present heat demand for houses and buildings. Only commercially available hydrogen technologies are used. For all systems, including hydrogen technologies, present technology characteristics and cost figures are used. The near future scenario presents a system that could be implemented around 2020.
- In the Mid Century scenario a *significant reduction of end-use energy* consumption is assumed. Hydrogen and fuel cell technology *has become mature with mass production* and performing on the cost and efficiency targets projected for 2050. Also for all the other technologies, such as solar, wind, electrolyzers the learning curves are taken into account.

In both scenarios it is assumed that the number of vehicles and the annual kilometers driven per vehicle are the same as nowadays.

## 2.4 Calculating the energy balance

The maximum amount of generated solar electricity in the smart city is calculated with the available roof area on buildings, based on the statistical analysis of the average European city area in section 3. Due to the possible insufficient solar electricity production and mismatch with building and transport energy consumption (see section 4.4), additional wind electricity and energy storage is required.

A technology choice is performed and an assessment is conducted for, efficiencies, sizes, cost and development in time for all involved components of the smart city area energy system, see section 5. Component sizes are determined using calculation methods from other studies or are based on average day patterns.

Once the technology choice and assessment is performed, the energy balance is calculated. In both scenarios wind electricity closes the annual energy balance of energy demand and local solar electricity generation, taking into account all efficiencies of the different conversion and storage technologies.

## 2.5 Calculating cost of energy

Three components for the cost of energy (CoE) will be calculated.

- Smart City Area Total System Cost of Energy,  $TSCoE_{SCA}$  in Euro per year.
- System Levelized Cost of Energy for electricity  $SLCoE_e$  in Euro per kWh and for hydrogen  $SLCoE_H$  in Euro per kg Hydrogen.
- Specific Cost of Energy for Buildings  $SCoE_B$  in Euro per  $m^2$  per year and for Transport  $SCoE_T$  in Euro per km.

### 2.5.1 Smart city area total system cost of energy

The  $TSCoE_{SCA}$  in Euro per year is the sum of the Total annual capital and operation and maintenance Costs  $TC_i$  (€/year) of the total number of components ( $n$ ) in the Smart City Area:

$$TSCoE_{SCA} (\text{€/year}) = \sum_1^n TC_i \quad (1)$$

The  $TC_i$  of an individual component are calculated with the annual Capital Cost  $CC_i$  (€/year) and Operation and Maintenance Cost  $OMC_i$  (€/year):

$$TC_i (\text{€/year}) = CC_i + OMC_i \quad (2)$$

The  $CC_i$  (€/year) of a component is calculated with the annuity factor  $AF_i$  (%), installed component capacity  $Q_i$  (component specific capacity) and Investment Cost  $IC_i$  (€ per component specific capacity):

$$CC_i (\text{€/year}) = AF_i \times Q_i \times IC_i \quad (3)$$

Where the annuity factor  $AF_i$  [88,89] is based on the weighted average cost of capital WACC (%) and the economic lifetime of a component  $LT_i$  (years):

$$AF_i = \frac{WACC \times (1 + WACC)^{LT_i}}{\left[ (1 + WACC)^{LT_i} \right] - 1} \quad (4)$$

The annual operation and maintenance costs  $OMC_i$  (€/year) are expressed as an annual percentage  $OM_i$  (%) of the  $Q_i$  and  $IC_i$ :

$$OMC_i (\text{€/year}) = OM_i \times Q_i \times IC_i \quad (5)$$

The cost analyses are in constant 2015 euros. An exchange rate of 0.88 USD to EUR is used. The website [90] is used to convert all USD values to  $USD_{2015}$  values. A WACC of 3% is used.

### 2.5.2 System levelized cost of energy

The system levelized cost of energy, for either electricity  $SLCoE_e$  (€/kWh) or hydrogen  $SLCoE_H$  (€/kg  $H_2$ ) are calculated by allocating a share of the  $TSCoE_{SCA}$  related to either electricity  $TSCoE_{SCA,e}$  or hydrogen consumption  $TSCoE_{SCA,H}$ . These shares are then divided by either the annual electricity  $EC_e$  (kWh/year) or hydrogen consumption  $EC_H$  (kg  $H_2$ /year) and resulting in respectively the  $SLCoE_e$  or  $SLCoE_H$ :

$$SLCoE_e (\text{€/kWh}) = \frac{TSCoE_{SCA,e}}{EC_e} \quad (6)$$



$$SLCoE_H (\text{€}/\text{kg } H_2) = \frac{TSCoE_{SCA,H}}{EC_H} \quad (7)$$

### 2.5.3 Specific cost of energy

The specific cost of energy is defined as the energy cost per physical unit [91]. For transportation services, the Specific Cost of Energy for transport  $SCoE_T$  is defined as the energy cost for driving a vehicle over a distance of 1 km. For FCEVs the  $SCoE_{T,veh}$  is the Specific Energy Consumption of hydrogen per hundred kilometer for each type of vehicle,  $SEC_{T,veh}$  (kg  $H_2$ /100 km), times the  $SLCoE_H$  and divided by 100 kilometer:

$$SCoE_{T,veh} (\text{€}/\text{km}) = \frac{SLCoE_H \times SEC_{T,veh}}{100 \text{ km}} \quad (8)$$

For building energy consumption, the Specific Cost of Energy for Buildings  $SCoE_B$  (€/m<sup>2</sup>/year) is defined as the cost of the annual Specific Energy Consumption  $SEC_B$  (kWh/m<sup>2</sup>/year) by all energy-consuming equipment within that building per square meter:

$$SCoE_B (\text{€}/\text{m}^2/\text{year}) = SLCoE_e \times SEC_B \quad (9)$$

## 2.6 Sensitivity analysis

A sensitivity analysis for the Mid Century scenario is performed for the parameters that have a large impact on the  $TSCoE_{SCA}$ . Amongst others the specific energy consumption of FCEVs, cost of hydrogen technologies, specific energy consumption of buildings and annual solar irradiation.

### 3 Design of a fully autonomous renewable and reliable energy system for a smart city area

#### 3.1 Smart integrated energy and transport city functional design

Main energy consumers in cities are buildings and transportation vehicles and account for 67% of the final energy consumption in the EU [92]. Buildings in cities belong to either the residential or services sector, as industrial buildings are often located outside city areas. Energy consumption of road transportation vehicles energy accounts for 80% of the EU final energy consumption for transportation [92]. The road transportation vehicles are owned by either the residential or services sector and energy is consumed in or between smart city areas. By applying the design requirements from section 2.2, the integrated system design of the smart city area has the following 6 major elements (*Fig. 1*):

- Buildings: The residential and services sector buildings. All buildings have rooftop solar electricity systems and water collection systems. The buildings are all electric, without any natural gas connection. Industrial and agricultural buildings are excluded from the analysis.
- Hydrogen production & purification, and storage system.
- Smart electric grid, managed by a controller, which connects all buildings and cars.
- A hydrogen tube trailer transporter and a Hydrogen Fueling Station (HFS).
- A fleet of hydrogen fuel cell cars and other road transportation vehicles.
- An off-site wind turbine park, not located near or in the smart city area, with water collection, purification and hydrogen production and storage system, with no electrical grid connection

The functional energy performance of the smart city area comprises of the following conversion steps:

- Electricity is generated by solar modules on all roofs.
- Rainwater is collected from the roofs of buildings and is demineralized and purified and used in the electrolysis process. Purification is needed for good operation of the electrolyzer.
- Surplus solar electricity is converted via water-electrolysis into pure hydrogen. The hydrogen is compressed and stored into tube trailer modules. Full tube trailer modules are transported by a trailer tractor to the nearby Hydrogen Fueling Station (HFS).
- At the HFS, the hydrogen is further compressed depending on vehicle demand. Electric energy required for hydrogen compression at the HFS comes from the city area.
- The hydrogen is used as a transport fuel for all types of fuel cell powered electric vehicles; passenger cars, vans, motorcycles, buses and trucks.
- In case of a temporary shortage in production of solar electricity, the fuel cells in grid-connected passenger cars provide the necessary electricity by converting hydrogen from the on-board hydrogen storage tanks. At parking places at home or at the local shopping area, vehicle-to-grid points connect the cars to the smart city electrical grid.
- All wind-electricity produced is converted at the wind turbine park into hydrogen via water-electrolysis. These wind turbines are located either on-shore or off-shore. The produced hydrogen from wind is transported via tube trailers to a hydrogen fueling station.
- Surface or seawater in the vicinity of the wind turbines is purified and used in the water-electrolysis process.

The system design configuration is flexible to use other renewable energy sources if present, for example as biomass or hydropower to hydrogen, but is not analyzed in this study.

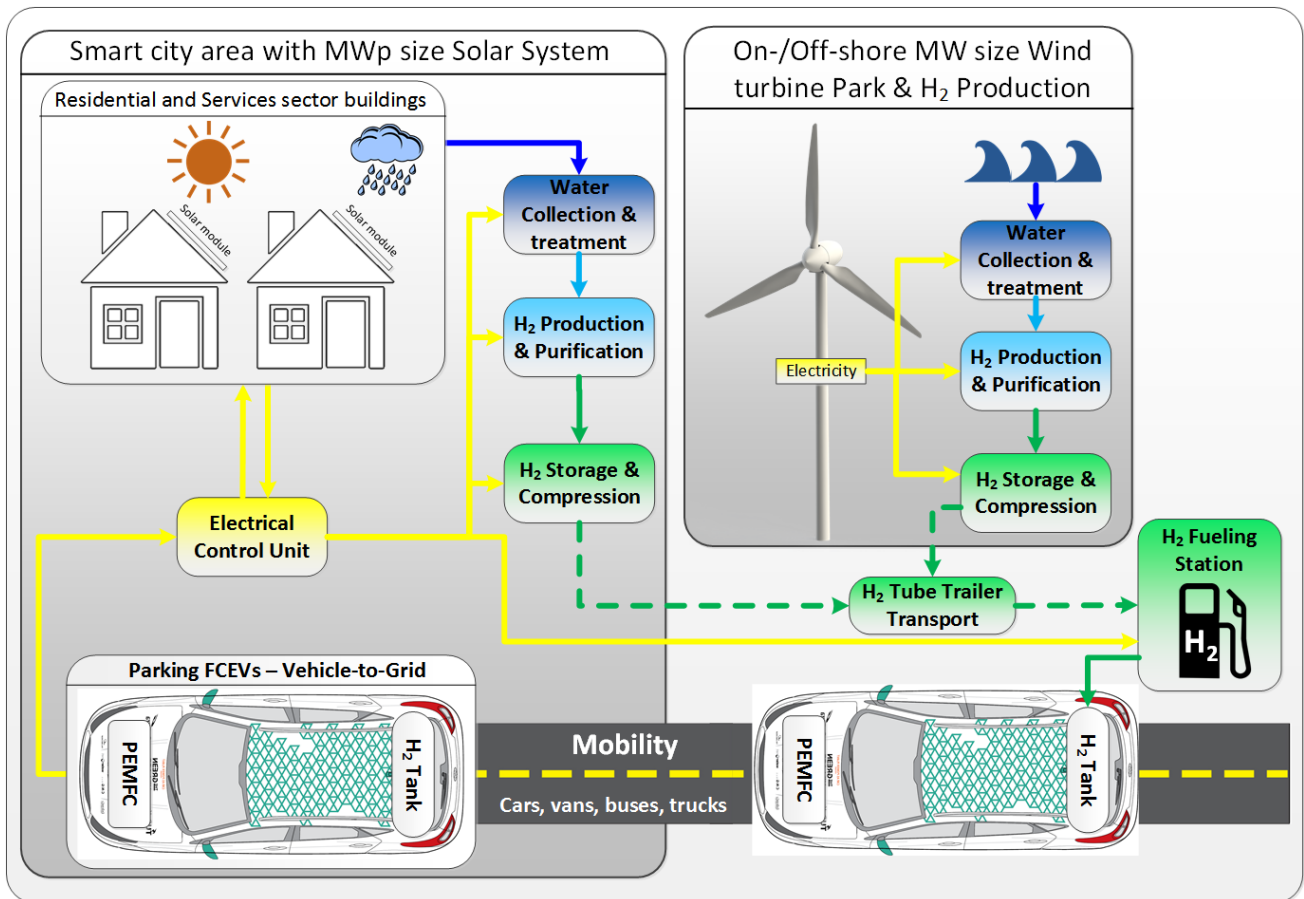


Fig. 1 – Smart City Area key elements and functional energy performance.

### 3.2 Dimensioning of smart integrated city area

The size of a European city area for this study is determined using the dispersion of supermarkets and petrol stations. In the EU 28, for every 1,900 households there is one petrol station [93,94] and for every 2,100 households there is an medium-sized supermarket so 2,000 households is a good indicator for dimensioning the smart integrated city area. This hydrogen fueling station will serve a similar vehicle population as current gasoline stations [95]. Total capital cost per capacity for large HFS ( $\geq 1,500$  kg/day) is lower than for smaller HFS [96]. Also in the future with lower specific energy consumption for transport the hydrogen fueling station will still dispense sufficient amount of hydrogen [96] with the benefits of lower total capital cost per capacity.

On average 2,000 households correspond to 4,700 persons, with in total 2,300 cars, 190 motorcycles and some 320 other vehicles and each household using  $89.75 \text{ m}^2$  of built area, according to European statistical data [93,94,97–104], see Table 1. Of the lorries and vans, approximately 10% are lorries [105–111].

Table 1 – Characteristics of a smart European city area.

| Parameter  | Quantity |
|--|----------|
| Petrol stations  | 1        |
| Food retail shop   | 1        |
| Households and dwellings <sup>1</sup> in smart integrated city | 2,000    |
| Persons  | 4,680    |
| Floor area buildings residential (m <sup>2</sup> )             | 179,500  |
| Floor area buildings services (m <sup>2</sup> )                | 57,200   |
| Passenger cars   | 2,300    |
| Motorcycles  | 190      |
| Lorries and Vans   | 300      |
| Large Trucks with trailers (road tractors) <sup>2</sup>        | 18       |
| Buses  | 8        |

<sup>1</sup> Assumed that only 1 household lives in a dwelling.

<sup>2</sup> The number of large trucks with trailers includes the number of tractors used for transporting hydrogen tube trailers

## 4 Energy demand and production in two scenarios

### 4.1 Residential Sector

The building-related energy demand of the residential sector accounts for 27% of the total EU final energy consumption [92]. The present European residential building floor space of 18.95 million m<sup>2</sup> and present-day energy consumption was, 3,493 TWh/year [92,101]. For the Near Future scenario, all electric buildings are assumed, where heat pumps with an estimated annual average COP of 3.5 replace conventional heating & cooling [112–115]. In the Mid Century scenario, buildings are also all-electric, and significant energy savings will be achieved: 95% savings on space heating and cooling and 50% on water heating [116]. It is assumed cooking energy consumption [101] in the Mid Century scenario will be the same as in the Near Future scenario. Although lighting energy savings will be significant by LED technologies, electrical consumption will increase due to an increased number and use of electrical appliances and home-automation. Therefore it is assumed that the combined electricity consumption for electrical appliances, lighting and cooking is the same as in the Near Future scenario.

Road transport energy accounts for 26% of the total EU final energy consumption [92], of which 1,959 TWh/year (59%) is due to passenger cars [99]. For the Near Future and Mid Century scenario, 100% hydrogen powered FCEVs are foreseen, with a SEC<sub>T,car</sub> of 1.0 and 0.6 kg H<sub>2</sub>/100 km, respectively [52]. The final energy consumption for motorcycles is not included as it represents only 1.3% [56] of the total road transport final energy consumption.

In both scenario's, the present European passenger cars average annual driven distance of 11,940 km [99] is used. With the specific energy consumption and energy content of 39.41 kWh/kg of hydrogen (on a HHV basis), the annual final energy consumption of a FCEV passenger car, equivalent to 62 respectively 37 kWh per square meter residential floor area per year.

Summarizing: the total specific energy consumption in the residential sector for transport and buildings is calculated using data from Table 1, [52,92,94,98,99,101,103], and results in 288, 142, and 89 kWh/m<sup>2</sup>/year at present, Near Future, and Mid Century, respectively, see Table 2. The specific energy consumption in buildings is comparable with the values in [117].

Table 2 – Specific energy consumption (kWh/m<sup>2</sup>/year) per consumption category for the residential sector.

| Energy consumption category                        | SEC [kWh/m <sup>2</sup> /year] |                   |                   |
|--|--------------------------------|-------------------|-------------------|
|  | Present                        | Near Future       | Mid Century       |
| Space heating & cooling                            | 126.3                          | 27.4              | 6.3               |
| Water heating                                      | 23.3                           | 19.6              | 11.7              |
| Electrical appliances, lighting, cooking           | 34.7                           | 33.4              | 33.4              |
| Total in buildings (SEC <sub>B,residential</sub> ) | 184.3                          | 80.4              | 51.4              |
| Passenger cars relative to floor surface           | 103.4                          | 62.0 <sup>1</sup> | 37.2 <sup>1</sup> |
| Total transport and buildings                      | 287.7                          | 142.4             | 88.6              |

<sup>1</sup> Specific energy consumption on a HHV basis.

## 4.2 Services Sector

The building-related energy consumption of European services sector accounts for 1,850 TWh per year (with climatic corrections) [100], equal to 14% of the total EU final energy consumption [92]. For the Near Future scenario a combined energy saving of 50% is assumed compared to the present situation, by virtue of application of heat pumps [118–123] for all thermal energy demands [124]. For the Mid Century scenario energy saving of 50% is assumed for hot water and 85% for other thermal demands compared to the present situation, based on [116].

Road transport of the services sector, excluding passenger cars, accounts for 10 % of the total EU final energy consumption, 1,302 TWh/year [92,99]. In both scenarios, all vehicles are powered by hydrogen fuel cells. Table 3 shows the average annual distance driven [105–111,125–129] and the SEC<sub>T,veh</sub> (kg H<sub>2</sub>/100km) for vans, lorries, road tractor and buses for both scenarios. The specific energy consumption in the Near Future of vans is based on the average of [130] and [131] with an assumed average fuel cell system Tank-To-Wheel (TTW) efficiency of 51.5% (HHV) [52]. For lorries and road tractors it is based on the specific energy use of Battery Electric Vehicle (BEV) type lorries and road tractors [130] and the fuel cell system Tank-To-Wheel (TTW) efficiency [52]. FCEV bus specific energy use for the Near Future is taken from [132]. An efficiency improvement of 30% for vans (somewhat lower than the 40% expected for cars [52] and 20% for FCEV buses, lorries and road tractors [132], is assumed in Mid Century scenario.

Table 3 – Average annual distance driven and Near Future and Mid Century specific energy consumption for van, lorry, road tractor and bus type FCEVs.

| Vehicle type | EU average annual distance driven [km/year] | Near Future SEC <sub>T,veh</sub> [kg H <sub>2</sub> /100km] | Mid Century SEC <sub>T,veh</sub> [kg H <sub>2</sub> /100km] |
|--------------|---|---|---|
| Van          | 20,725                                      | 1.3   | 0.9   |
| Lorry        | 46,176                                      | 4.6   | 3.7   |
| Road tractor | 87,152                                      | 6.9   | 5.5   |
| Bus          | 47,611                                      | 8.6   | 6.9   |

With the specific energy consumptions given in Table 3 and the energy content of 39.41 kWh/kg of hydrogen (HHV basis), the annual final energy consumption of FCEVs is calculated. In Near Future as well in Mid Century the average annual distance driven remains constant. The number of tube trailer trucks for hydrogen transport and their driven kilometers are assumed to be included in the number of road tractors and their annual driven kilometers. Using the data from [52,92,99,100,103,124], Table 1 and Table 3, total specific energy consumption for the service sector area is calculated, see Table 4. The total specific energy consumption is 522, 411, and 307

kWh/m<sup>2</sup>/year at present, Near Future, and Mid Century, respectively. The specific energy consumption in buildings is comparable with the values in [117].

Table 4 – Specific energy consumption (kWh/m<sup>2</sup>/year) per energy consumption category for the services sector.

| Energy consumption category  | SEC [kWh/m <sup>2</sup> /year] |                    |                    |
|--|--------------------------------|--------------------|--------------------|
|  | Present                        | Near Future        | Mid Century        |
| Space heating & cooling, process heating & cooling (with climatic corrections) | 166.1                          | 83.1               | 25.0               |
| Water Heating  | 27.0                           | 13.5               | 13.5               |
| Electrical appliances, lighting  | 113.4                          | 113.4              | 113.4              |
| Total in buildings (SEC <sub>B, services</sub> )                               | 306.6                          | 210.0              | 152.7              |
| Road vehicles (vans, lorries, buses, road tractors) relative to floor surface  | 215.7                          | 198.8 <sup>1</sup> | 154.1 <sup>1</sup> |
| Total transport and buildings  | 522.3                          | 411.7              | 306.7              |

<sup>1</sup> Specific energy consumption on a HHV basis.

### 4.3 Local energy production by solar electricity systems

Residential and service sector roofs will be used for solar electricity systems and for rainwater collection [133–135]. Solar electricity systems are installed on all technically suitable roof areas: 9 m<sup>2</sup> per person on residential buildings and 4 m<sup>2</sup> per person on service sector buildings area [136,137]. Façades are not considered. In the Near Future scenario the performance ratio and solar module efficiency are 0.75 and 0.20 kWp/m<sup>2</sup>, and in the Mid Century scenario these are 0.90 and 0.35 kWp/m<sup>2</sup> [138–143]. Thus 12.4 and 21.3 MWp are installed in Near Future and Mid Century scenario, respectively. The electricity generated is calculated using a typical global irradiation on optimally inclined modules in European urbanized areas of 1,300 kWh/m<sup>2</sup>/year [144–146].

### 4.4 Overview energy consumption and production

The final energy consumption for each category and solar electricity production for the two scenarios is shown in Fig. 2. The total final energy consumption for the smart city is 48 and 33 GWh/year in the Near Future and Mid Century scenario, respectively. The solar electricity production is 12 respectively 25 GWh/year.

In the Near Future scenario, demand exceeds supply, and solar electricity systems are insufficient to cover the residential and service sector demand nor the transport energy demand in the Near Future scenario. To balance demand and supply, additional energy has to be generated or imported. Exchange between residential and service sector does not solve this imbalance. In the Mid Century scenario, demand still exceeds supply, but for the residential sector there is a small net surplus of energy, and additional energy is still required. No attention has been given yet to temporal mismatch between solar electricity production and electricity consumption, and storage losses. The next section will address this.

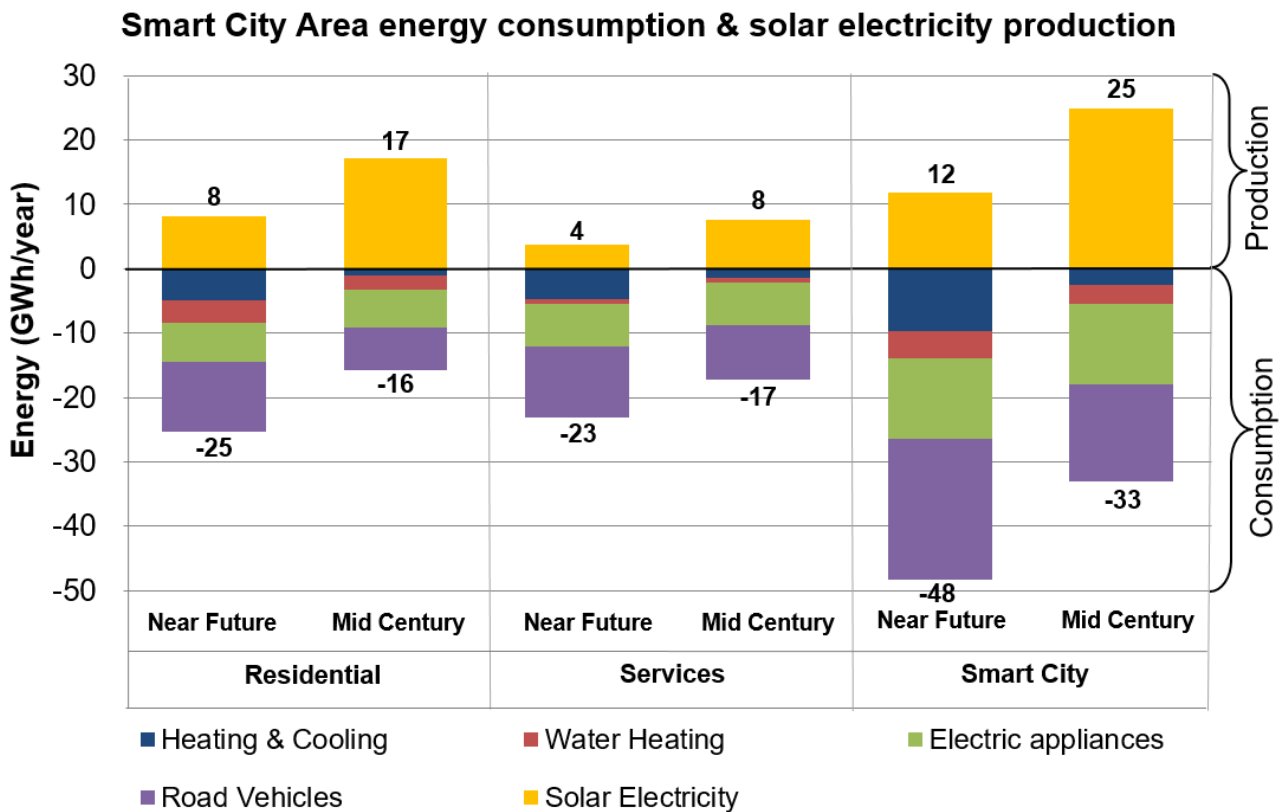


Fig. 2 – Generated solar electricity in each scenario compared to the building and transport final energy consumption categories.

## 5 Technology choices, sizing, characteristics and development

### 5.1 Data structuring

The relevant conversion processes in the smart city, as shown schematically in Fig. 3, are:

- hydrogen production and purification,
- hydrogen compression, storage and transport,
- hydrogen fueling station (compression, storage, dispensing and cooling)
- fuel cell electric vehicle power production,
- water collection and storage,
- water treatment,
- solar electricity production,
- wind electricity production

In both scenarios, the most appropriate, commercially available technologies are selected. The size of the components can be deduced from the energy balance. That requires meticulous evaluation of system component characteristics and calculation of the intermediate conversion efficiencies (and losses) especially from electricity to hydrogen production and the partial re-conversion to electricity. Cost characteristics of all these components are determined for both scenarios, using present-day technologies, discarding technologies with Technology Readiness Levels less than 7.

For the system cost calculations, the energy producing equipment, solar modules and wind-turbines including their installation, connection, maintenance and auxiliary component costs are included in this study. Energy saving measures and appliances and equipment, such as heat pumps, LED lights, washing machines, building automation and improved insulation are *not* taken into account.

All hydrogen related equipment including their installation, connection, maintenance and auxiliary component costs are included. Amongst hydrogen related equipment we consider the electrolyzers, hydrogen purification, compressors, tube trailers and tractors, high pressure compressors, high pressure stationary storage, hydrogen chillers and dispensers.

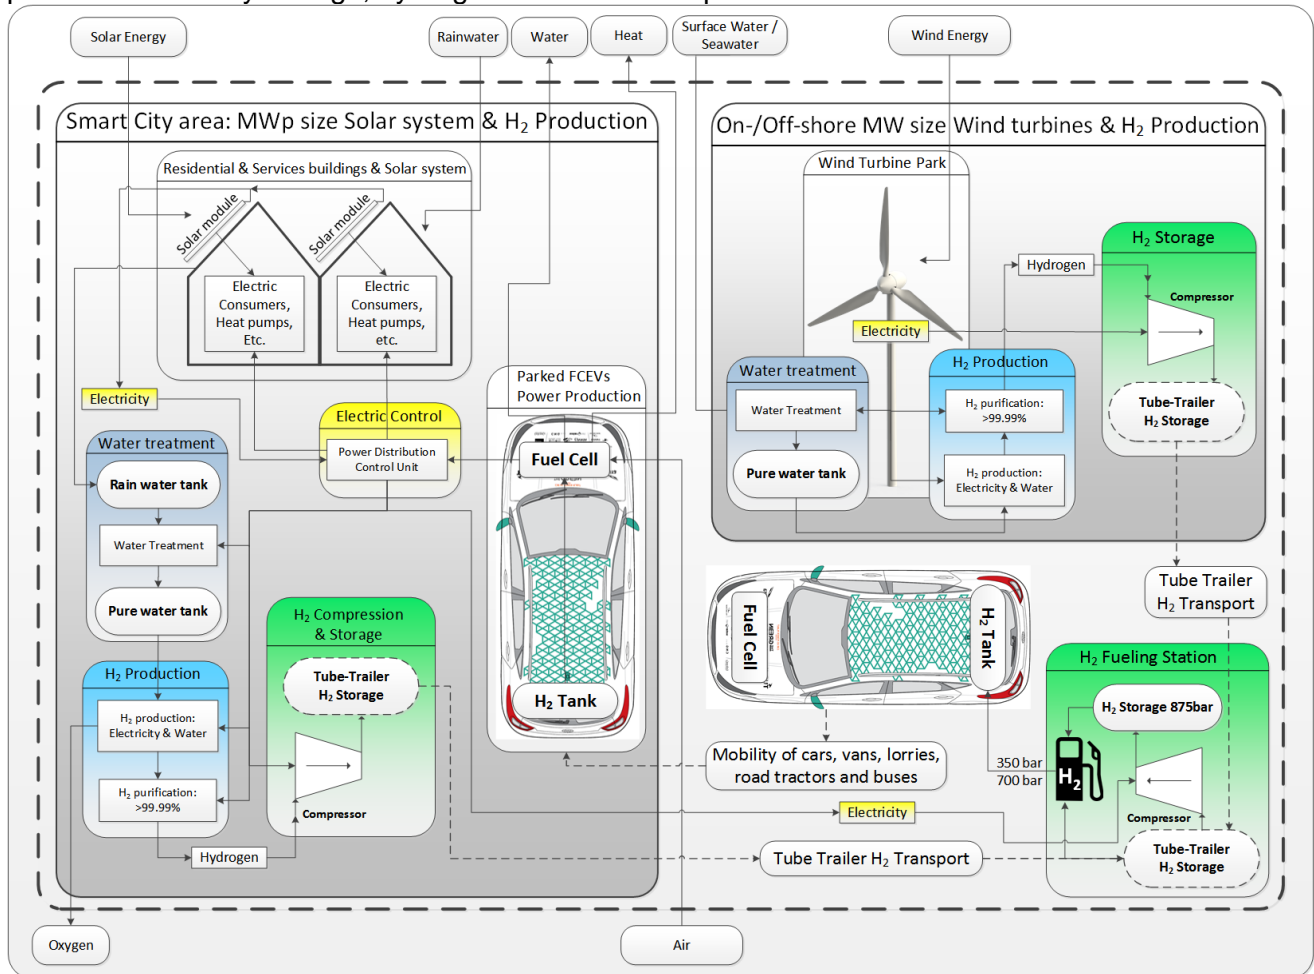


Fig. 3 – The relevant conversion processes in the smart city area.

## 5.2 Hydrogen production and purification: PEM water electrolysis

### Technology

The most mature and commercial available technologies in MW-scale systems are alkaline and PEM type electrolyzers [147]. Hydrogen from electrolyzers is not sufficiently pure [148] for FCEV use and needs to be purified [149,150]. PEM electrolyzers are used, because are more suitable to couple with intermittent renewable electricity sources as wind and solar electricity [147,151,152]. Also PEM electrolysis has a higher cost reduction potential and efficiency improvement potential compared to alkaline electrolysis [52,153]. The electrolyzer and purifier energy requirements [52,154–156] are assumed constant over the entire operating range and are listed in Table 6. The purifier hydrogen output pressure is 30 bar in both scenarios [147,148,150,155,156].

To calculate the required peak capacity of the electrolyzer connected to the solar system, it is assumed that all hydrogen is produced from the surplus solar electricity within 5 full-load hours per day. Here we assume that if the electrolyzer produces hydrogen, the purification module and compressor run simultaneously and also consume a part of the surplus electricity. The actual operational hours, which determine the stack degradation, are assumed to be 10 hours per day.



The capacity of the electrolyzer connected to the wind turbine park is the wind-turbine capacity minus the electric power requirement of the hydrogen purification module and compressor. The actual operational hours are assumed to be 24 hours per day. It is assumed that the calculated electrolyzer size is available in the market, or larger size electrolyzers are cost-shared with other smart cities.

### **Cost**

Installed capacity capital cost for the PEM electrolyzer is based on an extensive, detailed analysis in power to gas applications [153,157], which concludes 300-350 Euro/kW for a single produced 100MW system in 2030. For the smart city electrolyzer, cost reductions are possible because of higher volume production, economies of scales for membrane production [158] and component reduction, thus coming to 250 Euro/kW for the Mid Century scenario. Other sources have less detail in system size, production volume and components used in 2050 [52] or only have estimations for 2025 [154]. System lifetime is 20 to 30 years, but lifetime of the PEM stack and major components are 80,000 hours in the Near Future scenario and 90,000 in the Mid Century scenario [147,148].

The OM can be found in Table 7 for both scenarios for both electrolyzer locations. The OMC consist of a fixed part dependent on electrolyzer size [147] and a variable part due to stack and major component replacement. Replacement costs occur in case operational hours during system lifetime exceed the stack lifetime. The variable part is 15% of the installed electrolysis system cost in the Near Future and 12% in Mid Century [155,156].

## **5.3 Hydrogen storage and transport**

### **Technology**

Several types of hydrogen storage exist [159–161], but compressed hydrogen storage is selected, because it is the most mature and commercially available technology in mobile and stationary applications [162,163]. Using tube trailers [164–166] for exchange between wind site and urban area. In the Near Future scenario tube trailers can store 720 kg an effective mass of hydrogen at a pressure is 250 bar. In Mid Century scenario this will be 1350 kg of hydrogen at 500 bar [164,166]. At the hydrogen fueling station hydrogen is stored at 875 bar in variable storage sizes [162,164,167–169].

Storage capacity of the hydrogen tube trailers is two times the average daily hydrogen production at each electrolyzer location. The high-pressure stationary storage is sized to contain the average daily dispensed hydrogen. Both types of storage (tube trailer and stationary storage) are not rounded off to the closest available storage tank or tube trailer capacity. The calculated storage capacity is used directly to calculate the (installed) costs. Either a larger or smaller fueling station will be built and shared with a smaller or larger vehicle fleet, as this smart city is based on an illustrative number of vehicles.

The number of tractors for trucking in the tube trailers to the fueling station are calculated using the amount average daily dispensed hydrogen, the capacity of a tube trailer, average driving speed (50km/h), roundtrip distance (100km), loading and unloading time (2 hours) and working hours per day (8 hours) [170], coming to approx. 1 respectively 3.5 tractors in Mid Century versus Near Future scenario. The tractor driver also executes the charging operations so that no further personnel is required [170].

### **Cost**

Economic parameters of the tube trailers, tractors and stationary storage [165–171] are listed in Table 7. Especially tube trailer have long lifetimes of 30 year and an OM of 2% [170]. The OMC consist of the tractor maintenance costs (12% of IC), fuel costs and labor costs (35€/hour) [170]. Fuel efficiency of the tractor is listed Table 3. Sea transport costs of hydrogen produced off-shore are not included.

## 5.4 Hydrogen Compression

### Technology

Compressors used in hydrogen production and fueling stations selected are of reciprocating multi-stage piston and diaphragm [164]. The electrolyzer and storage pressures define the operating pressures ranges of the compressors. The maximum flow per compressor is assumed to be 250kg/h. If a larger flow is required, multiple compressors will be installed.

The compressor at the solar system and at the wind-turbines are medium-pressure compressors. Maximum flow rate of the medium-pressure compressors are equal to the maximum hydrogen production flow rate from the electrolyzers. Energy consumption of the low pressure compressors is calculated according [95,172].

The compressor at the hydrogen fueling station is a high-pressure compressor. The maximum flow rate of the high-pressure compressor is the average daily dispensed hydrogen compressed in 12 hours [95,172,173]. Energy consumption for the high pressure compressor(s) at the fueling station are calculated using [174], taking into account a variable inlet pressure from the emptying tube trailer.

Specific compression electric energy is assumed constant over the entire operating range of the compressors and can be found in Table 6. It is assumed that equal work is done by all three compression stages with intercooling between stages back to original feed temperature. Isentropic compressor efficiency is 60% in the Near Future and assumed 80% in Mid Century [164]. Using the specific compression electric energy with the flow rate of the compressor, the compressor electric power is calculated. The motor rating of the compressor is defined according [95,172,174].

### Cost

For the Near Future scenario compressor costs are taken from [175], using the calculated motor power of the compressor for medium- and high-pressure compressors at low production volumes. For the Mid Century scenario compressor costs are calculated with the formulas for high production volumes. Economic parameters of the compressors for both scenarios can be found in Table 7, reflecting OM of 4% and 2% in Near Future and Mid Century [176].

## 5.5 Hydrogen dispensing and cooling

### Technology

Hydrogen fueling at 700 bar requires cooling [164] to reduce the temperature increase caused by the gas expansion, done by a chiller. Specific cooling electric energy [177,178] is assumed constant over the entire operating range of the chiller and can be found in Table 6.

### Sizing

Most vehicles are fueled between 6a.m. and 12p.m. [172]. About 1/12<sup>th</sup> of the average daily dispensed fuel is refueled during peak hour [95,172,174]. The filling rate for dispensers in the Near Future is 0.65 kg/min [179] and 2.0 kg/min [162] assumed in the Mid Century scenario. Therefore, hydrogen chiller capacity need to be matched with the peak fueling capacity. An average lingering time of 0.5 min per kg fueled is assumed. The average filling hose occupancy during peak hour is estimated to be 50% [155,156]. The chiller capacity is sized with the number of dispensers, dispenser filling rate and average filling hose occupancy during peak hour.

### Cost

Economic parameters of the dispensers and chillers [164,175] for both scenarios can be found in Table 7.

## 5.6 Fuel Cell Electric Vehicles

### Technology

The FCEVs have a fuel cell and a battery for regenerative braking. The combination of fuel cell and battery makes it possible to deliver almost every kind of energy service [180,181], from balancing to emergency power back-up or primary reserve. Batteries in present FCEVs for regenerative braking have capacities of approximately 1 kWh with 24kW power [66]. Tank-To-Wheel efficiency ( $\eta_{TTW}$ ) of 51.5% (HHV) for the Near Future scenario and 61.0% HHV for the Mid Century scenario [52,53]. In Vehicle-To-Grid (V2G) mode, the efficiency of converting hydrogen from the FCEV tank to electricity is assumed equal to the Tank-To-Wheel efficiency ( $\eta_{TTW}$ ).

### Cost

For the Near Future scenario a durability of 4,100 hours in automotive drive cycle is assumed [182], 53 USD/kW (47.6€/kW) [80] at a production rate of 500,000 units per year. For the Mid Century scenario, US DOE targets for a passenger car fuel cell system are assumed: durability of 8,000 hours in automotive drive cycle, fuel cell system cost of 30 USD/kW (26.9 €/kW) [53] at a production rate of 500,000 units per year.

A Fuel Cells Dynamic Load Cycle (FC-DLC) [183] based on the New European Driving Cycle (NEDC) [184] is defined. With an average speed of 44.8 km/h excluding idling time [185]. Maximum fuel cell power in the FC-DLC is approx. 34 kW [186] for constant speed driving at 120 km/h. The average load level calculated over the FC-DLC cycle is 29.02% [183], corresponding to 9.9 kW. A study [187] recommends to use cumulative produced energy as degradation indication/parameter for dynamic operated fuel cells instead of power or voltage loss over time. Annual driven distance for a passenger car is 11,940 km, see section 4.1, resulting in 267 operational hours and producing 2630 kWh. At 9.9 kW, a fuel cell system of a passenger car could produce 78,950 kWh during its lifetime in automotive driving cycle in the Mid Century scenario and 40,460 kWh in the Near Future. These values would correspond to respectively 30.0 and 15.4 years of operational lifetime in automotive drive cycle only for the Mid Century and the Near Future scenario.

It can be deduced from [130,188] that approximately 14-16 hours of balancing power is required on an average day basis, during the no/low solar electricity hours. The largest share of this balancing energy is condensed in 6-8 hours, therefore we assume an average of 6 full-load hours of balancing per day at 10 kW per passenger car. This corresponds to 21,900 kWh of annual balancing energy per car in both scenarios. The required number of passenger cars for balancing is calculated in section 6.2. It is assumed every produced kWh for electricity balancing is causing 50% of the degradation as a produced kWh in driving mode. So the production of 21,900 kWh of balancing equals 10,950 kWh degradation by driving. 10,950 kWh out of 13,580 kWh per year driving and balancing represents 81%. If fuel cell durability is larger or degradation by balancing is lower, degradation due to balancing is smaller.

Durability depends on the type of load; constant load, load changing or start-stop [189–194]. Different US DOE durability targets are set for fuel cells; 25,000 for fuel cell transit buses, 10,000 hours for fuel cell back-up power systems and 60,000-80,000 hours for fuel cell CHP units [53]. The assumption for lower degradation rate per produced kWh in balancing mode is made because we expect the load ramps, one of the main degradation factors, are smaller in balancing mode than in driving mode. This is due to the limitation of 10 kW for balancing, whereas in driving mode load ramps can be up to 100kW. Also the load ramps can be divided amongst the connected cars resulting in even smaller load ramps.

An OM of 5% [52] is included, proportional to the degradation share of electricity balancing to the total degradation for driving and electricity balancing. It is assumed the battery and other components present in the FCEV are not degraded due to electricity balancing or included in the OMC. Furthermore, it is also assumed that the actual replacement is included in the capital cost of the replacement fuel cell. The V2G output plug on the FCEVs is assumed to be a standard feature at no further cost. The cost of other fuel cell powered transport vehicles (vans, buses, trucks) are not included either, as in principle the transport vehicles are bought for the transporting services.

## 5.7 Electric Infrastructure, control and Vehicle-to-Grid (V2G) connection

### Technology

An electric grid and an IT infrastructure are present in the smart city. A central electrical control unit is in charge of managing all the power flows, measuring and predicting power consumption and production from the solar modules and power to the hydrogen production and storage and required power from the FCEVs. For FCEVs, only a V2G connection is required. Here the technology selected is based on a solar power converter technology [139]. Discharging poles will have 4 connections points of each 10kW and 1 power converter with 40kW rating. The amount of V2G connections is approximately half the amount of passenger cars in the smart city.

### Cost

The costs of V2G connections is calculated using mass production and installation of 4-point 40 kW poles, consisting of 30 Euro/kW [139,139] in the Mid Century and 110 Euro/kW [139], for both scenarios an installed cost of 2,000 Euro/pole is assumed. The installed poles include all intelligence and interconnections between buildings and vehicles. The electrical connection cost for the solar modules and hydrogen production and compression equipment is already included in those component specific installed cost. The electrical connection cost of the buildings is assumed included in the building.

## 5.8 Water Collection and Storage

### Technology

Urban rainwater is collected in a rainwater tank and then demineralized and stored in a pure water tank. Interconnecting tubing, filters and transfer pumps complete the system. Energy consumption by the rainwater collection system [195] is presented in Table 6. It is assumed that the ground floor area taken from [136] is equal to the roof area suitable for rainwater collection. The roof area potential for rainwater collection for residential buildings is 105,200 m<sup>2</sup> and for buildings of the services sector 44,500 m<sup>2</sup>.

Maximum collected rainwater from roofs is calculated by assuming a roof run-off coefficient of 0.95 [196]. No first flush volume is accounted [196]. Average European precipitation is 785 L/m<sup>2</sup>/year [197,198]. Maximum rainwater collection potential on a year basis by using the roofs of the residential buildings is 78,490 m<sup>3</sup> and 33,140 m<sup>3</sup> when using the roofs of the services buildings. Only the water required for electrolysis is collected and the size of the system is determined from the energy balance.

At the wind turbine site surface water or sea water is used, assuming sufficient supply at all times. The holding tank capacity for demineralized water is equal to 7 days of average daily demineralized water consumption from the electrolyzer.

### Cost

For rainwater collection the piping to and related equipment of the reverse osmosis system are included. The CC and OMC for all components are deducted from [133,199] and presented in Table 7.

## 5.9 Water treatment: Reverse Osmosis

### Technology

Reverse Osmosis systems can demineralize rain- or seawater for use in electrolyzer systems [200] using electric energy [201]. Energy use is listed in Table 6, for rainwater, surface water or seawater [195,201,202]. Capacities of reverse osmosis systems in the smart city are small compared to large drinking water treatment plants [148,201,203], and relatively low recovery rates of only 50% [201,204] are assumed. The capacity of the reverse osmosis equipment is equal to the maximum water requirement by the electrolyzer.

### Cost

The installed cost includes piping and connections, pre-treatment of the water such as basic filtration and infrastructure-related costs. Cost parameters [201] are listed in Table 7.

## 5.10 Solar modules

### Technology

Technical parameters of the solar electricity system are given in section 4.3. The share of direct self-consumed electricity of new-built solar electricity systems in both scenarios is assumed 38%, as given for 40kW to MW systems in [130].

### Cost

Utility scale solar system cost parameters [139] are assumed and listed in Table 7. The installed system cost includes the module cost, balance of system and inverter cost. Balance of system includes all other cost components: Mounting system, installation, DC cables, infrastructure, transformer, grid connection, and planning and documentation.

## 5.11 Wind Power

### Technology

Wind power on- or offshore is used to balance demand and supply. For the Near Future all wind power is assumed to be located on-shore. For the Mid Century scenario, half of the wind turbine power will be installed off-shore and half on-shore. The averaged capacity factor for the wind turbines installed is 35% and 46% in the Near Future scenario and the Mid Century scenario, respectively [205]. The installed wind power is calculated by completing the energy balance.

### Cost

The wind turbines are connected directly to the electrolyzers. Therefore, grid connection costs are not applicable. For on-shore wind turbines grid connection costs are on average 11.5% and for off-shore wind turbines 22.5% [206,207]. Other cost parameters [208–211] can be found in Table 7. It is assumed that wind parks are cost-shared with other smart cities, thus not requiring rounding of wind capacities to turbine sizes.

Table 5 shows the specific electricity and water production parameters. Solar and wind specific electricity production are higher in the Mid Century scenario due to the increase in solar system efficiency (section 4.3) and wind power capacity factor (section 5.11). The pure water production from collected rainwater per square meter of roof area includes the reverse osmosis recovery factor of 50% (section 5.9). The conversion of hydrogen to electricity by the FCEV is respectively 20.3 and 23.6 kWh/kg H<sub>2</sub> in the Near Future and Mid Century scenario, corresponding to the Tank-To-Wheel efficiency ( $\eta_{TTW}$ ) given in section 5.6.

Table 5 – Electricity and water production parameters.

| Component  | Specific production parameters |             |
|--|--------------------------------|-------------|
|  | Near Future                    | Mid Century |
| Solar electricity system [kWh/(kWp × year)] [138–146]                                      | 975                            | 1,170       |
| Wind Power [kWh/(kW × year)] [205]   | 3,065                          | 4,030       |
| Pure water production [m <sup>3</sup> /(m <sup>2</sup> roof × year)] [136,196–198,201,204] | 0.37                           | 0.37        |
| FCEV hydrogen to electricity [kWh/kg H <sub>2</sub> ] [52,53]                              | 20.3                           | 23.6        |

Table 6 list the specific electricity consumption in the Near Future and Mid Century scenario for the different conversion processes, from rainwater collection to hydrogen fueling at 700 bar. The specific electricity consumption for PEM electrolysis, hydrogen purification and specific cooling electric energy decrease in the Mid Century scenario compared to the Near Future, due to an increase in efficiency. The specific electricity consumption for the compressors in the smart city area and at the wind turbines increase in the Mid Century due to the higher pressure of the tube trailers in the Mid Century. Total specific electricity consumption of the compressors decreases from 3.3 kWh/kg H<sub>2</sub> in the Near-Future to 3.0 kWh/kg H<sub>2</sub> in the Mid Century. In this study no reduction of specific electricity consumption is foreseen in the Mid Century for reverse osmosis and the transfer of rainwater from the buildings to the reverse osmosis unit. From electricity to fueled hydrogen at 70 bar, is respectively 68% and 79% efficient in the Near Future and Mid Century scenario. The roundtrip efficiency from electricity via fueled hydrogen at 700 bar to electricity is respectively 35% and 47% efficient in the Near Future and Mid Century scenario.

Table 6 – Specific electricity consumption (kWh/kg H<sub>2</sub>) of the conversion processes in the smart city for both scenarios.

| Conversion processes                                    | Specific electricity consumption     |                                      |
|---|--------------------------------------|--------------------------------------|
|   | Near Future [kWh/kg H <sub>2</sub> ] | Mid Century [kWh/kg H <sub>2</sub> ] |
| PEM Electrolysis [52,154]                               | 53.4                                 | 45.8                                 |
| Hydrogen Purification [155,156]                         | 1.3                                  | 1.1                                  |
| Compressor in smart city area [95,164,172–174]          | 1.5                                  | 1.9                                  |
| Compressor at wind turbines [95,164,172–174]            | 1.5                                  | 1.9                                  |
| Compressor at hydrogen fueling station [95,164,172–174] | 1.8                                  | 1.1                                  |
| Specific cooling electric energy [177,178]              | 0.20                                 | 0.15                                 |
| Reverse Osmosis – seawater [195,201,202]                | 0.0405                               | 0.0405                               |
| Reverse Osmosis – rainwater [195,201,202]               | 0.0056                               | 0.0056                               |
| Rainwater transfer [195]                                | 0.0028                               | 0.0028                               |

Table 7 gives an overview of all economical parameters of the Smart City Area components for the Near Future and Mid Century scenario. Annual operational and maintenance cost (OM<sub>i</sub>) of the electrolyzers can vary due to difference in system size and different operational hours per year, the latter which influence stack lifetime. Installed capital costs (IC<sub>i</sub>) of the various compressors used varies due to difference in final discharge pressure and mass flow, both influencing compressor motor size and cost.

Table 7 – Economical parameters of the Smart City Area components for the Near Future and Mid Century scenario. IC<sub>i</sub> = installed capital cost, OM<sub>i</sub> = annual operational and maintenance cost expressed as an annual percentage of the installed investment cost, LT = Lifetime.

| Subsystems and components   | Near Future                      |                             |   | Mid Century                      |                             |   |
|---|----------------------------------|-----------------------------|---|----------------------------------|-----------------------------|---|
|   | IC <sub>i</sub>                  | OM <sub>i</sub><br>[%/year] | LT <sub>i</sub><br>[years] <sup>1</sup> | IC <sub>i</sub>                  | OM <sub>i</sub><br>[%/year] | LT <sub>i</sub><br>[years] <sup>1</sup> |
| <b>Hydrogen Production, Storage and Transport</b>                     |                                  |                             |   |                                  |                             |   |
| PEM electrolyzer at solar system [147,148,153,155–157]                | 1,790 €/kW                       | 2.8%                        | 20                                      | 250 €/kW                         | 2.3%                        | 30                                      |
| PEM electrolyzer at wind turbines [147,148,153,155–157]               | 1,790 €/kW                       | 2.7%                        | 20                                      | 250 €/kW                         | 3.2%                        | 30                                      |
| Tube trailers at solar system [165–171]                               | 730 €/ kg H <sub>2</sub>         | 2.0%                        | 30                                      | 510 €/ kg H <sub>2</sub>         | 2.0%                        | 30                                      |
| Tube trailers at wind turbines [165–171]                              | 730 €/ kg H <sub>2</sub>         | 2.0%                        | 30                                      | 510 €/ kg H <sub>2</sub>         | 2.0%                        | 30                                      |
| Trailer tractors [165–171]  | 160,000 €/tractor                | 109%                        | 8                                       | 160,000 €/tractor                | 91%                         | 8                                       |
| Compressor at solar system [175,176]                                  | 8,170 €/ kg H <sub>2</sub> /h    | 4.0%                        | 10                                      | 3,650 €/ kg H <sub>2</sub> /h    | 2.0%                        | 10                                      |
| Compressor at wind turbines [175,176]                                 | 5,890 €/ kg H <sub>2</sub> /h    | 4.0%                        | 10                                      | 4,200 €/ kg H <sub>2</sub> /h    | 2.0%                        | 10                                      |
| <b>Hydrogen Fueling Station (HFS)</b>                                 |                                  |                             |   |                                  |                             |   |
| Compressor at HFS [175,176]   | 11,090 €/kg H <sub>2</sub> /h    | 4.0%                        | 10                                      | 4,940 €/ kg H <sub>2</sub> /h    | 2.0%                        | 10                                      |
| Stationary storage at HFS 875 bar [165–171]                           | 1,100 €/ kg H <sub>2</sub>       | 1.0%                        | 30                                      | 575 €/ kg H <sub>2</sub>         | 1.0%                        | 30                                      |
| Dispensers units [164,175]  | 91,810 €/unit                    | 0.9%                        | 10                                      | 72,890 €/unit                    | 1.1%                        | 10                                      |
| Chiller units [164,175]   | 143,880 €/kg H <sub>2</sub> /min | 2.0%                        | 15                                      | 118,520 €/kg H <sub>2</sub> /min | 2.0%                        | 15                                      |
| <b>Fuel Cell system in FCEV for balancing only</b> [52,53,80,182–194] | 3,830 €/100 kW                   | 5.0%                        | 4,100h                                  | 2,170 €/100 kW                   | 5.0%                        | 8,000 h                                 |
| <b>Smart grid, Control and V2G infrastructure</b> [139]               | 6,400€/ 4-point dischargers      | 5%                          | 15                                      | 3,200€/ 4-point dischargers      | 5.0%                        | 15                                      |
| <b>Water collection, storage and purification</b>                     |                                  |                             |   |                                  |                             |   |
| Rainwater collection and storage [133,199]                            | 21,030 €/m <sup>3</sup> /day     | 0.33%                       | 50                                      | 21,030 €/m <sup>3</sup> /day     | 0.33%                       | 50                                      |
| Pure water tank at wind turbines [133,199]                            | 120 €/m <sup>3</sup>             | 0.33%                       | 50                                      | 120 €/m <sup>3</sup>             | 0.33%                       | 50                                      |
| Reverse Osmosis at solar system [201]                                 | 1.20 €/L/day                     | 4.8%                        | 25                                      | 1.20 €/L/day                     | 4.8%                        | 25                                      |
| Reverse Osmosis at wind turbines [201]                                | 1.20 €/L/day                     | 4.8%                        | 25                                      | 1.20 €/L/day                     | 4.8%                        | 25                                      |
| <b>Energy Production</b>  |                                  |                             |   |                                  |                             |   |
| Solar electricity system [139]  | 995 €/kWp                        | 2.0%                        | 25                                      | 440 €/kWp                        | 2.3%                        | 30                                      |
| Wind Turbines onshore [206–211]                                       | 1,110 €/kW                       | 2.8%                        | 20                                      | 800 €/kW                         | 3.2%                        | 25                                      |
| Wind Turbines off-shore [206–211]                                     | 1,880 €/kW                       | 4.5%                        | 20                                      | 1040 €/kW                        | 4.7%                        | 25                                      |

<sup>1</sup>Lifetime = Economic lifetime of components in years, except for the fuel cell system in the FCEV for which the lifetime is expressed in operating hours.

## 6 Energy balance results

### 6.1 Energy balance results

Fig. 4 shows the calculated energy balance in the smart city system in the Near Future and Mid Century scenario. The consumption of 48 GWh/year in the Near Future can be covered fully by 106 GWh renewable electricity production. Consisting of 12 GWh/year rooftop solar electricity and 95 GWh/year distant wind electricity. The difference between production and consumption is due to hydrogen conversion efficiencies. In the Mid Century scenario, consumption of 33 GWh/year is covered by 48 GWh/year production, more than two-third (69%) of the production reaches final energy consumption or 57% final energy. In the Mid Century scenario renewable electricity supply consists of 24 GWh/year rooftop solar electricity and 23 GWh/year distant wind electricity.

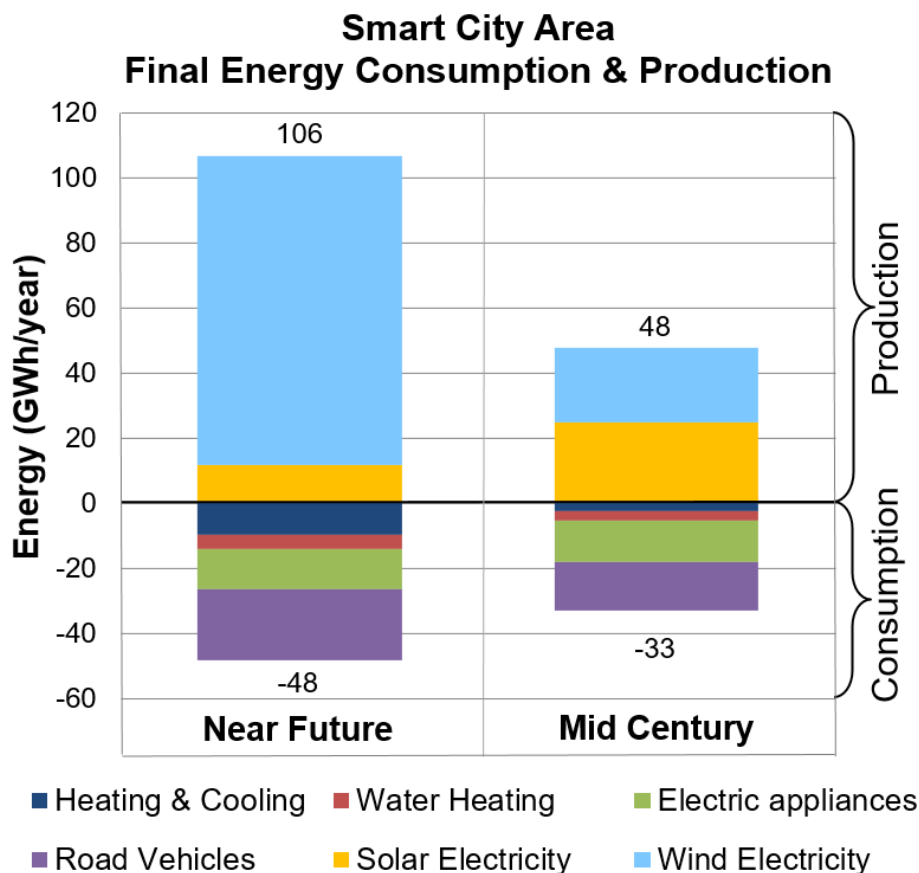


Fig. 4 – Smart City Final Energy Consumption and Production.

Fig. 5 shows all energy flows in the smart city, for both scenarios. In the Near Future scenario, the amount of wind energy is 89% of all energy needed, solar electricity provides the remaining 11%. In the Mid Century scenario, solar and wind electricity provide approximately 50% of the required energy each. In the Mid Century scenario, direct use of solar electricity is 9.5 GWh/year, 53% of all building energy used. Respectively 72 GWh/year and 31 GWh/year hydrogen is produced from surplus solar and wind electricity in the Near Future and Mid Century scenario. The hydrogen used for energy balancing is of similar magnitude as for driving in the Mid Century scenario, whereas the majority of hydrogen is for balancing the electricity demand, in the Near Future scenario. In this balancing, 48% of the energy is lost due to conversion in the Near Future scenario, whereas in the Mid Century scenario this is 40%, due to the higher fuel cell efficiency, see section 5.6.



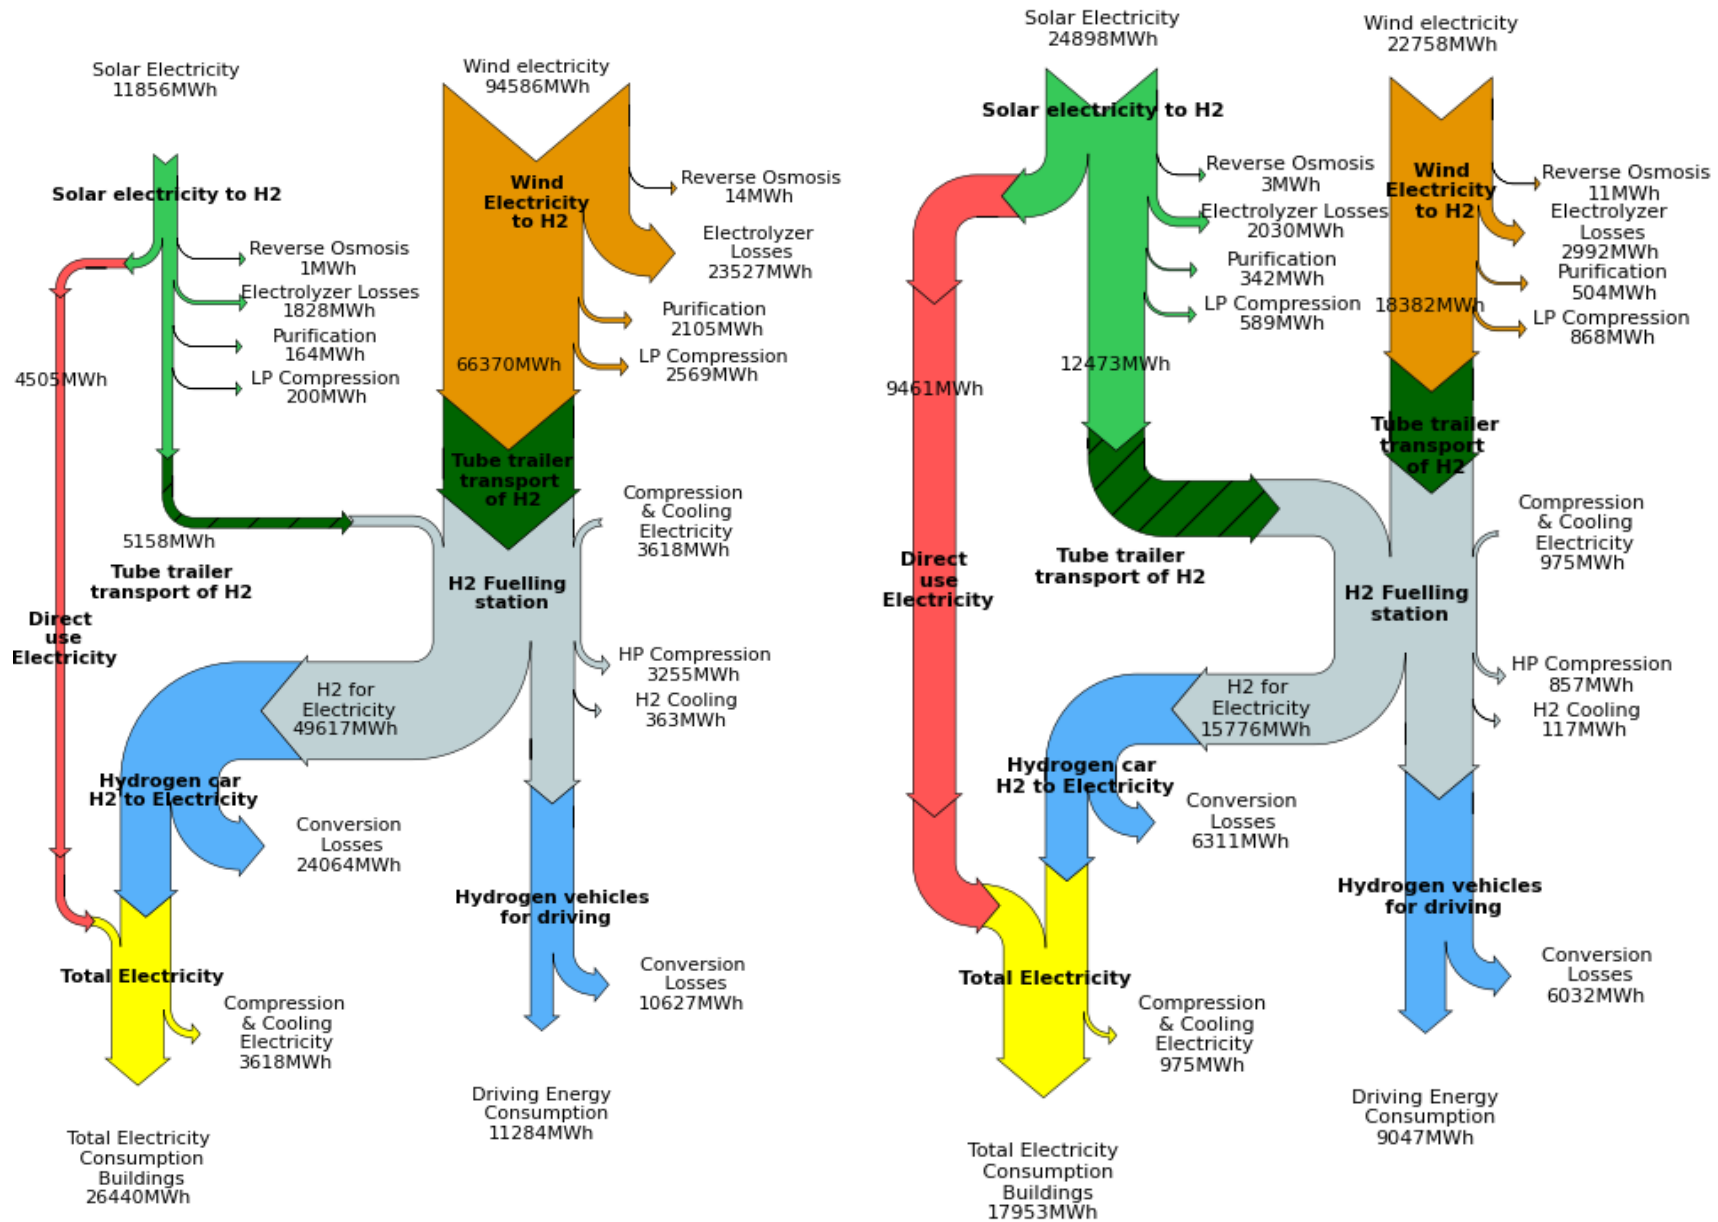


Fig. 5 – Energy Balance Near Future (left) and Mid Century scenario (right).

## 6.2 Energy balance discussion & evaluation

### **Balancing by FCEVs and H<sub>2</sub> transport**

Electricity generated from V2G connected FCEVs is 25,553 MWh/year in the Near Future scenario and in the Mid Century scenario, 9,465 MWh/year are needed. These amounts of electricity can be produced by respectively 1,167 and 423 FCEVs, 51% and 19% of the car fleet, assuming each car generating 60 kWh per day, at max power 10 kW. It can be deducted from [130,188] that approximately 14-16 hours of balancing power is required per day, during the no/low solar electricity hours. The largest share of back-up power is condensed in 6-8 hours peak hours, assuming 6 hours in this study. With 430-1170 cars, it can be managed to provide the required power at all times. If the cars can generate 20 kW (20% of the installed power) [212,213], halve the required amount of passenger cars would suffice. If more hours of balancing per car per day are assumed, proportionally less cars are needed.

When using all cars in the fleet, the average daily amount of hydrogen used for re-electrification per car is 1.5 kg for the Near Future scenario and 0.5 kg for the Mid Century scenario. With hydrogen tank storage of 5 kg [44,67,214] for the Near Future and 6.5 kg [52] for the Mid Century scenario, the average daily amount of hydrogen for re-electrification would be respectively 30% and 7% of the usable hydrogen tank content, requiring one extra tank stop per 2.7 days and 9.7 days, respectively. The normal use of the cars (home-work commuting) arranges presence of cars at demand centers: during the day at office / service sector buildings, and in the evening and at night at home [215].

### **Share of direct solar electricity consumption**

In the Mid Century scenario solar electricity generation is larger than in the Near Future scenario due to higher solar module efficiency. In Near Future, 17% of consumption is directly generated by the solar electricity system, whereas in Mid Century this is 53%. Because of the larger installed power and a significant demand reduction, in the Mid Century the share of direct solar electricity consumption has risen so much. It is also based on the assumption that demand response technology is well developed [216].

### **Water balance**

In the Mid Century and Near Future scenario rainwater use for hydrogen production in the urban area is 6,000 respectively 2,500 m<sup>3</sup>/year. Rain water collection from roofs far exceeds this water consumption, and only 2-5 % of the roofs are really required for collection.

## 7 Cost of energy results and allocation methodology

### 7.1 Smart city area total system cost of energy overview

Installed capacities, annual capital and O&M costs of all components, are presented in Table 8. Total annual costs,  $TSCoE_{SCA}$ , are 15.2 million Euro in the Near Future and 2.5 million Euro in the Mid Century scenario. In the Mid Century scenario costs are due to significant energy demand reduction, increased conversion efficiencies and cost reduction in the hydrogen cycle and renewable energy production.

Distribution of these costs are shown in Fig. 6. In the Near Future scenario, PEM electrolyzer and wind energy account for more than half of both annual capital and O&M costs of the Smart City Area. In the Mid Century scenario, PEM electrolyzer costs are reduced considerably, and wind energy and solar energy account for approximately half of both annual capital and O&M costs.

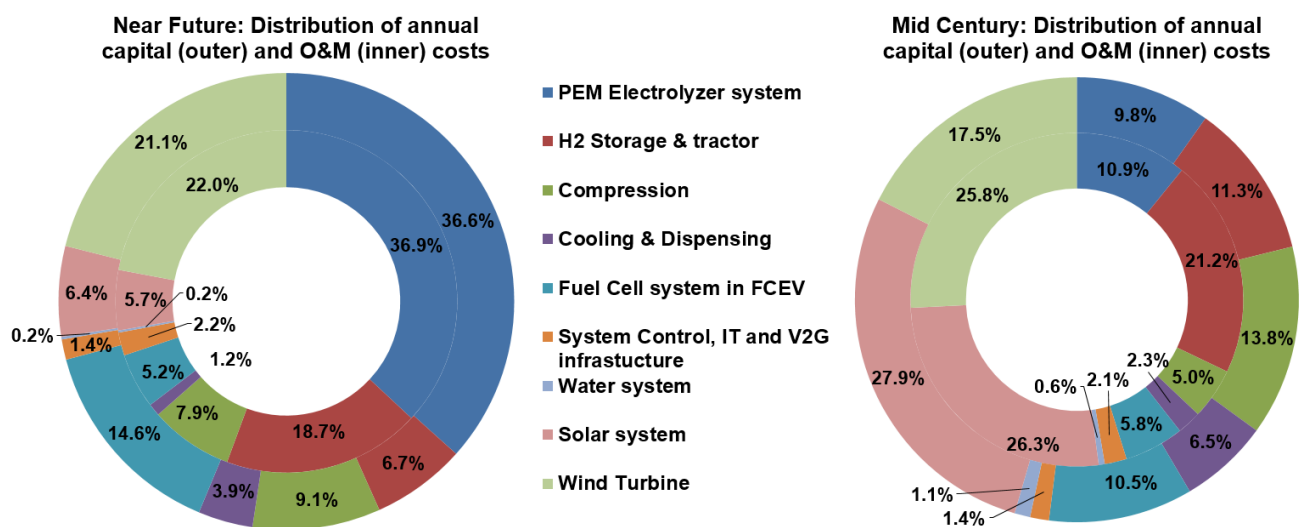


Fig. 6 — Near Future (left) and Mid Century (right) Smart City Area annual capital cost and O&M cost distribution.

Table 8 – Calculated installed capacities, capital, O&M and total costs for the components in the Smart City Area.

| Subsystems and components   | i     | Near Future                |   |  |   | Mid Century                |   |  |   |
|---|-------|----------------------------|---|--|---|----------------------------|---|--|---|
|   |       | Q <sub>i</sub>             | CC <sub>i</sub><br>[k€/year]<br>Eq. (3) | OMC <sub>i</sub><br>[k€/year]<br>Eq. (5) | TC <sub>i</sub><br>[k€/year]<br>Eq. (2) | Q <sub>i</sub>             | CC <sub>i</sub><br>[k€/year]<br>Eq. (3) | OMC <sub>i</sub><br>[k€/year]<br>Eq. (5) | TC <sub>i</sub><br>[k€/year]<br>Eq. (2) |
| <b>Hydrogen Production, Storage and Transport</b>                           |       |                            |   |  |   |                            |   |  |   |
| PEM electrolyzer at solar system  | S4    | 3,740 kW                   | 450                                     | 190                                      | 640                                     | 7,760 kW                   | 100                                     | 45                                       | 140                                     |
| PEM electrolyzer at wind turbines   | W5    | 29,330 kW                  | 3,530                                   | 1,390                                    | 4,930                                   | 5,310 kW                   | 68                                      | 43                                       | 110                                     |
| Tube trailers at solar system   | S6    | 720 kg H <sub>2</sub>      | 27                                      | 10                                       | 37                                      | 1735 kg H <sub>2</sub>     | 45                                      | 18                                       | 63                                      |
| Tube trailers at wind turbines  | W7    | 9,230 kg H <sub>2</sub>    | 340                                     | 130                                      | 480                                     | 2555 kg H <sub>2</sub>     | 66                                      | 26                                       | 92                                      |
| Trailer tractors  | HFS1  | 3.45 tractors              | 79                                      | 600                                      | 680                                     | 0.80 tractors              | 18                                      | 120                                      | 130                                     |
| Compressor at solar system  | S5    | 72 kg H <sub>2</sub> /h    | 69                                      | 23                                       | 92                                      | 173 kg H <sub>2</sub> /h   | 74                                      | 13                                       | 87                                      |
| Compressor at wind turbines   | W6    | 550 kg H <sub>2</sub> /h   | 380                                     | 130                                      | 510                                     | 116 kg H <sub>2</sub> /h   | 57                                      | 10                                       | 67                                      |
| <b>Hydrogen Fueling Station (HFS)</b>                                       |       |                            |   |  |   |                            |   |  |   |
| Compressor at HFS   | HFS2  | 415 kg H <sub>2</sub> /h   | 540                                     | 180                                      | 720                                     | 179 kg H <sub>2</sub> /h   | 104                                     | 18                                       | 120                                     |
| Stationary storage at HFS 875 bar   | HFS3  | 4,980 kg H <sub>2</sub>    | 280                                     | 55                                       | 330                                     | 2145 kg H <sub>2</sub>     | 63                                      | 12                                       | 75                                      |
| Dispensers units  | HFS4  | 29 # units                 | 310                                     | 23                                       | 340                                     | 6 # units                  | 51                                      | 4.8                                      | 56                                      |
| Chiller units   | HFS5  | 9.2 kg H <sub>2</sub> /min | 110                                     | 26                                       | 140                                     | 6.0 kg H <sub>2</sub> /min | 59                                      | 14                                       | 73                                      |
| <b>Replacement cost of Fuel Cell systems (100kW) in FCEVs for balancing</b> | FCEV2 | 1167# systems of 100kW     | 1,590                                   | 220                                      | 1,810                                   | 432# systems of 100kW      | 180                                     | 47                                       | 230                                     |
| <b>Smart grid, Control and V2G infrastructure</b>                           | FCEV1 | 292 4-point dischargers    | 160                                     | 93                                       | 250                                     | 108 4-point dischargers    | 23                                      | 17                                       | 41                                      |
| <b>Water collection, storage and purification</b>                           |       |                            |   |  |   |                            |   |  |   |
| Rainwater collection and storage  | S2    | 6.5 m <sup>3</sup> /day    | 5.3                                     | 0.5                                      | 5.7                                     | 15.6 m <sup>3</sup> /day   | 13                                      | 1.1                                      | 14                                      |
| Pure water tank at wind turbines  | W3    | 290 m <sup>3</sup>         | 1.3                                     | 0.1                                      | 1.4                                     | 80 m <sup>3</sup>          | 0.4                                     | 0.03                                     | 0.4                                     |
| Reverse Osmosis at solar system   | S3    | 15.5 m <sup>3</sup> /day   | 1.6                                     | 0.9                                      | 2.5                                     | 37.5 m <sup>3</sup> /day   | 3.8                                     | 2.2                                      | 6.0                                     |
| Reverse Osmosis at wind turbines  | W4    | 118.7 m <sup>3</sup> /day  | 12.0                                    | 6.9                                      | 18.9                                    | 25.0 m <sup>3</sup> /day   | 2.5                                     | 1.4                                      | 4.0                                     |
| <b>Energy Production</b>  |       |                            |   |  |   |                            |   |  |   |
| Solar electricity system  | S1    | 12,160 kWp                 | 690                                     | 240                                      | 940                                     | 21,280 kWp                 | 470                                     | 210                                      | 690                                     |
| Wind Turbines onshore   | W1    | 30,850 kW                  | 2,290                                   | 940                                      | 3,240                                   | 2,825 kW                   | 130                                     | 72                                       | 200                                     |
| Wind Turbines off-shore   | W2    | 0 kW                       | 0.0                                     | 0.0                                      | 0.0                                     | 2,825 kW                   | 170                                     | 140                                      | 300                                     |
| <b>Total</b>  |       |                            | 10,880                                  | 4,280                                    | 15,150                                  |                            | 1,700                                   | 810                                      | 2,500                                   |

## 7.2 Cost of energy allocation methodology

In a fully renewable and autonomous city area, electricity is produced by solar systems on the roofs of the houses and buildings. Electricity is also produced by fuel cell cars when there is a shortage of electricity from solar, which is during the night and in winter. So the system levelized cost of electricity is determined by both the levelized cost of electricity from solar and the levelized cost of electricity by fuel cell cars.

Hydrogen is produced by a wind farm which is located outside the city area and from surplus solar electricity. So the levelized cost of hydrogen is determined by both the wind farm cost and the surplus solar electricity cost.

The question is how to allocate these cost to both the system levelized cost of energy for electricity and the system levelized cost of energy for hydrogen.

### 7.2.1 Levelized cost of energy

First the levelized cost of energy for solar electricity and wind electricity is calculated.

The Levelized Cost of Energy for Solar electricity  $LCoE_{e,S}$  (€/kWh) is calculated by dividing the  $TC_{S1}$  (see Table 8 for component numbering), with the annual Energy Production of solar electricity  $EP_{e,S}$  (kWh/year) from Fig. 5:

$$LCoE_{e,S} (\text{€/kWh}) = \frac{TC_{S1}}{EP_{e,S}} \quad (10)$$

The levelized cost of energy for electricity from onshore wind  $LCoE_{e,W-onshore}$  (€/kWh) or off-shore wind  $LCoE_{e,W-offshore}$  (€/kWh) is calculated by dividing the  $TC_{W1}$  or  $TC_{W2}$  (€/year) of the on- or offshore wind turbines, with the annual Energy Production of on- or off-shore wind electricity,  $EP_{e,W-onshore}$  or  $EP_{e,W-offshore}$  (kWh/year):

$$LCoE_{e,W-onshore} (\text{€/kWh}) = \frac{TC_{W1}}{EP_{e,W-onshore}} \quad (11)$$

$$LCoE_{e,W-offshore} (\text{€/kWh}) = \frac{TC_{W2}}{EP_{e,W-offshore}} \quad (12)$$

The wind electricity is partly from onshore and offshore wind farms. The levelized cost of energy for wind electricity  $LCoE_{e,W}$  (€/kWh) is calculated by dividing both the  $TC_{W1}$  and  $TC_{W2}$  of the on- and offshore wind turbines (€/year) with the total annual Energy Production of wind electricity  $EP_{e,W}$  (kWh/year) from Fig. 5):

$$LCoE_{e,W} (\text{€/kWh}) = \frac{TC_{W1} + TC_{W2}}{EP_{e,W}} \quad (13)$$

Now the levelized cost of energy for hydrogen from wind and solar surplus electricity is calculated,  $LCoE_{H,W}$  (€/kg  $H_2$ ) and  $LCoE_{H,S-surp}$  (€/kg  $H_2$ ). In both on- and off-shore wind cases it means that besides the cost for electricity production by on- or off-shore wind, the TC for pure water production by reversed osmosis  $TC_{W3}$  and storage  $TC_{W4}$ , hydrogen production and purification by electrolysis  $TC_{W5}$ , low pressure compression  $TC_{W6}$  and tube trailer storage  $TC_{W7}$  needs to be included. The sum of aforementioned costs is divided by the Energy Production of hydrogen  $EP_{H,W}$  (kg  $H_2$ /year). For wind onshore hydrogen production this results in the following levelized cost of energy  $LCoE_{H,W-onshore}$  (€/kg  $H_2$ ):

$$LCoE_{H,W-onshore} (\text{€/kg } H_2) = \frac{TC_{W1} + \left( \sum_{W3}^{W7} TC_i \right) \times \left( \frac{EP_{e,W-onshore}}{EP_{e,W}} \right)}{EP_{H,W-onshore}} \quad (14)$$

For wind offshore hydrogen production the levelized cost of energy  $LCoE_{H,W-offshore}$  (€/kg  $H_2$ ) is calculated in a similar way:

$$LCoE_{H,W-offshore} (\text{€/kg } H_2) = \frac{TC_{W1} + \left( \sum_{W3}^{W7} TC_i \right) \times \left( \frac{EP_{e,W-offshore}}{EP_{e,W}} \right)}{EP_{H,W-offshore}} \quad (15)$$

The Levelized Cost of Energy of hydrogen from wind  $LCoE_{H,W}$  is calculated as follows:

$$LCoE_{H,W} (\text{€/kg } H_2) = \frac{\sum_{W1}^{W7} TC_i}{EP_{H,W}} \quad (16)$$

The levelized cost of energy for hydrogen produced by the solar surplus electricity is calculated  $LCoE_{H,S}$  (€/kg  $H_2$ ). The solar surplus electricity is that part of the solar electricity that cannot directly used as electricity in the smart city area  $EP_{e,S-surp}$  (kWh/year), see Fig. 5. The fraction of the solar modules costs  $TC_{S1}$  that is responsible for generating the surplus electricity and the total cost of the hydrogen production components, divided by the hydrogen production  $EP_{H,S}$  (kg  $H_2$ /year), result in the  $LCoE_{H,S}$ . The TC of the hydrogen production components consists of the costs for the rainwater collection and storage  $TC_{S2}$ , reverse osmosis  $TC_{S3}$ , hydrogen production and purification  $TC_{S4}$ , low pressure compressor  $TC_{S5}$  and tube trailer storage  $TC_{S6}$ .

$$LCoE_{H,S} (\text{€/kg } H_2) = \frac{\left( \frac{EP_{e,S-surp}}{EP_{e,S}} \right) \times TC_i + \sum_{S2}^{S6} TC_i}{EP_{H,S}} \quad (17)$$

Because only solar surplus electricity is converted into hydrogen, the capacity factor of the hydrogen production and storage equipment is relatively low and implies a relatively high price per kg hydrogen produced from surplus solar.

## 7.2.2 System levelized cost of energy

For transportation energy only hydrogen from wind is used. Electricity for buildings is supplied, directly from the solar system and from conversion of hydrogen from surplus solar and wind by FCEVs. Therefore first the system levelized cost of energy for electricity from wind hydrogen  $SLCoE_{e,W}$  (€/kWh) needs to be calculated.

Hydrogen produced from wind and surplus solar electricity needs to be transported, compressed to 875 bar, stored at the hydrogen fueling station, cooled and dispensed, before it can be reconverted into electricity by FCEVs. The components involved by these additional steps are used for both hydrogen produced from wind and surplus solar electricity. Therefore, the term system is added to the levelized cost of energy term. The energy consumption of the tube trailer tractor is included in the OMC of the tube trailer tractor. The energy consumption of the compressor and chiller at the HFS  $EC_{H,HFS}$  (kg  $H_2$ /year), is supplied by FCEVs converting hydrogen from wind into electricity. A fraction of; the energy consumption of the compressor and chiller at the HFS  $EC_{H,HFS,H-W}$  (kg  $H_2$ /year), the HFS cost of energy  $CoE_{HFS,H-W}$  (€/year) and HFS cost  $TC_{HFS,H-W}$  (€/year) are allocated to the system levelized cost of dispensed hydrogen from wind  $SLCoE_{H,W}$  (€/kg  $H_2$ ):

$$SLCoE_{H,W} (\text{€/kg } H_2) = \frac{(LCoE_{H,W} \times EP_{H,W}) + CoE_{HFS,H-W} + TC_{HFS,H-W}}{EP_{H,W}} \quad (18)$$

Where the cost of energy for compressing and cooling the hydrogen from wind  $CoE_{HFS,H-W}$  (€/year) consist of; the hydrogen cost used for electricity consumption at the HFS  $EC_{e,HFS,H-W}$  (kWh/year), a fraction of the costs for the smart grid, control, V2G infrastructure  $TC_{FCEV1}$  and the replacement of fuel cell systems in FCEVs  $TC_{FCEV2}$ , relative to the electricity production by FCEVs  $EP_{e,FCEV}$  (kWh/year):

$$CoE_{HFS,H-W} (\text{€/year}) = (EC_{H,HFS,H-W} \times LCoE_{H,W}) + \left[ \left( \frac{EC_{e,HFS,H-W}}{EP_{e,FCEV}} \right) \times (TC_{FCEV1} + TC_{FCEV2}) \right] \quad (19)$$

The fraction of the HFS cost for hydrogen from wind is calculated with costs of the tube trailer tractors  $TC_{HFS1}$ , compressor  $TC_{HFS2}$ , stationary storage  $TC_{HFS3}$ , dispenser  $TC_{HFS4}$  and chiller  $TC_{HFS5}$  units.

$$TC_{HFS,H-W} (\text{€/year}) = \left( \frac{EP_{H,W}}{EP_{H,W} + EP_{H,S}} \right) \times \sum_{HFS1}^{HFS5} TC_i \quad (20)$$

In a similar way, a fraction of; the energy consumption of the compressor and chiller at the HFS  $EC_{H,HFS,H-S}$  (kg H<sub>2</sub>/year), the HFS cost of energy  $CoE_{HFS,H-S}$  (€/year) and HFS cost  $TC_{HFS,H-S}$  (€/year), are allocated to the system levelized cost of dispensed hydrogen from surplus solar  $SLCoE_{H,S}$  (€/kg H<sub>2</sub>):

$$SLCoE_{H,S} (\text{€/kg H}_2) = \frac{(LCoE_{H,S} \times EP_{H,S}) + CoE_{HFS,H-S} + TC_{HFS,H-S}}{EP_{H,S}} \quad (21)$$

$$CoE_{HFS,H-S} (\text{€/year}) = (EC_{H,HFS,H-S} \times LCoE_{H,S}) + \left[ \left( \frac{EC_{e,HFS,H-S}}{EP_{e,FCEV}} \right) \times (TC_{FCEV1} + TC_{FCEV2}) \right] \quad (22)$$

$$TC_{HFS,H-W} (\text{€/year}) = \left( \frac{EP_{H,W}}{EP_{H,W} + EP_{H,S}} \right) \times \sum_{HFS1}^{HFS5} TC_i \quad (23)$$

The dispensed hydrogen from wind and surplus solar is then distributed by the FCEVs and converted into electricity. The system levelized cost of electricity from wind hydrogen  $SLCoE_{e,W}$  or surplus solar hydrogen  $SLCoE_{e,S}$  depends on five factors; system levelized cost of dispensed hydrogen from surplus solar  $SLCoE_{H,W}$  or wind  $SLCoE_{H,W}$ , the Tank-To-Wheel efficiency of the FCEV  $\eta_{TTW}$  (%) from section 4.1, Higher Heating Value of hydrogen  $HHV_H$  (kWh/kg H<sub>2</sub>), the relative costs of the smart grid, control, V2G infrastructure  $TC_{FCEV1}$  and replacement cost of fuel cell systems in FCEVs  $TC_{FCEV2}$ :

$$SLCoE_{e,W} (\text{€/kWh}) = \left( \frac{SLCoE_{H,W}}{HHV_H \times \eta_{TTW}} \right) + \left( \frac{TC_{FCEV1} + TC_{FCEV2}}{EP_{e,FCEV}} \right) \quad (24)$$

$$SLCoE_{e,S} (\text{€/kWh}) = \left( \frac{SLCoE_{H,S}}{HHV_H \times \eta_{TTW}} \right) + \left( \frac{TC_{FCEV1} + TC_{FCEV2}}{EP_{e,FCEV}} \right) \quad (25)$$

Electricity for buildings is supplied via three routes, directly from the solar system  $EP_{e,S-dir}$  (kWh/year), see Fig. 5, electricity from the conversion of hydrogen from surplus solar  $EC_{e,B,H-S}$  (kWh/year) and wind  $EC_{e,B,H-W}$  (kWh/year). Therefore the system levelized cost of energy for electricity  $SLCoE_e$  (€/kWh), see section 2.5.2, is a weighted average of the aforementioned electricity supply routes:

$$SLCoE_e (\text{€/kWh}) = \frac{LCoE_{e,S} \times EP_{e,S-dir} + SLCoE_{e,S} \times EC_{e,B,H-S} + SLCoE_{e,S} \times EC_{e,B,H-W}}{EP_{e,S-dir} + EC_{e,B,H-S} + EC_{e,B,H-W}} \quad (26)$$

This system levelized cost of energy for electricity includes all the cost to supply electricity to the area at all moments, so all storage and balancing cost are taken into account.

### 7.2.3 Specific cost of energy

Equation (8),  $SCoE_T$ , can be re-written into the following as only hydrogen from wind is used for transportation:

$$SCoE_{T,veh} (\text{€/km}) = \frac{SLCoE_{H,W} \times SEC_{T,veh}}{100km} \quad (27)$$

For building energy consumption, the Specific Cost of Energy for Buildings  $SCoE_B$  (€/m<sup>2</sup>/year), Equation (9) can be made specific for each sector, either residential or services:

$$SCoE_{B,sector} (\text{€/m}^2/\text{year}) = SLCoE_e \times SEC_{B,sector} \quad (28)$$

## 7.3 Cost of energy results

### 7.3.1 System levelized cost of energy

The (system) levelized cost parameters are presented in Table 9 for the Near Future and Mid Century scenarios.

A levelized cost of energy of wind and solar electricity of respectively 0.034 (LCoE<sub>e,w</sub>) and 0.079 (LCoE<sub>e,s</sub>) €/kWh in the Near Future scenario results in a system levelized cost of energy for electricity (SCLoE<sub>e</sub>, equation (26) ) of 0.41 €/kWh. Converting solar electricity into hydrogen and back into electricity again, electricity price increases from 0.079 €/kWh (LCOE<sub>e,s</sub>) to 0.70 €/kWh (SLCoE<sub>e,s</sub>) for the Near Future. For re-electrified hydrogen from wind electricity in the Near Future, price increases from 0.034 €/kWh (LCoE<sub>e,w</sub>) to 0.45 €/kWh (SLCoE<sub>e,w</sub>).

For the Mid Century LCoE<sub>e,s</sub> and LCoE<sub>e,w</sub> of respectively 0.028 and 0.022 €/kWh result in an SCLoE<sub>e</sub> of 0.088 €/kWh. Converting solar electricity into hydrogen and back into electricity again, electricity price increases from 0.028 €/kWh (LCOE<sub>e,s</sub>) to 0.70 €/kWh (SLCoE<sub>e,s</sub>) for the Mid Century. For re-electrified hydrogen from wind electricity in the Near Future, price increases from 0.034 €/kWh (LCoE<sub>e,w</sub>) to 0.45 €/kWh (SLCoE<sub>e,w</sub>).

Table 9 – Calculated (System) levelized cost parameters for the Near Future and Mid Century scenarios.

| (System) Levelized Cost parameter                      | Near Future | Mid Century |
|--|-------------|-------------|
| LCoE <sub>e,s</sub> [€/kWh] - Eq. (10)                 | 0.079       | 0.028       |
| LCoE <sub>e,w</sub> [€/kWh] - Eq. (13)                 | 0.034       | 0.022       |
| LCoE <sub>H,S</sub> [€/kg H <sub>2</sub> ] - Eq. (17)  | 10.4        | 2.3         |
| LCoE <sub>H,W</sub> [€/kg H <sub>2</sub> ] - Eq. (16)  | 5.4         | 1.7         |
| SLCoE <sub>H,S</sub> [€/kg H <sub>2</sub> ] - Eq. (21) | 12.5        | 3.1         |
| SLCoE <sub>H,W</sub> [€/kg H <sub>2</sub> ] - Eq. (18) | 7.6         | 2.4         |
| SLCoE <sub>e,s</sub> [€/kWh] - Eq. (25)                | 0.70        | 0.16        |
| SLCoE <sub>e,w</sub> [€/kWh] - Eq. (24)                | 0.45        | 0.13        |
| SLCoE <sub>e</sub> [€/kWh] - Eq. (26)                  | 0.41        | 0.088       |

It has to be kept in mind that other allocation principles will result in different System levelized cost of electricity and system levelized cost of hydrogen for transport. If for example all the hydrogen cost from the surplus electricity from solar is allocated to transport, the system levelized cost of electricity will be lower and the system levelized cost of hydrogen for transport will be higher (Table 9). Therefore in all renewable integrated energy systems, it is important to compare total energy cost for buildings and transport with these total cost for other fully renewable and reliable integrated energy systems.



Fig. 7 shows the Near Future (left) and Mid Century (right), cost distribution (outer) of 1 kWh final electricity consumption (SLCoE<sub>e</sub>) & energy distribution (inner) of 1 kWh primary electricity input. The outer ring shows the cost distribution of the System levelized cost of energy for electricity SLCoE<sub>e</sub>, which in the Near Future is 0.41 €/kWh and in the Mid Century 0.088 €/kWh (Table 9). In the Near Future the two largest cost contributors for the SLCoE<sub>e</sub> are the Electrolysis and water production equipment (Purple, 34.5%) and the Low and High Pressure Compression, Storage and Transport equipment (Cyan, 20.2%). For the Mid Century the two largest cost contributors are the share of the cost of solar electricity which is not used directly but converted into hydrogen (Red, 27.0%) and the Low and High Pressure Compression, Storage and Transport equipment (Cyan, 24.9%).

The inner ring, represents the primary input energy distribution for the consumed electricity in Buildings. The final electricity consumption consists of Electricity Solar direct use (Blue, 6.1% and 33.7%), Electricity Solar H<sub>2</sub> re-electrification (Red, 3.6% and 26.7%) and Electricity Wind H<sub>2</sub> re-electrification (Green, 26.2% and 4.3%), together respectively 35.9% and 64.0% in the Near Future and Mid Century scenario of the primary input energy. The remainder part of respectively 64.1% and 36% in the Near Future and Mid Century represent the energy losses. The energy losses are primarily dominated by the hydrogen to electricity conversion in the grid connected FCEVs (Orange, 31.2% and 21.3%), into a lesser extent the hydrogen production via electrolysis (Purple, 27.1% and 10.6%) and the Low and High Pressure Compression, Storage and Transport equipment (Cyan, 5.7% and 4.2%).

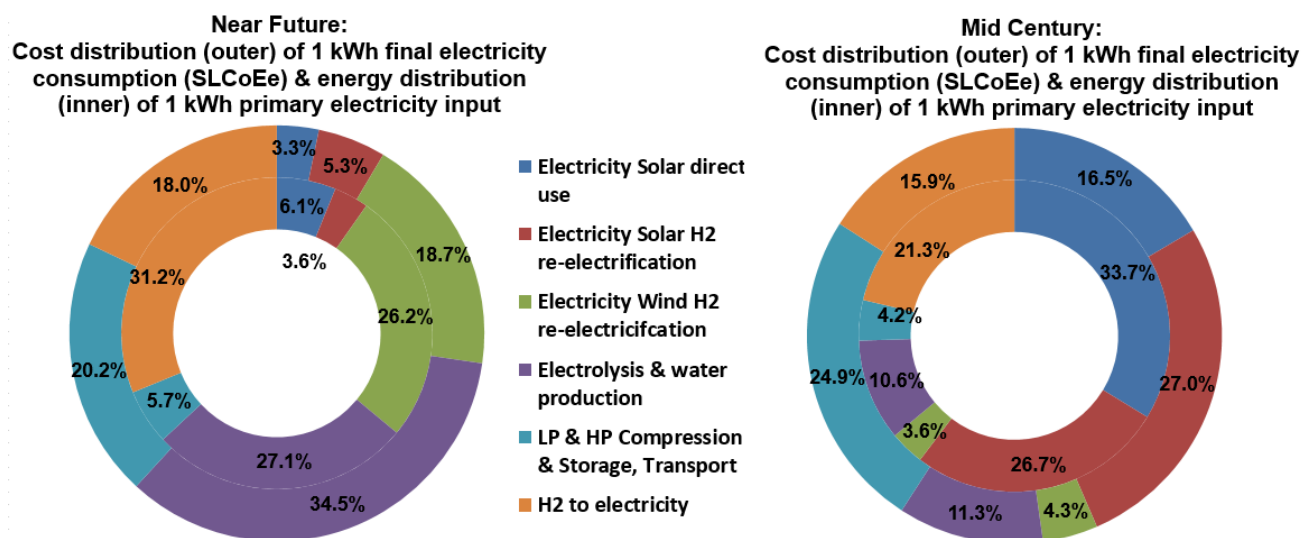


Fig. 7 – Near Future (left) and Mid Century (right), cost distribution (outer) of 1 kWh final electricity consumption (SLCoE<sub>e</sub>) & energy distribution (inner) of 1 kWh primary electricity input.

### 7.3.2 Specific cost of energy

Fig. 8 shows the SCoE<sub>B</sub> and SCoE<sub>T</sub> for the residential and the services sector. For the residential sector, the SCoE<sub>B</sub> is 33.3 €/m<sup>2</sup>/year and 4.5 €/m<sup>2</sup>/year in the Near Future and Mid Century scenario. The SCoE<sub>T</sub> is 0.076 €/km and 0.015 €/km in the Near Future and Mid Century scenario (Table 7). For the services sector, the SCoE<sub>B</sub> is 87.0 €/m<sup>2</sup>/year and 13.4 €/m<sup>2</sup>/year in the Near Future and Mid Century scenario. The SCoE<sub>T</sub> is ranging between 0.10-0.65 €/km and 0.022-0.17 €/km in the Near Future and Mid Century scenario (Table 7). The large reduction in specific costs of energy for either transport or buildings occur due to the combined decrease of system levelized cost of energy for electricity and hydrogen as well as the specific energy consumption for transport and buildings.

### 7.3.3 Smart city area total system cost of energy

Fig. 8 shows the  $TSCoE_{SCA}$  (M€/year) in the Near Future and Mid Century scenario. The  $TSCoE_{SCA}$  decreases from 15.2 M€/year in the Near Future scenario to 2.5 M€/year in the Mid Century scenario.

The large reduction in smart city area total system cost of energy and costs of energy per sector are due to the reduction of total capital and O&M costs of all components as well as the specific energy consumption for transport and buildings.



Fig. 8 – Specific Cost of Energy for Buildings (SCoE<sub>B</sub> in €/m<sup>2</sup>/year) and Transport (SCoE<sub>T</sub> €/km) per sector (Services sector upper diagram, Residential sector lower left diagram) and Smart City Area Total System Cost of Energy (TSCoE<sub>SCA</sub> in M€/year) (lower right diagram).

Fig. 9 shows the annual cost of buildings and transport energy distribution for residential and services sectors. The largest cost share is due to energy consumption in residential and services sector buildings: in the Near Future scenario 72%, in the Mid Century scenario 63%. Using the number of households 2,000 (Table 1), it can be calculated that the household annual energy costs for transport and household energy decreased from 4,030 €/year in the Near Future to 605 €/year in the Mid Century.

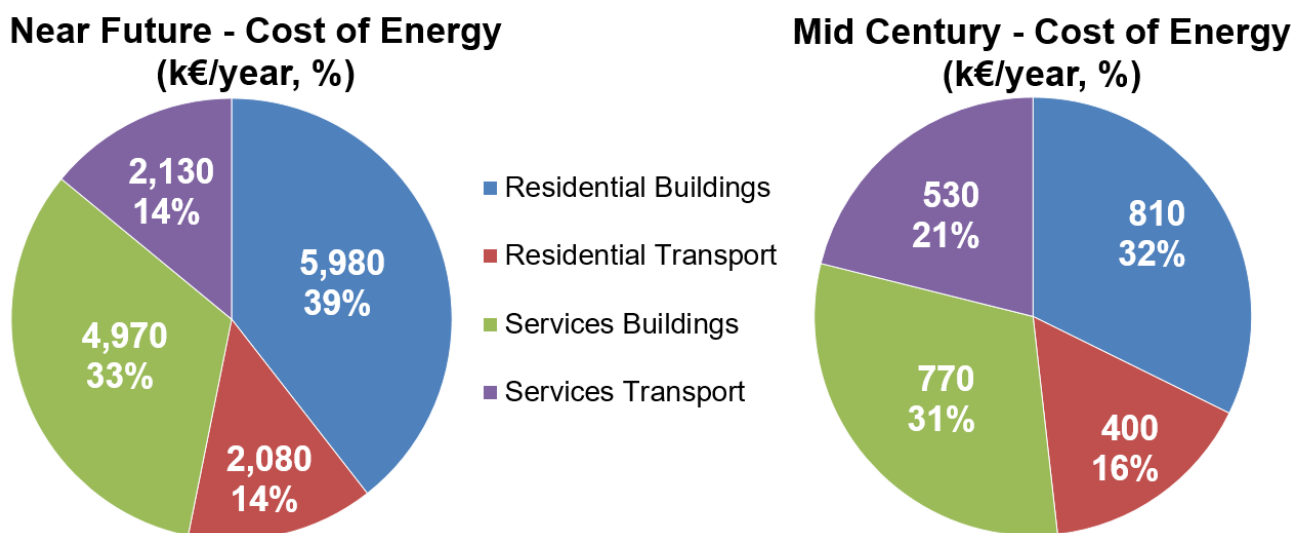


Fig. 9 – Cost of Energy distribution for the Residential and Services sector for buildings and transportation in the Near Future and Mid Century scenario.

## 8 Cost sensitivity results

A cost sensitivity analysis is performed for the Smart City Area Total System Cost of Energy ( $TSCoE_{SCA}$  in M€/year) by changing key input parameters and assumptions for the Mid Century scenario for 'pessimistic' and 'optimistic' deviations from the baseline, see Table 10. The pessimistic values result in a higher costs ( $TSCoE_{SCA}$ ), the optimistic values in lower costs ( $TSCoE_{SCA}$ ).

A higher or lower WACC has a direct impact on the  $TSCoE_{SCA}$ . The assumed range of the WACC in the sensitivity study is based on [211,217]. External factors such as (national) economic and market conditions or interest rate can have influence on the WACC [217,218]. As hydrogen technologies are still in development, future costs can deviate from predictions made today. If the learning rate or the rate of installed capacities deviates from what is expected, Mid Century costs could deviate by 30% [52,219,220]. Fuel cell cost still decreases [220,221]. In a Mid Century scenario, apart from cost, also future fuel cell efficiency and degradation rate can vary from predictions made and so influence the  $TSCoE_{SCA}$ . Application of new materials or fuel cell types, improved balance of plant or smart power management strategies could increase fuel cell system efficiency and durability. Therefore a relative increase of 7.5% in fuel cell system efficiency ( $\eta_{TTW}$ ) and specific energy consumption for transport ( $SEC_{T,veh}$ ) is assumed in the optimistic scenario. 7.5% relative increase would result in an efficiency of 64.5% HHV, less than the maximum theoretical fuel cell efficiency of 83% [222,223]. Direct solar electricity consumption [130,216], fuel cell efficiency or energy consumption reduction in buildings [224], all have a direct impact on the energy balance. Any deviation of these parameters results in more or less imported hydrogen from wind, or smaller or larger hydrogen equipment size and so influences the  $TSCoE_{SCA}$ . A wide range of building energy consumption as well as the global irradiation on optimal inclined modules in urban areas is included. These wide ranges represent the entire European continent.

Table 10 – Sensitivity parameters for a pessimistic and optimistic scenario of the Mid Century case.

| Sensitivity parameter   | Mid Century Baseline           | Optimistic Scenario relative change | Pessimistic Scenario relative change |
|---|--------------------------------|-------------------------------------|--------------------------------------|
| Weighted Average Cost of Capital (WACC)   | 3%                             | -30%                                | +30%                                 |
| Hydrogen equipment cost   | 1.1M€                          | -30%                                | +30%                                 |
| Share of direct solar electricity consumption   | 38%                            | +30%                                | -30%                                 |
| FCEV $\eta_{TTW}$ and vehicle specific energy consumption for transport ( $SEC_{T,veh}$ ) | 60.0% HHV and $SEC_{T,veh}$    | +7.5%                               | -7.5%                                |
| Fuel cell degradation factor V2G Mode   | 50%                            | -30%                                | +30%                                 |
| Energy consumption in buildings   | 18.0 GWh/year                  | -30%                                | +30%                                 |
| Global irradiation on optimal inclined modules in urban areas                             | 1,300 kWh/m <sup>2</sup> /year | +30%                                | -30%                                 |

Fig. 10 shows the results of the sensitivity analysis. The four sensitivity parameters with the largest impact on the  $TSCoE_{SCA}$  are the estimated energy savings in buildings, global irradiation on optimal inclined modules in urban areas, hydrogen equipment costs and share of direct solar electricity consumption. The sensitivity parameters impact is in the range of -2% to -27% and +2% to +27% on the Smart City Area relative change in the  $TSCoE_{SCA}$ . The optimistic cases for the share of direct solar electricity consumption, energy consumption in buildings and global irradiation on optimal inclined modules in urban areas result in situation where the buildings energy balance is positive and do not require hydrogen from wind for electricity production. Therefore a part of the hydrogen from sun can be used for driving. A relatively higher surplus solar hydrogen price therefore results in higher transportation costs, despite the decrease of the  $TSCoE_{SCA}$  and the smart city area system levelized cost of electricity  $SLCoE_e$ .

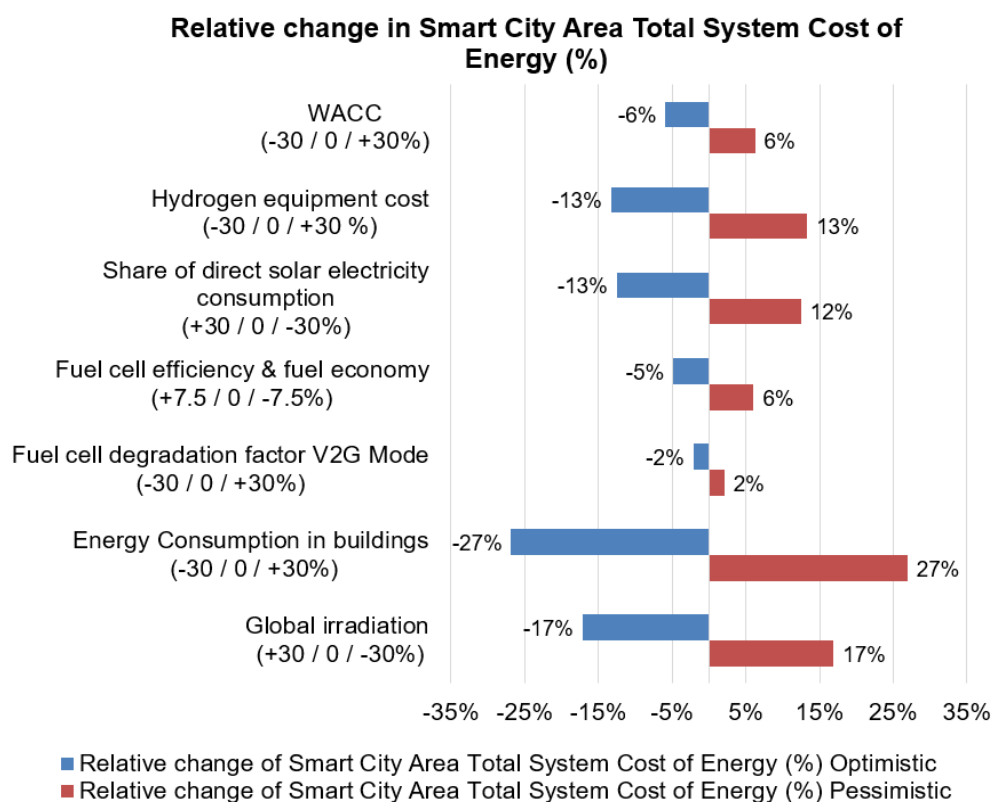


Fig. 10 – Relative change in Smart City Area Total System Cost of Energy compared to the Mid Century base scenario.

## 9 Discussion

It was concluded that the smart city design can provide the required energy at all times without any grid connection to a medium or high voltage grid. However, the potential of the smart city area with fuel cell electric cars depends on several aspects, the most important of which are discussed here.

### 9.1 Car availability and developments

The V2G electricity can be supplied by 1,170 cars for the Near Future and 430 cars in the Mid Century scenario, during 6 hours on an average day basis. For a day without any solar power, for the Near Future and Mid Century scenario, the cars can still supply all power, requiring respectively 1,375 and 865 cars, representing 60% and 38% of the car fleet.

The normal car use profiles arranges that cars are present at demand centers: during the day at office / service sector buildings and in the evening and at night at home [215] or at a car park in the smart city area [47,225]. A high degree of monitoring and automation, e.g. self-connecting and driving cars, and incentives for car owners to participate will help assuring car availability and energy security at all times at the desired locations.

New developments, such as free-floating car sharing-fleets [226] combined with autonomous driving [227,228] could provide mobility and power on demand. Due to car sharing initiatives, the number of cars per person will decrease. Most balancing electricity from FCEVs is required during night [130]. So even if car sharing spreads widely, most likely with heavy use during day time, during night time FCEVs will still be available to provide power.

The system uses only hydrogen fuel cell powered vehicles. In future it is likely to have a mix of electric powered vehicles: battery, fuel cell and hybrids of these [68], all zero emission technologies. These technologies could complement each other and could share facilities, for example the possibly future wireless V2G infrastructure [229].

### 9.2 Local climate and population density

In the sensitivity analysis a wide range of building energy consumption as well as the global irradiation on optimal inclined modules in urban areas is included. These wide ranges represent the entire European continent and its widely available solar and wind energy sources. Not included in the sensitivity analysis, is the available solar rooftop area per capita in cities, which varies as a function of population density [137].

The system size based on 2,000 households and one hydrogen fueling station results in a cost effective system. Smaller system sizes could result in slightly higher costs, as certain components are relatively more expensive at lower capacities.

### 9.3 Technology synergy effects and development

A fully autonomous smart city area is considered. However in reality these smart city areas will be interconnected with other city areas and industry sites, rural areas, etc. Therefore, system integration will result in more complex systems, with synergies leading to lower costs and higher reliability. For example if surplus electricity from solar in the summer time could be directly used for cooling at cold stores, less electricity conversion into hydrogen is needed in the smart city area, which will reduce cost. Or producing hydrogen from hydropower or biogas from agricultural residues, manure and waste water treatment plants could lead to lower prices for hydrogen. Smart integration with local heat grids and heat storage [6,230] can reduce system cost and affect economies of scale of hydrogen technologies.

The levelized cost of energy of wind or solar electricity is less than 0.03€/kWh in the Mid Century scenario, but balancing fluctuating renewable energy with energy storage and additional generators comes at a price. The hydrogen related components account for half of the total annual cost of the Smart City Area. Solar annual irradiation, energy savings measures in buildings and the share of direct solar electricity consumption have a large impact on the hydrogen equipment size and thus system cost.

For most of the hydrogen technologies used in the calculations, other technologies are being developed which are likely to be more energy efficient and/or cost effective. Examples are high temperature solid oxide or proton conducting electrolyzers [152,231], alkaline membrane [232–234] electrolyzers and direct solar to hydrogen technologies replacing solar panels and electrolyzers [235–240]. Ionic liquid piston compressors [241] and electrochemical hydrogen compression and purification [242,243] could replace compressors and purification systems. Several types of hydrogen storage methods are being investigated [159–161], but in particular liquid organic hydrogen carriers could be a cost effective alternative [244–247] and (partly) avoid the need for compressors. Also some research is performed in the field of reversible unitized (PEM) fuel cells, combining an electrolyzer and fuel cell in one device [248–251].

## 9.4 Comparing system costs with other power and transport systems

A comparison with other integrated power and transport systems is not straightforward due to combination of an integrated design, scale of the system, technologies used and projections in two technology and cost development scenarios. Balancing is commonly done using fossil resources, unlike the presented system.

The levelized cost results of the Near Future scenario can be compared with present day levelized costs of electricity. The levelized costs of electricity from wind and solar for the two scenarios are comparable with other studies, 0.02-0.08 €/kWh [139,188,211,252]. The levelized cost of dispensed hydrogen from wind or solar electricity in the Mid Century scenario is in a similar range as other studies, 2-4 €/kg H<sub>2</sub> [52,153,157]. Specific Costs of Energy for Transportation for the Near Future scenario for passenger cars is lower than the hydrogen cost per kilometer of 0.10-0.31€/km calculated by NREL [3] for a smaller integrated power and transport system with electricity grid connection. The levelized cost of electricity including storage and reconversion of 0.40€/kWh as calculated by NREL [3] is comparable with the Near Future SLCoE<sub>e</sub> of 0.41€/kWh. The Mid Century SLCoE<sub>e</sub> of 0.09€/kWh is of similar magnitude as the 100% renewable system electricity cost 0.10€/kWh in 2050-2055 in [253]. In conclusion, the designed system has equivalent costs for the parameters where comparison with other studies could be performed.

System levelized electricity costs are very hard to compare to other studies, and in this discussion we focus on some methodological observations. The SLCoE<sub>e</sub> cannot be compared directly with any future conventional or fossil based electricity cost [253]. For example conventional electricity cost projections do not integrate transportation, power and heating/cooling. Conventional calculations do not account for a multitude of avoided costs, such as health and climate related savings [254,255], possible avoidance of electric grid congestion problems [256–259] or using different energy carriers than electricity and hydrogen. Avoided costs are more complex to estimate than levelized costs because it requires information about how a similar system would have operated without the described system changes [260]. Therefore attempts are made to include these in cost calculations, such as the methodology of the Levelized Avoided Cost of Electricity [261]. The designed system is independent of any future fuel costs or High and Medium Voltage electricity grids, natural gas and district heating grids or expansion of these, and including these as avoided costs seems reasonable, hard to quantify, and for various stakeholders arguable.

## 10 Conclusion

It is concluded that for smart city areas, solar and wind electricity together with fuel cell electric vehicles as energy generators and distributors and hydrogen as energy carrier, can provide a 100% renewable, reliable and cost effective energy system, for power, heat, and transport.

A smart city area is designed and dimensioned based on European statistics. The smart city area consists of 180,000 m<sup>2</sup> floor area of residential and 57,000 m<sup>2</sup> floor area services sector buildings and 2,800 fuel cell powered road transport vehicles. 2,000 households with 4,700 inhabitants is an appropriate size for dimensioning the smart city area as statistically there is one petrol station and one food-retail shop.

All electricity and hydrogen can be supplied by solar and wind to fulfill the energy demand for power, heat and transport. Electricity is generated by solar modules on all roofs. Surplus solar electricity is converted via water-electrolysis with rainwater into pure hydrogen. The hydrogen is compressed and transported by tube trailer modules to the nearby Hydrogen Fueling Station. At the Hydrogen Fueling Station, the hydrogen is further compressed to fuel all types of fuel cell powered electric vehicles; passenger cars, vans, motorcycles, buses and trucks. In case of a temporary shortage in production of solar electricity, the fuel cells in grid-connected passenger cars provide the necessary electricity by converting hydrogen from the on-board hydrogen storage tanks. At parking places at home, office or at the local shopping area, vehicle-to-grid points connect the cars to the smart city electrical grid. To provide year round energy supply, distant on-shore or off-shore wind-electricity is converted at the wind turbine park into hydrogen via water-electrolysis with surface or seawater. The produced hydrogen from wind is transported via tube trailers to a hydrogen fueling station.

An energy balance and cost analysis is performed for a Near Future and Mid Century scenario. Technological and cost data is collected of all system components, using existing technologies and well-documented technology and cost development projections. In the Near Future, renewable electricity supply consists of 12 GWh/year rooftop solar electricity and 95 GWh/year distant wind electricity producing hydrogen. 4.5 GWh/year of solar electricity is used directly and 72 GWh/year hydrogen is produced from surplus solar and wind electricity. In the Mid Century scenario renewable electricity supply consists of 24 GWh/year rooftop solar electricity and 23 GWh/year distant wind electricity producing hydrogen. 9.5 GWh/year of solar electricity is used directly and 31 GWh/year hydrogen is produced from surplus solar and wind electricity. This lower renewable electricity production is possible due to savings in final energy consumption in buildings and transport, higher use of direct solar energy due to demand side management and efficiency increase in hydrogen production and fuel cell technologies.

The smart city area energy supply is reliable at all times and independent of other energy systems and grid connections. Reliability of energy supply is guaranteed by converting temporary surplus solar and distant wind electricity into hydrogen and through electricity supply with grid-connected fuel cell electric passenger cars providing 10 kW each (10% of installed power). The balancing electricity can be supplied by 1,170 cars for the Near Future and 430 cars in the Mid Century scenario, during 6 hours on an average day basis. For a day without any solar power, for the Near Future and Mid Century scenario, the cars can still supply all power, requiring respectively 1,375 and 865 cars, representing 60% and 38% of the car fleet. If the cars can generate 20 kW (20% of the installed power) halve the required of amount passenger cars would suffice. If more hours of balancing per car per day are assumed, proportionally less cars are needed.

In conclusion, the fuel cell electric vehicle and renewable energy based smart city area can provide a future cost effective energy supply, as the annual total system cost of energy demand for power, heat and transport is 15 M€/year in the Near Future and 2.5 M€/year in the Mid Century scenario for the entire smart city area. This corresponds to an average annual cost for power, heat and mobility of 600 €/year per household for the Mid Century scenario. In the Near Future scenario system levelized cost of hydrogen for transportation is 7.6 €/kg, system levelized cost of electricity is 0.41 €/kWh and the specific cost of energy for passenger cars is 0.08 €/km. In the Mid Century scenario however, this is only 2.4 €/kg, 0.09 €/kWh and 0.02 €/km. System levelized cost of energy and specific energy costs compare favorably with other scenario studies describing fully renewable energy and transport systems.

Future dynamic simulations and tailoring to geographical demand and climate conditions is needed to calculate system cost, and FCEV fleet deployment for specific city areas in Europe. Also other configurations using different renewable energy sources and different storage and conversion technologies is of interest for future research.

## Acknowledgments

This work was supported by The Netherlands Organisation for Scientific Research (NWO) [Program 'Uncertainty Reduction in Smart Energy Systems (URSES)', Project number 408-13-001].

## References

- [1] United Nations (UN), Adoption of the Paris Agreement - Framework Convention on Climate Change. (2015). <https://unfccc.int/resource/docs/2015/cop21/eng/l09r01.pdf> (accessed September 28, 2016).
- [2] International Energy Agency (IEA), Energy Technology Perspectives 2016: Towards Sustainable Urban Energy Systems. (2016).
- [3] D. Steward, J. Zuboy, Community Energy: Analysis of Hydrogen Distributed Energy Systems with Photovoltaics for Load Leveling and Vehicle Refueling, National Renewable Energy Laboratory, 2014.
- [4] A. Maroufmashat, M. Barbouti, H. El-shayeb, J. Ranisau, A. Trainor, U. Mukherjee, Development of a Hydrogen Powered Microgrid for grid services and backup - Hydrogen Student Design Competition 2016, 2016. [http://www.hydrogencontest.org/pdf/2016/University\\_of\\_Waterloo.pdf](http://www.hydrogencontest.org/pdf/2016/University_of_Waterloo.pdf) (accessed October 17, 2016).
- [5] B.V. Mathiesen, H. Lund, D. Connolly, H. Wenzel, P.A. Ostergaard, B. Möller, et al., Smart Energy Systems for coherent 100% renewable energy and transport solutions, Appl. Energy. 145 (2015) 139–154.
- [6] F. Orecchini, A. Santiangeli, Beyond smart grids-the need of intelligent energy networks for a higher global efficiency through energy vectors integration, Int. J. Hydrogen Energy. 36 (2011) 8126–8133.
- [7] S. Garmsiri, S. Koohi-Fayegh, M.A. Rosen, G.R. Smith, Integration of transportation energy processes with a net zero energy community using captured waste hydrogen from electrochemical plants, Int. J. Hydrogen Energy. 41 (2016) 8337–8346.



- [8] S. Cao, K. Alanne, Technical feasibility of a hybrid on-site H<sub>2</sub> and renewable energy system for a zero-energy building with a H<sub>2</sub> vehicle, *Appl. Energy*. 158 (2015) 568–583.
- [9] S. Cao, Comparison of the energy and environmental impact by integrating a H<sub>2</sub> vehicle and an electric vehicle into a zero-energy building, *Energy Conversion and Management*. 123 (2016) 153–173.
- [10] S. Barret, Toshiba starts 'H2One' independent energy supply, *Fuel Cells Bulletin*. 2015 (2015) 1.
- [11] D. Parra, M. Gillott, G.S. Walker, Design, testing and evaluation of a community hydrogen storage system for end user applications, *Int. J. Hydrogen Energy*. 41 (2016) 5215–5229.
- [12] V. Mohan, A. Shah, J.W. Sheffield, K.B. Martin, Design of a hydrogen community, *Int. J. Hydrogen Energy*. 37 (2012) 1214–1219.
- [13] G. Tzamalīs, E. Zoulias, E. Stamatakis, O.-S. Parissis, A. Stubos, E. Lois, Techno-economic analysis of RES & hydrogen technologies integration in remote island power system, *Int. J. Hydrogen Energy*. 38 (2013) 11646–11654.
- [14] W. Wu, V.I. Christiana, S.-A. Chen, J.-J. Hwang, Design and techno-economic optimization of a stand-alone PV (photovoltaic)/FC (fuel cell)/battery hybrid power system connected to a wastewater-to-hydrogen processor, *Energy*. 84 (2015) 462–472.
- [15] R. Lacko, B. Drobnič, M. Mori, M. Sekavčnik, M. Vidmar, Stand-alone renewable combined heat and power system with hydrogen technologies for household application, *Energy*. 77 (2014) 164–170.
- [16] M. Uzunoglu, O. Onar, M. Alam, Modeling, control and simulation of a PV/FC/UC based hybrid power generation system for stand-alone applications, *Renewable Energy*. 34 (2009) 509–520.
- [17] O. Ulleberg, Stand-alone power systems for the future: optimal design, operation and control of solar-hydrogen energy systems, NTNU, Trondheim, Norvège. (1998).
- [18] J. Andrews, B. Shabani, Dimensionless analysis of the global techno-economic feasibility of solar-hydrogen systems for constant year-round power supply, *Int. J. Hydrogen Energy*. 37 (2012) 6–18.
- [19] M. Little, M. Thomson, D. Infield, Electrical integration of renewable energy into stand-alone power supplies incorporating hydrogen storage, *Int. J. Hydrogen Energy*. 32 (2007) 1582–1588.
- [20] G. Zini, A. Dalla Rosa, Hydrogen systems for large-scale photovoltaic plants: Simulation with forecast and real production data, *Int. J. Hydrogen Energy*. 39 (2014) 107–118.
- [21] D. Parra, G.S. Walker, M. Gillott, Modeling of PV generation, battery and hydrogen storage to investigate the benefits of energy storage for single dwelling, *Sustainable Cities and Society*. 10 (2014) 1–10.
- [22] B. Shabani, J. Andrews, S. Watkins, Energy and cost analysis of a solar-hydrogen combined heat and power system for remote power supply using a computer simulation, *Solar Energy*. 84 (2010) 144–155.

- [23] E. Bernier, J. Hamelin, K. Agbossou, T.K. Bose, Electric round-trip efficiency of hydrogen and oxygen-based energy storage, *Int. J. Hydrogen Energy*. 30 (2005) 105–111.
- [24] O. Onar, M. Uzunoglu, M. Alam, Dynamic modeling, design and simulation of a wind/fuel cell/ultra-capacitor-based hybrid power generation system, *J. Power Sources*. 161 (2006) 707–722.
- [25] A. Yilanci, I. Dincer, H. Ozturk, A review on solar-hydrogen/fuel cell hybrid energy systems for stationary applications, *Progress in Energy and Combustion Science*. 35 (2009) 231–244.
- [26] M. Castañeda, A. Cano, F. Jurado, H. Sanchez, L.M. Fernandez, Sizing optimization, dynamic modeling and energy management strategies of a stand-alone PV/hydrogen/battery-based hybrid system, *Int. J. Hydrogen Energy*. 38 (2013) 3830–3845.
- [27] M. Eroglu, E. Dursun, S. Sevenscan, J. Song, S. Yazici, O. Kilic, A mobile renewable house using PV/wind/fuel cell hybrid power system, *Int. J. Hydrogen Energy*. 36 (2011) 7985–7992.
- [28] E. Dursun, B. Acarkan, O. Kilic, Modeling of hydrogen production with a stand-alone renewable hybrid power system, *Int. J. Hydrogen Energy*. 37 (2012) 3098–3107.
- [29] Y. Kalinci, A. Hepbasli, I. Dincer, Techno-economic analysis of a stand-alone hybrid renewable energy system with hydrogen production and storage options, *Int. J. Hydrogen Energy*. 40 (2015) 7652–7664.
- [30] G. Gahleitner, Hydrogen from renewable electricity: An international review of power-to-gas pilot plants for stationary applications, *Int. J. Hydrogen Energy*. 38 (2013) 2039–2061.
- [31] A. Kriston, T. Szabó, G. Inzelt, The marriage of car sharing and hydrogen economy: A possible solution to the main problems of urban living, *Int. J. Hydrogen Energy*. 35 (2010) 12697–12708.
- [32] X. Zhang, S.H. Chan, H.K. Ho, S.-C. Tan, M. Li, G. Li, et al., Towards a smart energy network: The roles of fuel/electrolysis cells and technological perspectives, *Int. J. Hydrogen Energy*. 40 (2015) 6866–6919.
- [33] R. Gammon, A. Roy, J. Barton, M. Little, Hydrogen and renewables integration (HARI), Case Study of International Energy Agency Hydrogen Implementing Agreement (IEAHIA). (2006).
- [34] H.C. Davies, N. Datardina, A probabilistic model for 1st stage dimensioning of renewable hydrogen transport micro-economies, *Renewable Energy*. 60 (2013) 355–362.
- [35] M. Newborough, A. Peacock, Micro-generation systems and electrolyzers for refuelling private bi-fuel cars at home, *Int. J. Hydrogen Energy*. 34 (2009) 4438–4451.
- [36] H. Miland, \Oystein Ulleberg, Testing of a small-scale stand-alone power system based on solar energy and hydrogen, *Solar Energy*. 86 (2012) 666–680.
- [37] N.A. Kelly, T.L. Gibson, D.B. Ouwerkerk, A solar-powered, high-efficiency hydrogen fueling system using high-pressure electrolysis of water: design and initial results, *Int. J. Hydrogen Energy*. 33 (2008) 2747–2764.
- [38] \Oystein Ulleberg, T. Nakken, A. Ete, The wind/hydrogen demonstration system at Utsira in Norway: Evaluation of system performance using operational data and updated hydrogen energy system modeling tools, *Int. J. Hydrogen Energy*. 35 (2010) 1841–1852.

- [39] F. Syed, M. Fowler, D. Wan, Y. Maniyali, An energy demand model for a fleet of plug-in fuel cell vehicles and commercial building interfaced with a clean energy hub, *Int. J. Hydrogen Energy*. 35 (2010) 5154–5163.
- [40] J.K. Kissock, Combined heat and power for buildings using fuel-cell cars, *SOLAR ENGINEERING*. (1998) 121–132.
- [41] B.D. Williams, others, *Commercializing Light-Duty Plug-In/Plug-Out Hydrogen-Fuel-Cell Vehicles: “Mobile Electricity” Technologies, Early California Household Markets, and Innovation Management*, 2007.
- [42] B.D. Williams, K.S. Kurani, Commercializing light-duty plug-in/plug-out hydrogen-fuel-cell vehicles: “Mobile Electricity” technologies and opportunities, *J. Power Sources*. 166 (2007) 549–566.
- [43] R.C. Samsun, *Global Development Status of Fuel Cell Vehicles*, *Fuel Cells: Data, Facts, and Figures*. (2016).
- [44] Toyota Motor Corporation (TMC), *Toyota Global Newsroom: Outline of the Mirai*. (2014). <http://newsroom.toyota.co.jp/en/download/13241306> (accessed September 28, 2016).
- [45] Honda Motor Company (HMC), *Honda Worldwide | Technology Picture Book | Power Exporter 9000*. (2016). <http://world.honda.com/powerproducts-technology/PowerExporter9000/> (accessed September 28, 2016).
- [46] K. Shinoda, E.P. Lee, M. Nakano, Z. Lukszo, Optimization model for a microgrid with fuel cell vehicles, in: *2016 IEEE 13th International Conference on Networking, Sensing, and Control (ICNSC)*, 2016: pp. 1–6.
- [47] A. Fernandes, T. Woudstra, A. van Wijk, L. Verhoef, P. Aravind, Fuel cell electric vehicle as a power plant and SOFC as a natural gas reformer: An exergy analysis of different system designs, *Appl. Energy*. 173 (2016) 13–28.
- [48] W. Kempton, J. Tomic, S. Letendre, A. Brooks, T. Lipman, Vehicle-to-grid power: battery, hybrid, and fuel cell vehicles as resources for distributed electric power in California, *Institute of Transportation Studies*. (2001). <http://www1.udel.edu/V2G/docs/V2G-Cal-2001.pdf> (accessed October 17, 2016).
- [49] E.P. Lee, É. Chappin, Z. Lukszo, P. Herder, The Car as Power Plant: Towards socio-technical systems integration, in: *PowerTech, 2015 IEEE Eindhoven*, 2015: pp. 1–6.
- [50] P. Brooker, N. Qin, N. Mohajeri, Fuel Cell Vehicles as Back-Up Power Options, *The Electrochemical Society Interface*. 24 (2015) 57–60.
- [51] N. Nomura, T. Fukunaga, J. Suzuki, Cogeneration vehicle system utilizing a fuel cell car and a mobile unit as a component of the system, (2006).
- [52] International Energy Agency (IEA), *2015 Technology Roadmap: Hydrogen and Fuel Cells*. (2015). <http://www.iea.org/publications/freepublications/publication/technology-roadmap-hydrogen-and-fuel-cells.html> (accessed August 23, 2016).
- [53] Fuel Cell Technologies Office (FCTO) - U.S. Department of Energy (DOE), *Multi-Year Research, Development, and Demonstration (MYRD&D) Plan, Section 3.4 Fuel Cells*. (2016). [http://energy.gov/sites/prod/files/2016/06/f32/fcto\\_myRDD\\_fuel\\_cells\\_0.pdf](http://energy.gov/sites/prod/files/2016/06/f32/fcto_myRDD_fuel_cells_0.pdf) (accessed August

23, 2016).

- [54] A. Van Wijk, L. Verhoef, *Our car as power plant*, IOS Press, ISBN 978-1-61499-377-3, 2014.
- [55] I. Dincer, C. Acar, Review and evaluation of hydrogen production methods for better sustainability, *Int. J. Hydrogen Energy*. (2015).
- [56] R. Chaubey, S. Sahu, O.O. James, S. Maity, A review on development of industrial processes and emerging techniques for production of hydrogen from renewable and sustainable sources, *Renewable and Sustainable Energy Reviews*. 23 (2013) 443–462.
- [57] J.D. Holladay, J. Hu, D.L. King, Y. Wang, An overview of hydrogen production technologies, *Catalysis Today*. 139 (2009) 244–260.
- [58] E. Promes, T. Woudstra, L. Schoenmakers, V. Oldenbroek, A.T. Thattai, P. Aravind, Thermodynamic evaluation and experimental validation of 253MW Integrated Coal Gasification Combined Cycle power plant in Buggenum, Netherlands, *Appl. Energy*. 155 (2015) 181–194.
- [59] A.T. Thattai, V. Oldenbroek, L. Schoenmakers, T. Woudstra, P. Aravind, Experimental model validation and thermodynamic assessment on high percentage (up to 70%) biomass co-gasification at the 253MW e integrated gasification combined cycle power plant in Buggenum, The Netherlands, *Appl. Energy*. 168 (2016) 381–393.
- [60] Á. Serna, F. Tadeo, Offshore hydrogen production from wave energy, *Int. J. Hydrogen Energy*. 39 (2014) 1549–1557.
- [61] World Health Organization (WHO), *Urban Population Growth - Global Health Observatory (GHO) Data*. (2014).  
[http://www.who.int/gho/urban\\_health/situation\\_trends/urban\\_population\\_growth\\_text/en/](http://www.who.int/gho/urban_health/situation_trends/urban_population_growth_text/en/) (accessed August 19, 2016).
- [62] K. Meier, Hydrogen production with sea water electrolysis using Norwegian offshore wind energy potentials, *International Journal of Energy and Environmental Engineering*. 5 (2014) 1–12.
- [63] Det Norske Veritas Germanischer Lloyd (DNV GL), *Offshore Production of Renewable Hydrogen, SUMMER PROJECT 2015*. (2015).  
<http://production.presstogo.com/fileroot7/gallery/DNVGL/files/original/9af5ee9d44454df49592fddbe5c959b3.pdf> (accessed September 29, 2016).
- [64] International Energy Agency (IEA), *Next-Generation Wind and Solar Power - From Cost to Value*. (2016).  
<http://www.iea.org/publications/freepublications/publication/NextGenerationWindandSolarPower.pdf> (accessed October 16, 2016).
- [65] T. Yoshida, K. Kojima, Toyota MIRAI Fuel Cell Vehicle and Progress Toward a Future Hydrogen Society, *The Electrochemical Society Interface*. 24 (2015) 45–49.
- [66] Hyundai Motor Company (HMC), *Hyundai ix35 Fuel Cell*. (2016).  
<http://worldwide.hyundai.com/WW/Showroom/Eco/ix35-Fuel-Cell/PIP/index.html> (accessed August 19, 2016).
- [67] Honda Motor Company (HMC), *Honda Begins Sales of All-New Clarity Fuel Cell - Clarity Fuel Cell Realizes the World's Top-Class Cruising Range among Zero Emission Vehicles of*

Approximately 750 Km -. (2016).

<http://world.honda.com/news/2016/4160310eng.html?from=r> (accessed August 19, 2016).

- [68] Daimler AG, Under the Microscope: Mercedes-Benz GLC F-CELL: The Fuel Cell Gets a Plug. (2016). <http://media.daimler.com/marsMediaSite/en/instance/ko/Under-the-microscope-Mercedes-Benz-GLC-F-CELL-The-fuel-cell-.xhtml?oid=11111320> (accessed August 19, 2016).
- [69] P.E. Dodds, P. Ekins, A portfolio of powertrains for the UK: An energy systems analysis, Int. J. Hydrogen Energy. 39 (2014) 13941–13953.
- [70] McKinsey & Company, A Portfolio of Power-Trains for Europe: A Fact-Based Analysis. (2010). [http://www.fch.europa.eu/sites/default/files/Power\\_trains\\_for\\_Europe\\_0.pdf](http://www.fch.europa.eu/sites/default/files/Power_trains_for_Europe_0.pdf) (accessed October 16, 2016).
- [71] The International Zero-Emission Vehicle Alliance, Accelerating the Adoption of Zero-Emission Vehicles. (2016). <http://www.zevalliance.org/> (accessed August 22, 2016).
- [72] Hydrogen Mobility Europe (H2ME). (2016). <http://h2me.eu/> (accessed August 22, 2016).
- [73] Hydrogen Link Denmark, National Implementation Plan (NIP) for Hydrogen Refueling Infrastructure, Part of the HIT Project, Denmark. (2014). [http://www.hydrogenlink.net/download/reports/HIT-NIP-Denmark\\_3rd-final\\_June-2014.pdf](http://www.hydrogenlink.net/download/reports/HIT-NIP-Denmark_3rd-final_June-2014.pdf) (accessed August 22, 2016).
- [74] UK H2Mobility, Hydrogen: Fuelling Cleaner Motoring. (2016). <http://www.ukh2mobility.co.uk/> (accessed August 22, 2016).
- [75] Air Resources Board (ARB) - California Environmental Protection Agency (CalEPA), 2016 Annual Evaluation of Hydrogen Fuel Cell Electric Vehicle Deployment and Hydrogen Fuel Station Network Development. (2016). [https://www.arb.ca.gov/msprog/zevprog/ab8/ab8\\_report\\_2016.pdf](https://www.arb.ca.gov/msprog/zevprog/ab8/ab8_report_2016.pdf) (accessed October 17, 2016).
- [76] C. Yang, J.M. Ogden, Renewable and low carbon hydrogen for California-Modeling the long term evolution of fuel infrastructure using a quasi-spatial TIMES model, Int. J. Hydrogen Energy. 38 (2013) 4250–4265.
- [77] Ministry of Economy, Trade and Industry (METI), Compilation of the Revised Version of the Strategic Roadmap for Hydrogen and Fuel Cells. (2016). [http://www.meti.go.jp/english/press/2016/0322\\_05.html](http://www.meti.go.jp/english/press/2016/0322_05.html) (accessed August 19, 2016).
- [78] Clean Energy Partnership (CEP), (2016). <https://cleanenergypartnership.de/en/home/> (accessed August 22, 2016).
- [79] H2 Mobility, Wasserstoff-Tankstellen Infrastruktur 2023≈400. (2016). <http://h2-mobility.de/en/> (accessed August 22, 2016).
- [80] J. Marcinkoski, J. Spendelow, A. Wilson, D. Papageorgopoulos, Fuel Cell System Cost - 2015 - DOE Hydrogen and Fuel Cells Program Record, U.S. Department of Energy (DOE). (2015). [https://www.hydrogen.energy.gov/pdfs/15015\\_fuel\\_cell\\_system\\_cost\\_2015.pdf](https://www.hydrogen.energy.gov/pdfs/15015_fuel_cell_system_cost_2015.pdf) (accessed October 17, 2016).

- [81] J. Rifkin, *The hydrogen economy: The creation of the worldwide energy web and the redistribution of power on earth*, Penguin, 2003.
- [82] M. Ball, M. Weeda, *The hydrogen economy-vision or reality?*, *Int. J. Hydrogen Energy*. 40 (2015) 7903–7919.
- [83] R. Moliner, M. Lázaro, I. Suelves, *Analysis of the strategies for bridging the gap towards the Hydrogen Economy*, *Int. J. Hydrogen Energy*. 41 (2016) 19500–19508.
- [84] K.H.R.- paving the way for a hydrogen-based society, Kawasaki Heavy Industries, Ltd., (2016). <http://global.kawasaki.com/en/stories/hydrogen/> (accessed December 30, 2016).
- [85] Toyota Motor Corporation (TMC), *Toward Sustainable Energy-Based Society That Use Hydrogen*. (2016). <http://www.toyota-global.com/sustainability/environment/challenge2/lca-and-eco-actions/index.html> (accessed December 30, 2016).
- [86] Toshiba Corporation, *Hydrogen Economy Envisioned by Toshiba*. (2016). <https://www.toshiba-newenergy.com/en/> (accessed December 30, 2016).
- [87] A. Maroufmashat, M. Fowler, S.S. Khavas, A. Elkamel, R. Roshandel, A. Hajimiragha, *Mixed integer linear programming based approach for optimal planning and operation of a smart urban energy network to support the hydrogen economy*, *Int. J. Hydrogen Energy*. 41 (2016) 7700–7716.
- [88] O. Edenhofer, R. Pichs-Madruga, Y. Sokona, K. Seyboth, P. Matschoss, S. Kadner, et al., *Annex II: Methodology in IPCC special report on renewable energy sources and climate change mitigation*, 2011.
- [89] S. Wissel, S. Rath-Nagel, M. Blesl, U. Fahl, A. Voß, *Stromerzeugungskosten im Vergleich, Arbeitsbericht Der Universität Stuttgart, Institut Für Energiewirtschaft Und Rationelle Energieanwendung [IER]*. (2008).
- [90] Bureau of Labor Statistics (BLS) - U.S. Department of Labor, *Inflation Calculator*. (2016). [http://www.bls.gov/data/inflation\\_calculator.htm](http://www.bls.gov/data/inflation_calculator.htm) (accessed May 9, 2016).
- [91] K. Blok, E. Nieuwlaar, *Introduction to energy analysis*, Routledge, 2016.
- [92] Eurostat, *Simplified energy balances - annual data*, (2014). [http://ec.europa.eu/eurostat/en/web/products-datasets/-/NRG\\_100A](http://ec.europa.eu/eurostat/en/web/products-datasets/-/NRG_100A) (accessed August 22, 2016).
- [93] FuelsEurope - division of the European Petroleum Refiners Association, *Number of Petrol Stations in Europe End of 2014*. (2015). [https://www.fuelseurope.eu/uploads/Modules/Dataroom/fuelseurope\\_graph\\_2015-50.pdf](https://www.fuelseurope.eu/uploads/Modules/Dataroom/fuelseurope_graph_2015-50.pdf) (accessed August 22, 2016).
- [94] Eurostat, *Number of private households by household composition, number of children and age of youngest child (1 000)*, (2014). [http://ec.europa.eu/eurostat/en/web/products-datasets/-/LFST\\_HHNHTYCH](http://ec.europa.eu/eurostat/en/web/products-datasets/-/LFST_HHNHTYCH) (accessed August 22, 2016).
- [95] T. Chen, *Final Report Hydrogen delivery infrastructure options analysis*, DOE Award Number: DE-FG36-05GO15032. Nexant, U.S. Department of Energy (DOE). (2008). [http://www1.eere.energy.gov/hydrogenandfuelcells/pdfs/delivery\\_infrastructure\\_analysis.pdf](http://www1.eere.energy.gov/hydrogenandfuelcells/pdfs/delivery_infrastructure_analysis.pdf) (accessed October 17, 2016).

- [96] M. Melaina, M. Penev, Hydrogen Station Cost Estimates - Comparing Hydrogen Station Cost Calculator Results with other Recent Estimates, National Renewable Energy Laboratory (NREL). (2013). <http://www.nrel.gov/docs/fy13osti/56412.pdf> (accessed October 17, 2016).
- [97] EY, Cambridge Econometrics Ltd., Arcadia International, European Commission (EC), The Economic Impact of Modern Retail on Choice and Innovation in the EU Food Sector - Final Report. (2014). <http://ec.europa.eu/competition/publications/KD0214955ENN.pdf> (accessed August 22, 2016).
- [98] S. Werner, European space cooling demands, Energy. (2015).
- [99] Enerdata, Odyssee database - Transport, (2013). <http://odyssee.enerdata.net/database/> (accessed August 22, 2016).
- [100] Enerdata, Odyssee database - Services, (2013). <http://odyssee.enerdata.net/database/> (accessed August 22, 2016).
- [101] Enerdata, Odyssee database - Households, (2013). <http://odyssee.enerdata.net/database/> (accessed August 22, 2016).
- [102] Mobiliteit in Cijfers Auto's 2015/2016, Stichting BOVAG-RAI Mobiliteit. (2015). <http://bovagrai.info/auto/2015/media/Mobiliteit-in-Cijfers-Auto-2015-webversie.pdf> (accessed August 22, 2016).
- [103] Eurostat, Stock of vehicles by category and NUTS 2 regions, (2014). [http://ec.europa.eu/eurostat/web/products-datasets/-/tran\\_r\\_vehst](http://ec.europa.eu/eurostat/web/products-datasets/-/tran_r_vehst) (accessed August 22, 2016).
- [104] Eurostat, Population on 1 January, (2014). <http://ec.europa.eu/eurostat/web/products-datasets/-/tps00001> (accessed August 22, 2016).
- [105] Danmarks Statistik, BIL6: New Registrations, Sale of Second Hand Vehicles and Stock Etc by Type of Vehicle and Unit. (2014). <http://www.statbank.dk/BIL6> (accessed August 22, 2016).
- [106] Kraftfahrt-Bundesamt, Verkehr in Kilometern der deutschen Kraftfahrzeuge im Jahr 2014, (2014). [http://www.kba.de/DE/Statistik/Kraftverkehr/VerkehrKilometer/2014/2014\\_vk\\_kurzbericht\\_pdf.pdf?\\_\\_blob=publicationFile&v=1](http://www.kba.de/DE/Statistik/Kraftverkehr/VerkehrKilometer/2014/2014_vk_kurzbericht_pdf.pdf?__blob=publicationFile&v=1) (accessed August 22, 2016).
- [107] Statline - Centraal Bureau voor de Statistiek (CBS), Verkeersprestaties Motorvoertuigen; Kilometers, Voertuigsoort, Grondgebied. (2014). <http://statline.cbs.nl/StatWeb/publication/?VW=T&DM=SLNL&PA=80302NED&LA=NL> (accessed August 22, 2016).
- [108] Danmarks Statistik, VEJ23: Road Traffic of Danish Vehicles on Danish Roads by Means of Transport. (2014). <http://statbank.dk/VEJ23> (accessed August 22, 2016).
- [109] UK Department for Transport, Table VEH0101 Licensed Vehicles by Body Type at the End of Quarter: Great Britain and United Kingdom. (2014). [https://www.gov.uk/government/uploads/system/uploads/attachment\\_data/file/527186/veh0101.ods](https://www.gov.uk/government/uploads/system/uploads/attachment_data/file/527186/veh0101.ods) (accessed August 22, 2016).

- [110] Trafik Analys, Vehicle Statistics - Official Statistics of Sweden. (2014). <http://www.trafa.se/en/road-traffic/vehicle-statistics/> (accessed August 22, 2016).
- [111] M. Kwanten, Kilometers afgelegd door Belgische voertuigen in het jaar 2014, Federale Overheidsdienst Mobiliteit En Vervoer, Directoraat-Generaal Duurzame Mobiliteit En Spoorbeleid. (2015). [http://mobilit.belgium.be/sites/default/files/Kilometers\\_2014\\_NL.pdf](http://mobilit.belgium.be/sites/default/files/Kilometers_2014_NL.pdf) (accessed August 22, 2016).
- [112] I. Sarbu, C. Sebarchievici, General review of ground-source heat pump systems for heating and cooling of buildings, *Energy and Buildings*. 70 (2014) 441–454.
- [113] T. Sivasakthivel, K. Murugesan, H.R. Thomas, Optimization of operating parameters of ground source heat pump system for space heating and cooling by Taguchi method and utility concept, *Appl. Energy*. 116 (2014) 76–85.
- [114] H.W. Jung, H. Kang, W.J. Yoon, Y. Kim, Performance comparison between a single-stage and a cascade multi-functional heat pump for both air heating and hot water supply, *International Journal of Refrigeration*. 36 (2013) 1431–1441.
- [115] A. Girard, E.J. Gago, T. Muneer, G. Caceres, Higher ground source heat pump COP in a residential building through the use of solar thermal collectors, *Renewable Energy*. 80 (2015) 26–39.
- [116] U.S. Department of Energy (DOE), Quadrennial Technology Review - AN ASSESSMENT OF ENERGY TECHNOLOGIES AND RESEARCH OPPORTUNITIES - Chapter 5 Section 5.1. (2015). [http://energy.gov/sites/prod/files/2015/09/f26/Quadrennial-Technology-Review-2015\\_0.pdf](http://energy.gov/sites/prod/files/2015/09/f26/Quadrennial-Technology-Review-2015_0.pdf) (accessed October 17, 2016).
- [117] International Energy Agency (IEA), *Nordic Energy Technology Perspectives 2016: Cities, Flexibility and Pathways to Carbon-Neutrality*. (2016).
- [118] X. Wu, Z. Xing, Z. He, X. Wang, W. Chen, Performance evaluation of a capacity-regulated high temperature heat pump for waste heat recovery in dyeing industry, *Applied Thermal Engineering*. 93 (2016) 1193–1201.
- [119] M.F. Olesen, C. Madsen, L. Olsen, B. Paaske, E.D. Rothuizen, High efficient ammonia heat pump system for industrial process water using the ISEC concept. Part 2, in: 11th IIR Gustav Lorentzen Conference on Natural Refrigerants, 2014.
- [120] E.D. Rothuizen, C. Madsen, B. Elmegaard, M. Olesen, W.B. Markussen, High efficient ammonia heat pump system for industrial process water using the ISEC concept. Part 1, in: 11th IIR Gustav Lorentzen Conference on Natural Refrigerants, 2014.
- [121] S. Fukuda, C. Kondou, N. Takata, S. Koyama, Low GWP refrigerants R1234ze (E) and R1234ze (Z) for high temperature heat pumps, *International Journal of Refrigeration*. 40 (2014) 161–173.
- [122] W.H. Kaiser, M. van Eldik, The potential for CO<sub>2</sub> heat pumps in the South African industrial sector, in: 2015 International Conference on the Industrial and Commercial Use of Energy (ICUE), 2015: pp. 70–75.
- [123] Energistyrelsen - Danish Energy Agency (DEA), *Background Data from Energiscenarier Frem Mod 2020, 2035 Og 2050*. (2014).



- [124] Directorate-General (DG) for Energy, Communication from the Commission to the European Parliament, the Council, the European Economic and Social Committee and the Committee of the Regions on an EU Strategy for Heating and Cooling. European Commission (EC). (2016).  
[https://ec.europa.eu/energy/sites/ener/files/documents/1\\_EN\\_autre\\_document\\_travail\\_service\\_part1\\_v6\\_0.pdf](https://ec.europa.eu/energy/sites/ener/files/documents/1_EN_autre_document_travail_service_part1_v6_0.pdf) (accessed August 23, 2016).
- [125] Commissariat général au développement durable – Service de l’observation et des statistiques, G – Bilan de La Circulation - Les Comptes Des Transports En 2014. (2015).  
[http://www.statistiques.developpement-durable.gouv.fr/fileadmin/documents/Produits\\_editoriaux/Publications/References/2015/comptes-transports-2014/comptes-transports-fiche-11.pdf](http://www.statistiques.developpement-durable.gouv.fr/fileadmin/documents/Produits_editoriaux/Publications/References/2015/comptes-transports-2014/comptes-transports-fiche-11.pdf) (accessed August 22, 2016).
- [126] Statline - Centraal Bureau voor de Statistiek (CBS), Motorvoertuigenpark; Inwoners, Type, Regio, 1 Januari. (2014).  
<http://statline.cbs.nl/Statweb/publication/?VW=T&DM=SLNL&PA=7374hvv&D1=2-11&D2=0&D3=a&HD=160124-1642&HDR=T&STB=G2,G1> (accessed August 22, 2016).
- [127] UK Department for Transport, Table TRA0201 Road Traffic (vehicle Kilometres) by Vehicle Type in Great Britain. (2014).  
[https://www.gov.uk/government/uploads/system/uploads/attachment\\_data/file/523560/tra0201.xls](https://www.gov.uk/government/uploads/system/uploads/attachment_data/file/523560/tra0201.xls) (accessed August 22, 2016).
- [128] UK Department for Transport, Table RFS0115 Average Annual Vehicle Kilometres by Vehicle Type. (2014). <https://www.gov.uk/government/statistical-data-sets/rfs01-goods-lifted-and-distance-hauled> (accessed August 22, 2016).
- [129] Energy Policy Statistical Support Unit - Sustainable Energy Authority of Ireland (SEAI), Energy in Transport 2014 Report. (2014).  
[http://www.seai.ie/Publications/Statistics\\_Publications/Energy\\_in\\_Transport/Energy-in-Transport-2014-report.pdf](http://www.seai.ie/Publications/Statistics_Publications/Energy_in_Transport/Energy-in-Transport-2014-report.pdf) (accessed August 22, 2016).
- [130] International Energy Agency (IEA), Energy Technology Perspectives 2014: Harnessing Electricity’s Potential. (2014).
- [131] Emiss b.v., CM Mission 150e | Elektrische Minibus. (2016).  
<http://www.emoss.biz/nl/elektrische-bus/minibus-cm-mission-150e/> (accessed August 23, 2016).
- [132] Roland Berger - The Fuel Cells and Hydrogen Joint Undertaking (FCH JU), Fuel Cell Electric Buses – Potential for Sustainable Public Transport in Europe. (2015).  
[http://www.fch.europa.eu/sites/default/files/150909\\_FINAL\\_Bus\\_Study\\_Report\\_OUT\\_0.PDF](http://www.fch.europa.eu/sites/default/files/150909_FINAL_Bus_Study_Report_OUT_0.PDF) (accessed August 23, 2016).
- [133] A.K. Sharma, D. Begbie, T. Gardner, Rainwater Tank Systems for Urban Water Supply: Design, Yield, Energy, Health Risks, Economics and Social Perceptions, IWA Publishing, 2015.
- [134] A.K. Sharma, S. Cook, T. Gardner, G. Tjandraatmadja, Rainwater tanks in modern cities: a review of current practices and research, Journal of Water and Climate Change. (2016).
- [135] R. Siems, O. Sahin, Energy intensity of residential rainwater tank systems: exploring the economic and environmental impacts, Journal of Cleaner Production. 113 (2016) 251–262.

- [136] M. Gutschner, S. Nowak, P. Toggweiler, Potential for building integrated photovoltaics, IEA-PVPS Task 7. (2002). [http://netenergy.ch/fileadmin/webmaster/dokumente/projekte/PV\\_Potential\\_IEA\\_PVPS.pdf](http://netenergy.ch/fileadmin/webmaster/dokumente/projekte/PV_Potential_IEA_PVPS.pdf) (accessed October 17, 2016).
- [137] International Energy Agency (IEA), Energy Technology Perspectives 2016: Towards Sustainable Urban Energy Systems, Annex H Rooftop Solar PV Potential in Cities. (2016). [http://www.iea.org/media/etp/etp2016/AnnexHRooftopsolarPVpotential\\_web.pdf](http://www.iea.org/media/etp/etp2016/AnnexHRooftopsolarPVpotential_web.pdf) (accessed October 17, 2016).
- [138] M.A. Green, K. Emery, Y. Hishikawa, W. Warta, E.D. Dunlop, Solar cell efficiency tables (version 47), Progress in Photovoltaics: Research and Applications. 24 (2016).
- [139] Fraunhofer-Institute for Solar Energy Systems (ISE), Current and Future Cost of Photovoltaics; Long-Term Scenarios for Market Development, System Prices and LCOE of Utility Scale Pv-Systems. Agora Energiewende. (2015). [https://www.agora-energiewende.de/fileadmin/Projekte/2014/Kosten-Photovoltaik-2050/AgoraEnergiewende\\_Current\\_and\\_Future\\_Cost\\_of\\_PV\\_Feb2015\\_web.pdf](https://www.agora-energiewende.de/fileadmin/Projekte/2014/Kosten-Photovoltaik-2050/AgoraEnergiewende_Current_and_Future_Cost_of_PV_Feb2015_web.pdf) (accessed October 17, 2016).
- [140] P. Defaix, W. Van Sark, E. Worrell, E. de Visser, Technical potential for photovoltaics on buildings in the EU-27, Solar Energy. 86 (2012) 2644–2653.
- [141] C. Breyer, A. Gerlach, Global overview on grid-parity, Progress in Photovoltaics: Research and Applications. 21 (2013) 121–136.
- [142] N.H. Reich, B. Mueller, A. Armbruster, W.G. Sark, K. Kiefer, C. Reise, Performance ratio revisited: is PR > 90% realistic?, Progress in Photovoltaics: Research and Applications. 20 (2012) 717–726.
- [143] T. Dierauf, A. Growitz, S. Kurtz, J. Cruz, E. Riley, C. Hansen, Weather-Corrected Performance Ratio, National Renewable Energy Laboratory (NREL). (2013). <http://www.nrel.gov/docs/fy13osti/57991.pdf> (accessed October 17, 2017).
- [144] Joint Research Center (JRC), PVGIS Photovoltaic Solar Electricity Potential in European Countries - Yearly Global Irradiation Incident on Optimally-Inclined Photovoltaic Modules Placed in Urban Areas of the EU-27 and 6 Candidate Countries. European Union (EC). (2015). [http://re.jrc.ec.europa.eu/pvgis/cmmaps/eu\\_cmsaf\\_opt/PVGIS-EuropeSolarPotential.pdf](http://re.jrc.ec.europa.eu/pvgis/cmmaps/eu_cmsaf_opt/PVGIS-EuropeSolarPotential.pdf) (accessed August 23, 2016).
- [145] T. Huld, R. Müller, A. Gambardella, A new solar radiation database for estimating PV performance in Europe and Africa, Solar Energy. 86 (2012) 1803–1815.
- [146] M. Sári, T.A. Huld, E.D. Dunlop, H.A. Ossenbrink, Potential of solar electricity generation in the European Union member states and candidate countries, Solar Energy. 81 (2007) 1295–1305.
- [147] L. Bertuccioli, A. Chan, D. Hart, F. Lehner, B. Madden, E. Standen, Development of Water Electrolysis in the European Union. Final Report, Fuel Cells and Hydrogen Joint Undertaking (FCH-JU). (2014). [http://www.fch.europa.eu/sites/default/files/study%20electrolyser\\_0-Logos\\_0.pdf](http://www.fch.europa.eu/sites/default/files/study%20electrolyser_0-Logos_0.pdf) (accessed October 17, 2016).
- [148] Siemens AG, Siemens Silyzer 200 (PEM Electrolysis System). (2015). [https://www.industry.siemens.com/topics/global/en/pem-electrolyzer/silyzer/Documents/silyzer-200-en\\_v1.3\\_InternetVersion.pdf](https://www.industry.siemens.com/topics/global/en/pem-electrolyzer/silyzer/Documents/silyzer-200-en_v1.3_InternetVersion.pdf) (accessed August

23, 2016).

- [149] SAE International, Hydrogen Fuel Quality for Fuel Cell Vehicles - J2719\_201511. (2015). [http://standards.sae.org/j2719\\_201511/](http://standards.sae.org/j2719_201511/) (accessed October 17, 2016).
- [150] Strategic Analysis (SA), National Renewable Energy Laboratory (NREL), PEM Electrolysis H2A Production Case Study Documentation. Fuel Cell Technologies Office (FCTO) - U.S. Department of Energy (DOE) (2013). [https://www.hydrogen.energy.gov/pdfs/h2a\\_pem\\_electrolysis\\_case\\_study\\_documentation.pdf](https://www.hydrogen.energy.gov/pdfs/h2a_pem_electrolysis_case_study_documentation.pdf) (accessed August 23, 2016).
- [151] M. Carmo, D.L. Fritz, J. Mergel, D. Stolten, A comprehensive review on PEM water electrolysis, *Int. J. Hydrogen Energy*. 38 (2013) 4901–4934.
- [152] M. Götz, J. Lefebvre, F. Mörs, A.M. Koch, F. Graf, S. Bajohr, et al., Renewable Power-to-Gas: A technological and economic review, *Renewable Energy*. 85 (2016) 1371–1390.
- [153] C. Noack, F. Burggraf, S.S. Hosseiny, P. Lettenmeier, S. Kolb, S. Belz, et al., Studie über die Planung einer Demonstrationsanlage zur Wasserstoff-Kraftstoffgewinnung durch Elektrolyse mit Zwischenspeicherung in Salzkavernen unter Druck, Deutsches Zentrum Für Luft- Und Raumfahrt e.V. (DLR), Ludwig-Bölkow-Systemtechnik GmbH (LBST), Fraunhofer-Institut Für Solare Energiesysteme ISE, KBB Underground Technologies GmbH. (2015). <http://elib.dlr.de/94979/> (accessed October 17, 2016).
- [154] C. Ainscough, D. Peterson, E. Miller, DOE Hydrogen and Fuel Cells Program Record 14004: Hydrogen Production Cost From PEM Electrolysis, U.S. Department of Energy (DOE). (2014). [https://www.hydrogen.energy.gov/pdfs/14004\\_h2\\_production\\_cost\\_pem\\_electrolysis.pdf](https://www.hydrogen.energy.gov/pdfs/14004_h2_production_cost_pem_electrolysis.pdf) (accessed August 23, 2016).
- [155] National Renewable Energy Laboratory (NREL), H2A Analysis, Production Case Studies: Current Forecourt Hydrogen Production from PEM Electrolysis Version 3.101. (2013). [https://www.hydrogen.energy.gov/h2a\\_prod\\_studies.html](https://www.hydrogen.energy.gov/h2a_prod_studies.html) (accessed August 23, 2016).
- [156] National Renewable Energy Laboratory (NREL), H2A Analysis, Production Case Studies: Future Forecourt Hydrogen Production from PEM Electrolysis Version 3.101. (2013). [https://www.hydrogen.energy.gov/h2a\\_prod\\_studies.html](https://www.hydrogen.energy.gov/h2a_prod_studies.html) (accessed August 23, 2016).
- [157] T. Smolinka, Cost break down and analysis of PEM electrolysis systems for different industrial and Power to Gas applications, World of Energy Solutions, Stuttgart (DE), October 12, 2015. Fraunhofer-Institut für Solare (ISE) (2015). [http://publica.fraunhofer.de/eprints/urn\\_nbn\\_de\\_0011-n-3791585.pdf](http://publica.fraunhofer.de/eprints/urn_nbn_de_0011-n-3791585.pdf) (accessed October 17, 2016).
- [158] M.F. Mathias, R. Makharia, H.A. Gasteiger, J.J. Conley, T.J. Fuller, C.J. Gittleman, et al., Two fuel cell cars in every garage, *Electrochem. Soc. Interface*. 14 (2005) 24–35.
- [159] K. Hirose, M. Hirscher, *Handbook of hydrogen storage: new materials for future energy storage*, John Wiley & Sons, 2010.
- [160] L. Klebanoff, *Hydrogen storage technology: materials and applications*, CRC Press, 2012.
- [161] A. Godula-Jopek, W. Jehle, J. Wellnitz, *Hydrogen storage technologies: new materials, transport, and infrastructure*, John Wiley & Sons, 2012.

- [162] Fuel Cell Technologies Office (FCTO) - U.S. Department of Energy (DOE), Multi-Year Research, Development, and Demonstration (MYRD&D) Plan, Section 3.3 Hydrogen Storage. (2015). [http://energy.gov/sites/prod/files/2015/05/f22/fcto\\_myRDD\\_storage.pdf](http://energy.gov/sites/prod/files/2015/05/f22/fcto_myRDD_storage.pdf) (accessed August 23, 2016).
- [163] D. Durbin, C. Malardier-Jugroot, Review of hydrogen storage techniques for on board vehicle applications, *Int. J. Hydrogen Energy*. 38 (2013) 14595–14617.
- [164] G. Parks, R. Boyd, J. Cornish, R. Remick, Hydrogen Station Compression, Storage, and Dispensing Technical Status and Costs: Systems Integration, National Renewable Energy Laboratory (NREL). (2014). <http://www.nrel.gov/docs/fy14osti/58564.pdf> (accessed October 17, 2016).
- [165] D. Baldwin, Development of High Pressure Hydrogen Storage Tank for Storage and Gaseous Truck Delivery - FY 2015 Annual Progress Report DOE Hydrogen and Fuel Cells Program, Hexagon Lincoln. (2015). [https://www.hydrogen.energy.gov/pdfs/progress15/iii\\_5\\_baldwin\\_2015.pdf](https://www.hydrogen.energy.gov/pdfs/progress15/iii_5_baldwin_2015.pdf) (accessed August 23, 2016).
- [166] D. Baldwin, Development of High Pressure Hydrogen Storage Tank for Storage and Gaseous Truck Delivery - Presentation, Hexagon Lincoln. (2015). [https://www.hydrogen.energy.gov/pdfs/review15/pd021\\_baldwin\\_2015\\_o.pdf](https://www.hydrogen.energy.gov/pdfs/review15/pd021_baldwin_2015_o.pdf) (accessed August 23, 2016).
- [167] Z. Feng, Y. Wang, Y.C. Lim, Steel Concrete Composite Vessel for 875 Bar Stationary Hydrogen Storage - DOE Hydrogen and Fuel Cells Program FY 2015 Annual Progress Report, Oak Ridge National Laboratory (ORNL). (2015). [https://www.hydrogen.energy.gov/pdfs/progress15/iii\\_8\\_feng\\_2015.pdf](https://www.hydrogen.energy.gov/pdfs/progress15/iii_8_feng_2015.pdf) (accessed August 23, 2016).
- [168] Z. Feng, Y. Wang, Y.C. Lim, J. Chen, L. Anovitz, Vessel Design and Fabrication Technology for Stationary High- Pressure Hydrogen Storage - FY 2015 Annual Progress Report DOE Hydrogen and Fuel Cells Program, Oak Ridge National Laboratory (ORNL). (2015). [https://www.hydrogen.energy.gov/pdfs/review15/pd088\\_feng\\_2015\\_o.pdf](https://www.hydrogen.energy.gov/pdfs/review15/pd088_feng_2015_o.pdf) (accessed August 23, 2015).
- [169] W. Zhang, F. Ren, Z. Feng, J. Wang, Manufacturing Cost Analysis of Novel Steel/Concrete Composite Vessel for Stationary Storage of High-Pressure Hydrogen, Oak Ridge National Laboratory (ORNL). (2012). <http://info.ornl.gov/sites/publications/files/pub41882.pdf> (accessed October 17, 2016).
- [170] D. Teichmann, W. Arlt, P. Wasserscheid, Liquid organic hydrogen carriers as an efficient vector for the transport and storage of renewable energy, *Int. J. Hydrogen Energy*. 37 (2012) 18118–18132.
- [171] D. Baldwin, BULK HAULING EQUIPMENT FOR CHG, Hexagon Lincoln. (2013). <http://energy.gov/eere/fuelcells/downloads/bulk-hauling-equipment-chg> (accessed October 17, 2016).
- [172] K. Reddi, A. Elgowainy, E. Sutherland, Hydrogen refueling station compression and storage optimization with tube-trailer deliveries, *Int. J. Hydrogen Energy*. 39 (2014) 19169–19181.
- [173] A. Elgowainy, R. Krishna, M. Mintz, D. Brown, H2A delivery scenario analysis model version 3.0\* (HDSAM 3.0) user's manual, Argonne National Laboratory, Pacific Northwest National Laboratory. (2015). [https://www.hydrogen.energy.gov/h2a\\_delivery.html](https://www.hydrogen.energy.gov/h2a_delivery.html) (accessed October

17, 2016).

- [174] M. Ringer, H2A Delivery Components Model Version 1.1: Users Guide, National Renewable Energy Laboratory (NREL). (2006).  
[https://www.hydrogen.energy.gov/pdfs/h2a\\_delivery\\_doc.pdf](https://www.hydrogen.energy.gov/pdfs/h2a_delivery_doc.pdf) (accessed December 17, 2016).
- [175] J. Pratt, D. Terlip, C. Ainscough, J. Kurtz, A. Elgowainy, H2FIRST Reference Station Design Task Project Deliverable 2-2, Sandia National Laboratories (SNL), National Renewable Energy Laboratory (NREL), Argonne National Laboratory (ANL). (2015).  
<http://www.nrel.gov/docs/fy15osti/64107.pdf> (accessed October 17, 2016).
- [176] Fuel Cell Technologies Office (FCTO) - U.S. Department of Energy (DOE), Multi-Year Research, Development, and Demonstration (MYRD&D) Plan, Section 3.2 Hydrogen Delivery. (2015). [http://energy.gov/sites/prod/files/2015/08/f25/fcto\\_myRDD\\_delivery.pdf](http://energy.gov/sites/prod/files/2015/08/f25/fcto_myRDD_delivery.pdf) (accessed August 23, 2016).
- [177] T. Hua, R. Ahluwalia, J. Peng, M. Kromer, S. Lasher, K. McKenney, et al., Technical assessment of compressed hydrogen storage tank systems for automotive applications, Argonne National Laboratory (ANL), TIAX LLC. (2010).  
[https://www1.eere.energy.gov/hydrogenandfuelcells/pdfs/compressedtank\\_storage.pdf](https://www1.eere.energy.gov/hydrogenandfuelcells/pdfs/compressedtank_storage.pdf) (accessed October 17, 2016).
- [178] A. Elgowainy, K. Reddi, Hydrogen Fueling Station Pre-Cooling Analysis, Argonne National Laboratory (ANL). (2016).  
[https://www.hydrogen.energy.gov/pdfs/review16/pd107\\_elgowainy\\_2016\\_o.pdf](https://www.hydrogen.energy.gov/pdfs/review16/pd107_elgowainy_2016_o.pdf) (accessed August 23, 2016).
- [179] S. Sprik, J. Kurtz, C. Ainscough, G. Saur, M. Peters, Hydrogen Station Data Collection and Analysis, (2015). [https://www.hydrogen.energy.gov/pdfs/review15/tv017\\_sprik\\_2015\\_o.pdf](https://www.hydrogen.energy.gov/pdfs/review15/tv017_sprik_2015_o.pdf) (accessed October 17, 2016).
- [180] X. Luo, J. Wang, M. Dooner, J. Clarke, Overview of current development in electrical energy storage technologies and the application potential in power system operation, Appl. Energy. 137 (2015) 511–536.
- [181] Y. Rebours, D. Kirschen, What is spinning reserve, The University of Manchester. (2005).  
[http://www2.ee.washington.edu/research/real/Library/Reports/What\\_is\\_spinning\\_reserve.pdf](http://www2.ee.washington.edu/research/real/Library/Reports/What_is_spinning_reserve.pdf) (accessed October 17, 2016).
- [182] J. Kurtz, S. Sprik, C. Ainscough, G. Saur, M. Jeffers, National Renewable Energy Laboratory (NREL), Fuel Cell Electric Vehicle Evaluation. Advanced Automotive Battery Conference, June 17, Detroit, MI (2016). <http://www.nrel.gov/docs/fy16osti/66760.pdf> (accessed August 23, 2016).
- [183] G. Tsotridis, A. Pilenga, G.D. Marco, T. Malkow, EU Harmonised Test Protocols for PEMFC-MEA Testing in Single Cell Configuration for Automotive Applications, Joint Research Centre (JRC) . European Commission (EC) (2015).  
<http://publications.jrc.ec.europa.eu/repository/bitstream/JRC99115/Idna27632enn.pdf> (accessed October 17, 2016).
- [184] M. Tutuianu, P. Bonnel, B. Ciuffo, T. Haniu, N. Ichikawa, A. Marotta, et al., Development of the World-wide harmonized Light duty Test Cycle (WLTC) and a possible pathway for its introduction in the European legislation, Transportation Research Part D: Transport and Environment. 40 (2015) 61–75.

- [185] B. De Jager, T. Van Keulen, J. Kessels, *Optimal control of hybrid vehicles*, Springer, 2013.
- [186] R. Tuominen, J. Ihonen, HyCoRA – Hydrogen Contaminant Risk Assessment Grant agreement no: 621223 Deliverable 4.2 Guidance for the second part of WP1 and WP2 work, VTT Technical Research Centre of Finland. (2015).  
<http://hycora.eu/deliverables/D%204.2%20Guidance%20for%20the%20second%20part%20of%20WP1%20and%20WP2%20work.pdf> (accessed August 23, 2016).
- [187] M. Jouin, M. Bressel, S. Morando, R. Gouriveau, D. Hissel, M.-C. Péra, et al., Estimating the end-of-life of PEM fuel cells: Guidelines and metrics, *Appl. Energy*. 177 (2016) 87–97.
- [188] International Energy Agency (IEA), *Technology Roadmap: Solar Photovoltaic Energy*. (2014).
- [189] R. Borup, J. Meyers, B. Pivovar, Y.S. Kim, R. Mukundan, N. Garland, et al., Scientific aspects of polymer electrolyte fuel cell durability and degradation, *Chemical Reviews*. 107 (2007) 3904–3951.
- [190] P. Pei, H. Chen, Main factors affecting the lifetime of Proton Exchange Membrane fuel cells in vehicle applications: A review, *Appl. Energy*. 125 (2014) 60–75.
- [191] F. De Bruijn, V. Dam, G. Janssen, Review: durability and degradation issues of PEM fuel cell components, *Fuel Cells*. 8 (2008) 3–22.
- [192] N. Yousfi-Steiner, P. Moçotéguy, D. Candusso, D. Hissel, A review on polymer electrolyte membrane fuel cell catalyst degradation and starvation issues: Causes, consequences and diagnostic for mitigation, *J. Power Sources*. 194 (2009) 130–145.
- [193] Y. Yu, H. Li, H. Wang, X.-Z. Yuan, G. Wang, M. Pan, A review on performance degradation of proton exchange membrane fuel cells during startup and shutdown processes: Causes, consequences, and mitigation strategies, *J. Power Sources*. 205 (2012) 10–23.
- [194] L. Dubau, L. Castanheira, F. Maillard, M. Chatenet, O. Lottin, G. Maranzana, et al., A review of PEM fuel cell durability: materials degradation, local heterogeneities of aging and possible mitigation strategies, *Wiley Interdisciplinary Reviews: Energy and Environment*. 3 (2014) 540–560.
- [195] A.S. Vieira, C.D. Beal, E. Ghisi, R.A. Stewart, Energy intensity of rainwater harvesting systems: A review, *Renewable and Sustainable Energy Reviews*. 34 (2014) 225–242.
- [196] R. Farreny, T. Morales-Pinzón, A. Guisasola, C. Taya, J. Rieradevall, X. Gabarrell, Roof selection for rainwater harvesting: quantity and quality assessments in Spain, *Water Research*. 45 (2011) 3245–3254.
- [197] Eurostat, Area by NUTS 3 region, (2014). [http://ec.europa.eu/eurostat/en/web/products-datasets/-/DEMO\\_R\\_D3AREA](http://ec.europa.eu/eurostat/en/web/products-datasets/-/DEMO_R_D3AREA) (accessed August 23, 2014).
- [198] Eurostat, Renewable freshwater resources, (2014).  
[http://ec.europa.eu/eurostat/en/web/products-datasets/-/ENV\\_WAT\\_RES](http://ec.europa.eu/eurostat/en/web/products-datasets/-/ENV_WAT_RES) (accessed August 23, 2016).
- [199] T.R. Gurung, S. Umapathi, A.K. Sharma, *Economics of Scale Snalysis of Communal Rainwater Tanks*, 2012. <http://www.urbanwateralliance.org.au/publications/UWSRA-tr67.pdf> (accessed August 23, 2016).

- [200] F. Barbir, PEM electrolysis for production of hydrogen from renewable energy sources, *Solar Energy*. 78 (2005) 661–669.
- [201] K.H. Mistry, J.H. Lienhard, An economics-based second law efficiency, *Entropy*. 15 (2013) 2736–2765.
- [202] Dow Water & Process Solutions, Reverse Osmosis System Analysis (ROSA) for FILMTEC™ Membranes, ROSA 9.0.0, ConfigDB u399339\_282. (2015). <http://www.dow.com/en-us/water-and-process-solutions/resources/design-software/rosa-software> (accessed August 23, 2016).
- [203] A. Perez-Gonzalez, A.M. Urriaga, R. Ibanez, I. Ortiz, State of the art and review on the treatment technologies of water reverse osmosis concentrates, *Water Res.* 46 (2012) 267–283.
- [204] M. Elimelech, W.A. Phillip, The future of seawater desalination: energy, technology, and the environment, *Science* (80-. ). 333 (2011) 712–717.
- [205] J. Chapman, E. Lantz, P. Denholm, F. Felker, G. Heath, T. Mai, et al., Wind Energy Technologies, Chapter 11. Renewable Electricity Futures Study, Vol. 2, National Renewable Energy Laboratory (NREL). (2012). <http://www.nrel.gov/docs/fy12osti/52409-2.pdf> (accessed August 23, 2016).
- [206] International Renewable Energy Agency (IRENA), Renewable Power Generation Costs in 2014. (2015). [https://www.irena.org/DocumentDownloads/Publications/IRENA\\_RE\\_Power\\_Costs\\_2014\\_report.pdf](https://www.irena.org/DocumentDownloads/Publications/IRENA_RE_Power_Costs_2014_report.pdf) (accessed October 17, 2016).
- [207] International Renewable Energy Agency (IRENA), Renewable Energy Cost Analysis - Wind Power. (2012). [https://www.irena.org/documentdownloads/publications/re\\_technologies\\_cost\\_analysis-wind\\_power.pdf](https://www.irena.org/documentdownloads/publications/re_technologies_cost_analysis-wind_power.pdf) (accessed August 23, 2016).
- [208] International Energy Agency (IEA), Energy Technology Perspectives 2012: Pathways to a Clean Energy System. (2012).
- [209] F. Sensfuß, B. Pfluger, G. Schubert, J. Leisentritt, „Tangible ways towards climate protection in the European Union (EU Long-term scenarios 2050)“, Fraunhofer Institute for Systems and Innovation Research ISI. (2011). [http://www.isi.fraunhofer.de/isi-wAssets/docs/e/de/publikationen/Final\\_Report\\_EU-Long-term-scenarios-2050\\_FINAL.pdf](http://www.isi.fraunhofer.de/isi-wAssets/docs/e/de/publikationen/Final_Report_EU-Long-term-scenarios-2050_FINAL.pdf) (accessed August 23, 2016).
- [210] F. Sensfuß, B. Pfluger, Final report Optimized pathways towards ambitious climate protection in the European electricity system (EU Long-term scenarios 2050 II), Fraunhofer Institute for Systems and Innovation Research ISI. (2014). <http://www.isi.fraunhofer.de/isi-wAssets/docs/x/en/projects/Optimized-pathways-final.pdf> (accessed August 23, 2016).
- [211] C. Kost, J.N. Mayer, J. Thomsen, N. Hartmann, C. Senkpiel, S. Philipps, et al., Levelized cost of electricity renewable energy technologies, Fraunhofer Institute for Solar Energy Systems ISE. (2013). <https://www.ise.fraunhofer.de/en/publications/veroeffentlichungen-pdf-dateien-en/studien-und-konzeptpapiere/study-levelized-cost-of-electricity-renewable-energies.pdf> (accessed October 17, 2016).
- [212] S. Barret, GM marks 50 years of FCEV development, from Electrovan to Chevrolet Colorado ZH2, *Fuel Cells Bulletin*. 11 (2016) 14–15.

- [213] General Motors Company, Mission-Ready Chevrolet Colorado ZH2 Fuel Cell Vehicle Breaks Cover at U.S. Army Show. (2016). <http://media.gm.com/media/us/en/gm/news.detail.html/content/Pages/news/us/en/2016/oct/1003-zh2.html> (accessed December 30, 2016).
- [214] Hyundai ix35 Fuel Cell, (n.d.). <http://worldwide.hyundai.com/WW/Showroom/Eco/ix35-Fuel-Cell/PIP/index.html>.
- [215] G. Pasaoglu, D. Fiorello, A. Martino, G. Scarcella, A. Alemanno, A. Zubaryeva, et al., Driving and parking patterns of European car drivers-a mobility survey, Joint Research Centre (JRC) - European Commission (EC). (2012). [https://setis.ec.europa.eu/system/files/Driving\\_and\\_parking\\_patterns\\_of\\_European\\_car\\_drivers-a\\_mobility\\_survey.pdf](https://setis.ec.europa.eu/system/files/Driving_and_parking_patterns_of_European_car_drivers-a_mobility_survey.pdf) (accessed October 16, 2016).
- [216] P. Siano, Demand response and smart grids—A survey, *Renewable and Sustainable Energy Reviews*. 30 (2014) 461–478.
- [217] R.S. Ruback, Capital cash flows: a simple approach to valuing risky cash flows, *Financial Management*. (2002) 85–103.
- [218] J. Ondraczek, N. Komendantova, A. Patt, WACC the dog: The effect of financing costs on the levelized cost of solar PV power, *Renewable Energy*. 75 (2015) 888–898.
- [219] K. Schoots, F. Ferioli, G. Kramer, B. Van der Zwaan, Learning curves for hydrogen production technology: an assessment of observed cost reductions, *Int. J. Hydrogen Energy*. 33 (2008) 2630–2645.
- [220] W. McDowall, Endogenous technology learning for hydrogen and fuel cell technology in UKSHEC II: Literature review, research questions and data, 2012.
- [221] B. Sørensen, Fuel cells: Optimism gone-Hard work still there, *Int. J. Hydrogen Energy*. 38 (2013) 7578–7582.
- [222] J. Larminie, A. Dicks, M.S. McDonald, Fuel cell systems explained, J. Wiley Chichester, UK, 2003.
- [223] F. Barbir, PEM fuel cells: theory and practice, Academic Press, 2013.
- [224] M. Weiss, H.M. Junginger, M.K. Patel, others, Learning energy efficiency: experience curves for household appliances and space heating, cooling, and lighting technologies, (2008).
- [225] European Parking Association (EPA), Data Collection – The Scope of Parking in Europe. (2013). [http://www.europeanparking.eu/media/1180/epa\\_data\\_collection\\_rev.pdf](http://www.europeanparking.eu/media/1180/epa_data_collection_rev.pdf) (accessed October 16, 2016).
- [226] J. Firnkorn, M. Müller, Free-floating electric carsharing-fleets in smart cities: The dawning of a post-private car era in urban environments?, *Environ. Sci. Policy*. 45 (2015) 30–40.
- [227] M. Pavone, Autonomous mobility-on-demand systems for future urban mobility, in: *Autonomous Driving*, Springer, 2016: pp. 387–404.
- [228] L.D. Burns, Sustainable mobility: a vision of our transport future, *Nature*. 497 (2013) 181–182.



- [229] M. Fuller, Wireless charging in California: Range, recharge, and vehicle electrification, *Transportation Research Part C: Emerging Technologies*. 67 (2016) 343–356.
- [230] R. Niemi, J. Mikkola, P. Lund, Urban energy systems with smart multi-carrier energy networks and renewable energy generation, *Renewable Energy*. 48 (2012) 524–536.
- [231] S.D. Ebbesen, S.H. Jensen, A. Hauch, M.B. Mogensen, High Temperature Electrolysis in Alkaline Cells, Solid Proton Conducting Cells, and Solid Oxide Cells, *Chemical Reviews*. 114 (2014) 10697–10734.
- [232] C.C. Pavel, F. Cecconi, C. Emiliani, S. Santiccioli, A. Scaffidi, S. Catanorchi, et al., Highly Efficient Platinum Group Metal Free Based Membrane-Electrode Assembly for Anion Exchange Membrane Water Electrolysis, *Angewandte Chemie*. 126 (2014) 1402–1405.
- [233] M. Manolova, C. Schoeberl, R. Freudenberger, C. Ellwein, J. Kerres, S. Stypka, et al., Development and testing of an anion exchange membrane electrolyser, *Int. J. Hydrogen Energy*. 40 (2015) 11362–11369.
- [234] Y. Leng, G. Chen, A.J. Mendoza, T.B. Tighe, M.A. Hickner, C.-Y. Wang, Solid-state water electrolysis with an alkaline membrane, *Journal of the American Chemical Society*. 134 (2012) 9054–9057.
- [235] K.S. Joya, H.J.M. de Groot, Artificial leaf goes simpler and more efficient for solar fuel generation, *ChemSusChem*. 7 (2014) 73–6.
- [236] Y.-R. He, F.-F. Yan, H.-Q. Yu, S.-J. Yuan, Z.-H. Tong, G.-P. Sheng, Hydrogen production in a light-driven photoelectrochemical cell, *Appl. Energy*. 113 (2014) 164–168.
- [237] M.M. May, H.-J. Lewerenz, D. Lackner, F. Dimroth, T. Hannappel, Efficient direct solar-to-hydrogen conversion by in situ interface transformation of a tandem structure, *Nature Communications*. 6 (2015).
- [238] E. Verlage, S. Hu, R. Liu, R.J. Jones, K. Sun, C. Xiang, et al., A monolithically integrated, intrinsically safe, 10% efficient, solar-driven water-splitting system based on active, stable earth-abundant electrocatalysts in conjunction with tandem III-V light absorbers protected by amorphous TiO<sub>2</sub> films, *Energy & Environmental Science*. 8 (2015) 3166–3172.
- [239] P. Kalisman, Y. Nakibli, L. Amirav, Perfect Photon-to-Hydrogen Conversion Efficiency, *Nano Letters*. 16 (2016) 1776–1781.
- [240] B.A. Pinaud, J.D. Benck, L.C. Seitz, A.J. Forman, Z. Chen, T.G. Deutsch, et al., Technical and economic feasibility of centralized facilities for solar hydrogen production via photocatalysis and photoelectrochemistry, *Energy & Environmental Science*. 6 (2013) 1983–2002.
- [241] S. Metz, Linde pioneers hydrogen compression techniques for fuel cell electric vehicles, *Fuel Cells Bulletin*. 2014 (2014) 12–15.
- [242] P. Bouwman, *Fundamentals of Electrochemical Hydrogen Compression, PEM Electrolysis for Hydrogen Production: Principles and Applications*. (2016) 269.
- [243] P. Bouwman, J. Konink, D. Semerel, L. Raymakers, M. Koeman, W. Kout, et al., (Invited) Electrochemical Hydrogen Compression, *ECS Transactions*. 64 (2014) 1009–1018.

- [244] D. Teichmann, K. Stark, K. Müller, G. Zöttl, P. Wasserscheid, W. Arlt, Energy storage in residential and commercial buildings via Liquid Organic Hydrogen Carriers (LOHC), *Energy & Environmental Science*. 5 (2012) 9044–9054.
- [245] D. Teichmann, W. Arlt, P. Wasserscheid, R. Freymann, A future energy supply based on Liquid Organic Hydrogen Carriers (LOHC), *Energy & Environmental Science*. 4 (2011) 2767–2773.
- [246] M. Markiewicz, Y. Zhang, A. Bösmann, N. Brückner, J. Thöming, P. Wasserscheid, et al., Environmental and health impact assessment of Liquid Organic Hydrogen Carrier (LOHC) systems-challenges and preliminary results, *Energy & Environmental Science*. 8 (2015) 1035–1045.
- [247] D. Geburtig, P. Preuster, A. Bösmann, K. Müller, P. Wasserscheid, Chemical utilization of hydrogen from fluctuating energy sources-Catalytic transfer hydrogenation from charged Liquid Organic Hydrogen Carrier systems, *Int. J. Hydrogen Energy*. 41 (2016) 1010–1017.
- [248] H. Ito, N. Miyazaki, M. Ishida, A. Nakano, Efficiency of unitized reversible fuel cell systems, *Int. J. Hydrogen Energy*. 41 (2016) 5803–5815.
- [249] X. Lu, J. Xuan, D.Y. Leung, H. Zou, J. Li, H. Wang, et al., A switchable pH-differential unitized regenerative fuel cell with high performance, *J. Power Sources*. 314 (2016) 76–84.
- [250] Y. Wang, D.Y. Leung, J. Xuan, H. Wang, A review on unitized regenerative fuel cell technologies, part-A: Unitized regenerative proton exchange membrane fuel cells, *Renewable and Sustainable Energy Reviews*. 65 (2016) 961–977.
- [251] M. Gabbasa, K. Sopian, A. Fudholi, N. Asim, A review of unitized regenerative fuel cell stack: Material, design and research achievements, *Int. J. Hydrogen Energy*. 39 (2014) 17765–17778.
- [252] R. Wisser, K. Jenni, J. Seel, E. Baker, M. Hand, E. Lantz, et al., Expert elicitation survey on future wind energy costs, *Nature Energy*. 1 (2016) 16135.
- [253] M.Z. Jacobson, M.A. Delucchi, M.A. Cameron, B.A. Frew, Low-cost solution to the grid reliability problem with 100% penetration of intermittent wind, water, and solar for all purposes, *Proceedings of the National Academy of Sciences*. 112 (2015) 15060–15065.
- [254] International Energy Agency (IEA), *Energy and Air Pollution World Energy Outlook Special Report*. (2016). <http://www.iea.org/publications/freepublications/publication/WorldEnergyOutlookSpecialReport2016EnergyandAirPollution.pdf> (accessed October 17, 2016).
- [255] D. Jones, J. Huscher, L. Myllyvirta, R.F.J. Gierens, K. Gutmann, D. Urbaniak, et al., *Europe's Dark Cloud: How coal-burning countries are making their neighbours sick*, Sandbag, Health and Environment Alliance (HEAL), Greenpeace, Climate Action Network (CAN) Europe, WWF European Policy Office, European Climate Foundation (ECF). (2016). [http://env-health.org/IMG/pdf/dark\\_cloud-full\\_report\\_final.pdf](http://env-health.org/IMG/pdf/dark_cloud-full_report_final.pdf) (accessed October 17, 2016).
- [256] J.W. Eising, T. van Onna, F. Alkemade, Towards smart grids: Identifying the risks that arise from the integration of energy and transport supply chains, *Appl. Energy*. 123 (2014) 448–455.

- [257] J. Hu, S. You, M. Lind, J. Ostergaard, Coordinated charging of electric vehicles for congestion prevention in the distribution grid, *IEEE Trans. Smart Grid.* 5 (2014) 703–711.
- [258] D.B. Richardson, Electric vehicles and the electric grid: A review of modeling approaches, Impacts, and renewable energy integration, *Renewable and Sustainable Energy Reviews.* 19 (2013) 247–254.
- [259] S. You, H. Segerberg, Integration of 100% micro-distributed energy resources in the low voltage distribution network: A Danish case study, *Applied Thermal Engineering.* 71 (2014) 797–808.
- [260] U.S. Energy Information Administration (EIA), Levelized Cost and Levelized Avoided Cost of New Generation Resources in the Annual Energy Outlook 2016. (2016). [http://www.eia.gov/forecasts/aeo/pdf/electricity\\_generation.pdf](http://www.eia.gov/forecasts/aeo/pdf/electricity_generation.pdf) (accessed October 17, 2016).
- [261] U.S. Energy Information Administration (EIA), Assessing the Economic Value of New Utility-Scale Renewable Generation Projects Using Levelized Cost of Electricity and Levelized Avoided Cost of Electricity. (2016). <http://www.eia.gov/renewable/workshop/gencosts/> (accessed October 17, 2016).