

## Effects of COVID-19 measures on ventilation in secondary schools in the Netherlands

Ding, Er; Zhang, D.; Garcia Sanchez, C.; Bluysen, P.M.

**Publication date**

2023

**Document Version**

Final published version

**Citation (APA)**

Ding, E., Zhang, D., Garcia Sanchez, C., & Bluysen, P. M. (2023). *Effects of COVID-19 measures on ventilation in secondary schools in the Netherlands*. 1-3. Abstract from 18th Healthy Buildings Europe Conference 2023, Aachen, Germany.

**Important note**

To cite this publication, please use the final published version (if applicable).  
Please check the document version above.

**Copyright**

Other than for strictly personal use, it is not permitted to download, forward or distribute the text or part of it, without the consent of the author(s) and/or copyright holder(s), unless the work is under an open content license such as Creative Commons.

**Takedown policy**

Please contact us and provide details if you believe this document breaches copyrights.  
We will remove access to the work immediately and investigate your claim.

## Effects of COVID-19 measures on ventilation in secondary schools in the Netherlands

Er Ding <sup>a</sup>, Dadi Zhang <sup>a</sup>, Clara García-Sánchez <sup>b</sup>, Philomena M. Bluysen <sup>a</sup>.

<sup>a</sup> Chair Indoor Environment, Faculty of Architecture and the Built Environment, Delft University of Technology, Delft, The Netherlands, [E.Ding@tudelft.nl](mailto:E.Ding@tudelft.nl)

<sup>b</sup> 3D Geoinformation Research Group, Faculty of Architecture and the Built Environment, Delft University of Technology, Delft, The Netherlands

**Background.** During the COVID-19 pandemic, the importance of ventilation for ensuring occupants' health was widely stressed, especially for densely occupied places such as schools (Ding *et al*, 2022). Correspondingly, new protocols of ventilation were implemented in school buildings among many countries and regions. In the Netherlands, school classrooms were first required to keep the windows and doors open, and later after a national lockdown more stringent measures such as reducing student occupancy were introduced. Previous studies have already shown that the ventilation in a large portion of school classrooms did not meet the requirement (National Ventilation Coordination Team, 2020). However, what are the actual effects of the COVID-19 measures on ventilation in school classrooms remains unclear.

**Aims.** This study aims to investigate 1) the ventilation sufficiency, and 2) the ventilation-related effects of temporary pandemic control and prevention measures in school classrooms under the COVID-19 pandemic.

**Methods.** A field study was conducted among 31 classrooms of 11 Dutch secondary schools. Fifteen (48%) of the 31 classrooms only use natural ventilation, three (10%) have mechanical air supply, three (10%) have mechanical air exhaust, and 10 (32%) have both mechanical air supply and exhaust. All the classrooms have openable windows, most of which are top-hung or side-hung windows, and can be opened to an angle of 30°-45°. During the time when this survey was conducted, windows and doors were often kept opened during the occupied lessons. Therefore, natural ventilation should also be considered present inside the classrooms that have mechanical ventilation.

All the schools were visited before and after a national lockdown (December 2020-February 2021), i.e. during both October-December 2020 (pre-lockdown) and March-June 2021 (post-lockdown). Each visit lasted for one school day, during which the indoor and outdoor CO<sub>2</sub> concentration were continuously monitored, namely inside the classrooms (at the center of both the front and back walls) and at the entrance/courtyard of the schools, using HOB0® CO<sub>2</sub> loggers (model: MX1102A). Occupied teaching hours and numbers of student occupants were recorded for each classroom.

The ventilation rate per person (VR<sub>p</sub>, l/s/p) in the classrooms was calculated accordingly based on the steady-state method (Zhang *et al*, 2022). VR<sub>p</sub> was then assessed according to the Dutch Fresh School guidelines (Netherlands Enterprise Agency, 2021) and Dutch Building Decree (Ministry of the Interior and Kingdom Relations, 2012). The difference in VR<sub>p</sub> between pre- and post- lockdown periods was examined through Wilcoxon signed-rank tests. Generalized estimating equations (GEE) analysis with linear function was used to identify the association between VR<sub>p</sub> and student occupancy, number of opened windows, number of opened doors, and pre- and post-lockdown visits (Ding *et al*, 2023).

**Results.** The results of VR<sub>p</sub> are presented in **Figure 1**. Before lockdown, the average occupancy in the classrooms was 17 students. VR<sub>p</sub> ranged from 4.6 to 241.5 l/s/p, with an average of 21.8 l/s/p. In 13%, 45%, and 65% of the classrooms, VR<sub>p</sub> did not meet the *acceptable* (6 l/s/p), *good*


(8.5 l/s/p), and *very good* (12 l/s/p) level of the Dutch Fresh School guidelines, respectively. Besides,  $VR_p$  in 45% of the classrooms did not fulfill the requirement of the Dutch Building Decree (8.5 l/s/p). After lockdown, the average occupancy in the classrooms decreased to 10 students.  $VR_p$  ranged from 7.4 l/s/p to 155.8 l/s/p, with an average of 32.5 l/s/p.  $VR_p$  in all classrooms exceeded the *acceptable* level of the Dutch Fresh School guidelines, yet was still lower than the *good* and *very good* level in 6% and 13% of the classrooms, respectively. Also,  $VR_p$  in 6% of the classrooms did not fulfill the requirement of the Dutch Building Decree. For the Wilcoxon signed-rank tests,  $VR_p$  was significantly higher after lockdown than before lockdown ( $P = 0.005$ ). For the GEE analysis,  $VR_p$  only had a significant association with the student occupancy in the classrooms ( $P < 0.001$ ), with an estimated exponentiated  $\beta$  of 0.938 (95% CI: 0.915-0.963).

**Conclusions.** According to the Dutch Fresh School guidelines and Dutch Building Decree, before lockdown when the classrooms were used under normal occupancy, the ventilation rate per person in many classrooms was unsatisfying (some even unacceptable), even with windows and doors kept open. After lockdown, the ventilation rate per person increased significantly, yet it was mainly due to the reduction in student occupancy, rather than any changes in the operation of windows and doors. While opening windows and doors cannot achieve the required ventilation at all times, reducing occupancy might not be a feasible solution in the short term. Hence, more controllable and flexible ways for improving ventilation in school classrooms are needed.

**Keywords.** Classroom, ventilation, indoor air quality, children, COVID-19 pandemic.

**Figure 1**

Ventilation rate per person in the classrooms before and after lockdown.

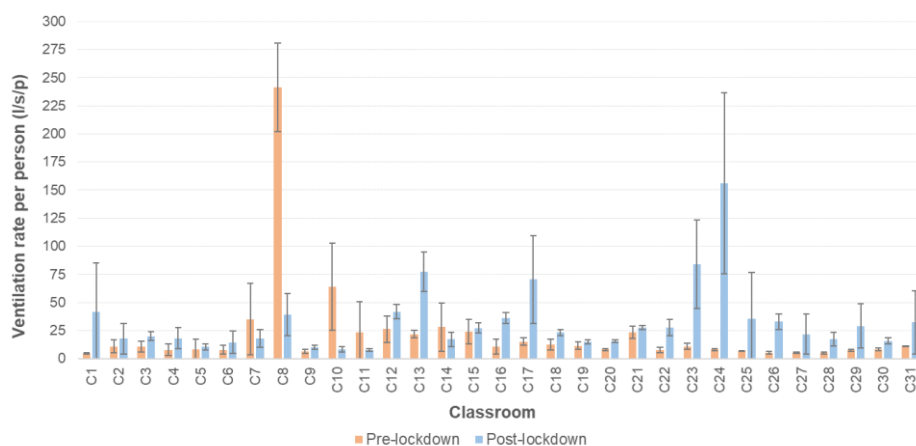

## References

Ding, E., Zhang, D., & Bluysen, P.M. (2022). Ventilation regimes of school classrooms against airborne transmission of infectious respiratory droplets: A review. *Building and Environment*, 207, 108484. <https://doi.org/10.1016/j.buildenv.2021.108484>

Ding, E., Zhang, D., Hamida, A., García-Sánchez, C., Jonker, L., de Boer, A.R., Bruijning, P.C.J.L., Linde, K.J., Wouters, I.M., & Bluysen, P.M. (2023). Ventilation and thermal conditions in secondary schools in the Netherlands: Effects of COVID-19 pandemic control and prevention measures. *Building and Environment*, 109922. <https://doi.org/10.1016/j.buildenv.2022.109922>

Ministry of the Interior and Kingdom Relations (2012). *Building Decree 2012: Decree on buildings and*

*living environment.* <https://www.onlinebouwbesluit.nl/>

National Ventilation Coordination Team (2020). *Final report – Picture of ventilation in schools in the basic education in the Netherlands.* (in Dutch). Netherlands National Government.

<https://www.rijksoverheid.nl/documenten/rapporten/2020/10/01/eindrapport-landelijk-coordinatieteam-ventilatie-op-scholen>

Netherlands Enterprise Agency (2021). *Program of requirements – Fresh schools.*

<https://www.rvo.nl/sites/default/files/2021/06/PvE-Frisse-Scholen-2021.pdf>

Zhang, D., Ding, E., & Bluysen, P. M. (2022). Guidance to assess ventilation performance of a classroom based on CO<sub>2</sub> monitoring. *Indoor and Built Environment*, 31(4), 1107-1126.

<https://doi.org/10.1177/1420326X211058743>