

Sustainability characteristics of drinking water supply in the Netherlands

Van Engelenburg, Jolijn; Van Slobbe, Erik; Teuling, Adriaan J.; Uijlenhoet, Remko; Hellegers, Petra

DOI

[10.5194/dwes-14-1-2021](https://doi.org/10.5194/dwes-14-1-2021)

Publication date

2021

Document Version

Final published version

Published in

Drinking Water Engineering and Science

Citation (APA)

Van Engelenburg, J., Van Slobbe, E., Teuling, A. J., Uijlenhoet, R., & Hellegers, P. (2021). Sustainability characteristics of drinking water supply in the Netherlands. *Drinking Water Engineering and Science*, 14(1), 1-43. <https://doi.org/10.5194/dwes-14-1-2021>

Important note

To cite this publication, please use the final published version (if applicable). Please check the document version above.

Copyright

Other than for strictly personal use, it is not permitted to download, forward or distribute the text or part of it, without the consent of the author(s) and/or copyright holder(s), unless the work is under an open content license such as Creative Commons.

Takedown policy

Please contact us and provide details if you believe this document breaches copyrights. We will remove access to the work immediately and investigate your claim.



Sustainability characteristics of drinking water supply in the Netherlands

Jolijn van Engelenburg¹, Erik van Slobbe², Adriaan J. Teuling³, Remko Uijlenhoet^{3,4}, and
Petra Hellegers⁵

¹Asset Management Department, Vitens NV, P.O. Box 1205, 8001 BE Zwolle, the Netherlands

²Water Systems and Global Change Group, Wageningen University and Research,
P.O. Box 47, 6700 AA Wageningen, the Netherlands

³Hydrology and Quantitative Water Management Group, Wageningen University and Research,
P.O. Box 47, 6700 AA Wageningen, the Netherlands

⁴Department of Water Management, Civil Engineering and Geosciences Faculty, Delft University of
Technology, P.O. Box 5048, 2600 GA Delft, the Netherlands

⁵Water Resources Management Group, Wageningen University and Research,
P.O. Box 47, 6700 AA Wageningen, the Netherlands

Correspondence: Jolijn van Engelenburg (jolijn.vanengelenburg@vitens.nl)

Received: 13 March 2020 – Discussion started: 24 March 2020

Revised: 16 October 2020 – Accepted: 29 November 2020 – Published: 19 January 2021

Abstract. Developments such as climate change and a growing demand for drinking water threaten the sustainability of drinking water supply worldwide. To deal with this threat, adaptation of drinking water supply systems is imperative, not only on a global and national scale but particularly on a local scale. This investigation sought to establish characteristics that describe the sustainability of local drinking water supply. The hypothesis of this research was that sustainability characteristics depend on the context that is analysed, and therefore, a variety of cases must be analysed to reach a better understanding of the sustainability of drinking water supply in the Netherlands. Therefore, three divergent cases on drinking water supply in the Netherlands were analysed. One case related to a short-term development (2018 summer drought), and two concerned long-term phenomena (changes in water quality and growth in drinking water demand). We used an integrated systems approach, describing the local drinking water supply system in terms of hydrological, technical, and socio-economic characteristics that determine the sustainability of a local drinking water supply system. To gain a perspective on the case study findings that are broader than the Dutch context, the sustainability aspects identified were paired with global aspects concerning sustainable drinking water supply. This resulted in the following set of hydrological, technical, and socio-economic sustainability characteristics: (1) water quality, water resource availability, and impact of drinking water abstraction; (2) reliability and resilience of the technical system and energy use and environmental impact; (3) drinking water availability, water governance, and land and water use. Elaboration of these sustainability characteristics and criteria into a sustainability assessment can provide information on the challenges and trade-offs inherent in the sustainable development and management of a local drinking water supply system.

1 Introduction

Climate change, combined with a growing drinking water demand, threatens the sustainability of the drinking water supply worldwide. The goal set for drinking water supply in Sustainable Development Goal (SDG) 6.1 (UN, 2015) is “to achieve universal and equitable access to safe and affordable drinking water for all by 2030”. Worldwide drinking water supply crises are visible, resulting from a combination of limited water resource availability, lacking or failing drinking water infrastructure, and/or increased drinking water demand due to short-term events or long-term developments (WHO, 2017). Still, nearly 10 percent of the world population is fully deprived of improved drinking water resources (Ekins et al., 2019), and additionally, existing drinking water supply systems are often under pressure. For instance, two recent examples of water crises were reported in Cape Town, South Africa, and São Paulo, Brazil (Sorensen, 2017; Cohen, 2016). To deal with such challenges and threats to safe and affordable drinking water, adaptation of the current drinking water supply system is imperative, not only on a global and national level but also on a local scale.

In the Netherlands, for instance, the national drinking water supply currently meets the indicator from SDG 6 (UN, 2018) on safely managed drinking water services and safely treated wastewater. At the same time, the more specific goals on (local) water quantity, quality, and ecology, as set by the European Water Framework Directive (WFD), are not met yet (European Environment Agency, 2018). Consequently, drinking water supply in the Netherlands does not meet all SDG 6 indicators, for instance when considering impact on water-related ecosystems (Van Engelenburg et al., 2018), of water pollution (Kools et al., 2019; Van den Brink and Wuijts, 2016), or of water shortage (Ministry of Infrastructure and Environment and Ministry of Economic Affairs and Climate Policy, 2019). Additionally, future developments, such as the uncertain drinking water demand growth rate (Van der Aa et al., 2015) and the changing climate variability (Teuling, 2018), may put the sustainability of the Dutch drinking water supply under pressure in the future.

The abstraction of groundwater or surface water from the hydrological system, and subsequent treatment to drinking water quality before being distributed to customers, requires local infrastructure (typically a drinking water production facility embedded in a distribution network of pipelines). Although the daily routine of drinking water supply has a highly technical character (Bauer and Herder, 2009), the sustainability in the long-term depends on the balance between technical, socio-economic, and environmental factors. This balance is especially complex for the local drinking water supply, which is intertwined with the local hydrological system and local stakeholders through its geographical location.

Because of the interconnections between physical, technical, and socio-economic factors as well as across space, organizational levels, and time, adaptation of the local drink-

ing water supply to current and future sustainability challenges calls for an integrated planning approach (Liu et al., 2015). Integrated models have been developed to understand the complex interactions between the physical, technical, and socio-economic components in various water systems (Loucks et al., 2017). However, a systems analysis to assess local drinking water supply and to identify sustainability challenges on a local scale has not yet been developed.

This research aimed to propose a set of sustainability characteristics that describe the drinking water supply system on a local scale to support policy- and decision-making on sustainable drinking water supply. To reach this aim, cases on drinking water supply were analysed using a conceptual framework. The selected cases represented a short-term event and long-term developments that affect water quality and water resource availability, the technical drinking water supply infrastructure, and/or the drinking water demand. The system boundaries were set to drinking water supply on a local scale. While the drinking water supply on a local scale is also affected by outside influences from different organizational and spatial scales, the analysis accounted for these external influences too. The hypothesis of this research was that sustainability characteristics depend on the context that is analysed, and therefore, a variety of cases must be analysed to reach a better understanding of the sustainability of drinking water supply in the Netherlands.

2 Method

Sustainable water systems can be defined as water systems that are designed and managed to contribute to the current and future objectives of society, maintaining their ecological, environmental, and hydrological integrity (Loucks, 2000). This study focused on the sustainability of drinking water supply systems on a local scale – in short, local drinking water supply systems. The boundaries of these systems were set by the area in which drinking water abstraction is embedded. The system can be approached from different perspectives. The socio-ecological approach considers relations between the socio-economic and environmental system, whereas the socio-technical approach considers the socio-economic and technical system (Pant et al., 2015). In this study, we combined both approaches by describing the local drinking water supply system in terms of hydrological, technical, and socio-economic characteristics that determine the sustainability of a local drinking water supply system.

Drinking water supply in the Netherlands is of a high standard compared to many other countries. The SDG 6 targets on safe and affordable drinking water and sanitation and wastewater treatment are basically met. But the Dutch government and drinking water suppliers are also challenged to meet the other goals set in SDG 6, such as the improvement of water quality, increase in water-use efficiency, and protection and restoration of water-related ecosystems. In ad-

dition the standards on water quantity, quality, and ecology, as set by the European Water Framework Directive (WFD), have not been achieved yet (European Environment Agency, 2018).

The adopted research approach consisted of four steps. The first step was the selection and analysis of three drinking water practice cases in the Netherlands, aiming to identify the main Dutch sustainability aspects in these cases. Three Dutch cases were selected based on their impact on the sustainability of drinking water supply in the Netherlands, considering a short-term event with limited water resource availability and long-term, ongoing developments on water quality, and growing drinking water demand and water resource availability. The cases are illustrated with Vitens data (Van Engelenburg et al., unpublished, 2020).

In the second step, the cases were analysed using the DPSIR framework (Driver, Pressure, State, Impact, Response; Eurostat, 1999; see Sect. 2.1). The sustainability aspects of these cases were identified in the descriptive results of the DPSIR analysis. The results were combined with Dutch governmental reports on these events and developments (Ministry of Infrastructure and Environment and Ministry of Economic Affairs and Climate Policy, 2019; Vitens, 2016) and cross-checked with Vitens staff. The sustainability aspects were categorized into hydrological, technical, and socio-economic aspects. This resulted in a set of relevant sustainability aspects, which is presented in Appendices A–C. The following step was used to broaden the perspective from the drinking water supply in the Netherlands to a more general perspective by cross-checking the set of sustainability aspects with the targets and indicators in Sustainable Development Goal 6 (hereafter referred to as SDG 6; see Appendix D; UN, 2015) and the WHO Guidelines for Drinking-water Quality (WHO, 2017). The sustainability aspects, as identified in the analysis, were categorized into nine hydrological, technical, and socio-economic sustainability characteristics. In the final step of the study, each sustainability characteristic was elaborated further into five sustainability criteria that describe the local drinking water supply system. The results are described in Sect. 3. A detailed description of the resulting sustainability criteria is presented in Appendix E.

2.1 Case analysis method

To reach the aim of this research to support policy development on sustainable drinking water supply, three practice cases were analysed to identify the main sustainability aspects in these cases using the DPSIR (Driver, Pressure, State, Impact, Response) systems approach (Eurostat, 1999). Drivers describe future developments, such as climate change and population growth. Pressures are developments (in emissions or environmental resources) as a result of the drivers. The state describes the system state that results from the pressures. In this research, the aim is to describe the sys-

tem state of the drinking water supply system in terms of local hydrological, technical, and socio-economic sustainability characteristics (see Sect. 2.1). The changes in system state cause impacts on system functions, which will lead to societal responses. DPSIR was originally developed to describe causal relations between human actions and the environment. It has also frequently been used for relations and interactions between technical infrastructure and the socio-economic and physical domain (Pahl-Wostl, 2015; Hellegers and Leflaive, 2015; Binder et al., 2013).

The DPSIR approach was used for the analysis of the three selected drinking water supply cases to obtain an overview of the impact of drivers, pressures, and responses to the state of the drinking water supply system. Although the framework has been applied on different spatial scales, Carr et al. (2009) recommend using the framework in a place-specific manner to ensure that local stakeholder perspectives are assessed as well. With the research focus at the local drinking water supply system, these local perspectives were implicitly included. The drivers, pressures, and responses can be on local and higher organizational and/or spatial scales, thus ensuring that – where essential – relevant higher scales are accounted for too.

DPSIR has previously been used for complex water systems by various well-known researchers in this field, such as Claudia Pahl-Wostl. In Binder et al. (2013), a comparison was made between various frameworks, which concluded that DPSIR is a policy framework that does not explicitly include development of a model but aims at providing policy-relevant information on pressures and responses on different scales. In Carr et al. (2009), the use of DPSIR for sustainable development was evaluated. Although the authors were critical regarding the use of the DPSIR framework on national, regional, or global scales, they considered application on a local scale appropriate. They concluded that practitioners could use DPSIR for local-scale studies because it assesses the place-specific nuances of multiple concerned stakeholders more realistically. In Van Noordwijk et al. (2020), DPSIR was used to understand the joint multiscale phenomena in the forest–water–people nexus and, thus, diagnosed issues to be addressed in local decision-making. Therefore, DPSIR was considered an appropriate framework for meeting the aim of the research.

The impact of developments on different temporal scales to the drinking water supply system must be considered as well. The long-lived, interdependent drinking water supply infrastructure is resistant to change due to design decisions in the past which cause path dependencies and lock-ins (Melese et al., 2015). In addition, consumer behaviour, governance and engineering, and the interaction between these processes cause lock-in situations that limit the ability to change towards more sustainable water resources management (Pahl-Wostl, 2002). For this reason, the case analysis was performed considering both short- and long-term pressures, impacts and responses.

2.2 Case selection

In this research, three drinking water supply cases in the Netherlands were selected. The case studies were analysed to find sustainability aspects caused by the identified pressures and short- and/or long-term responses in each case because short-term shocks have different impacts and call for other responses than long-term stresses (Smith and Stirling, 2010). The cases therefore focused on short-term events and long-term developments. All three cases also related to targets set in SDG 6 (UN, 2015). The DPSIR analysis of the case studies is presented in Appendices A–C.

2.3 Case 1: 2018 summer drought

Summer 2018 in the Netherlands was extremely warm and dry, causing water shortages in the water system and a long period of extreme daily drinking water demand, resulting in a record monthly water demand in July 2018 (Ministry of Infrastructure and Environment and Ministry of Economic Affairs and Climate Policy, 2019; see Illustration case 1). The driver in this case is the extreme weather condition, which caused several pressures, such as high temperatures, high evaporation, and a lack of precipitation. These pressures did not only cause drought damage to nature, agriculture, and gardens and parks as well as limited water availability in the surface water and groundwater systems, they also resulted in an extremely high drinking water demand. Data on drinking water supply volumes (Van Engelenburg et al., unpublished, 2020) showed that the extreme drinking water demand during summer 2018 put the drinking water supply system under high pressure, causing extreme daily and monthly drinking water supply volumes that exceeded all previously supplied volumes (see Fig. 1). The capacity of the system was fully exploited but faced limitations in abstraction, treatment and distribution capacity.

Illustration case 1: 2018 summer drought

Within the Vitens supply area, the average daily supply volume during the summer period June–August over the years 2012–2017 was approximately $965\,000\text{ m}^3\text{ d}^{-1}$. During the period 27 June–4 August 2018, the daily supply volume exceeded this average summer volume by approximately 28 %, with an average volume of nearly $1\,240\,000\text{ m}^3\text{ d}^{-1}$ (Fig. 1a). On 25 July 2019, the maximum daily water supply reached nearly $1\,390\,000\text{ m}^3\text{ d}^{-1}$, which was 42 % above the baseline daily supply (Fig. 1a). The monthly drinking water supply volume in July 2018 of 38 million m^3 per month was an increase of 18 % compared to the previous maximum monthly supply volumes (Fig. 1b). Although the drinking water supply infrastructure was designed with an overcapacity to meet the regular demand peaks, the flexibility to more extreme peaks or to long periods of peak demand is limited.

The high drinking water abstraction volumes added up to the water shortages in both the groundwater and the surface

water system that was caused by the lack of precipitation and high evaporation during the summer (Ministry of Infrastructure and Environment and Ministry of Economic Affairs and Climate Policy, 2019). To ensure an acceptable surface water quality for the drinking water supply, measures were taken to reduce salinization (Ministry of Infrastructure and Environment and Ministry of Economic Affairs and Climate Policy, 2019).

To reduce the drinking water use, a call for drinking water saving was made, and locally, pressures in the drinking water distribution system were intentionally lowered to reduce the delivered drinking water volumes (Ministry of Infrastructure and Environment and Ministry of Economic Affairs and Climate Policy, 2019). The problems caused by the summer drought raised a discourse on (drinking) water use and saving, including discussions on controversial measures such as a progressive drinking water tariffs, with tariffs dependent on the consumed drinking water volume and differentiation between high-grade and low-grade use of (drinking) water (Ministry of Infrastructure and Environment and Ministry of Economic Affairs and Climate Policy, 2019). The results of this case analysis are presented in Appendix A.

2.4 Case 2: groundwater quality development

This case focused on the impact of the groundwater quality development in the Netherlands on the drinking water supply. Analysis of the state of the resources for drinking water supply in the Netherlands in 2014 pointed out that, although the drinking water quality met the Dutch legal standards, all water resources are under threat by known and new pollutants (Kools et al., 2019). In the Netherlands, 55 % of the drinking water supply is provided by groundwater resources (Baggelaar and Geudens, 2017). Long-term analysis of water quality records of Dutch drinking water supply fields shows that the vulnerability of groundwater resources to external influences, such as land use, strongly depends on hydrochemical characteristics (Mendizabal et al., 2012). Monitoring results show that, currently, groundwater quality is mainly under pressure due to nitrate, pesticides, historical contamination, and salinization (Kools et al., 2019). Nearly half of the groundwater abstractions for drinking water are affected by an insufficient groundwater quality, and it is expected that, in the future, the groundwater quality at more abstractions will exceed the groundwater standards set in the European Water Framework Directive (European Union, 2000). In addition, traces of pollutants such as recent industrial contaminants, medicine residues, and other emerging substances have been found, indicating that the groundwater quality will likely further deteriorate (Kools et al., 2019).

Groundwater protection regulations regarding land and water use by legal authorities will help to slow down groundwater deterioration (Van den Brink and Wuijts, 2016). However, strategies to restore groundwater quality will often not be effective in the short term because already existing con-



Figure 1. Daily (a) and monthly (b) drinking water supply volume by Dutch drinking water supplier Vitens during summer 2017 (average), 2018 (extreme), and 2019 (high) (Van Engelenburg et al., unpublished, 2020).

taminations may remain present for a long period of time, depending on the local hydrological characteristics (Jørgensen and Stockmarr, 2009; see Illustration case 2). The impact of contamination cannot be undone unless soil processes help to (partially) break down contaminants. Thorough monitoring for pollution is therefore essential for following groundwater quality trends and for responding adequately to these trends (Janža, 2015). Due to the expected deterioration of the raw water quality¹, different and more complex treatment meth-

ods are necessary to continuously meet the drinking water standards (Kools et al., 2019). In general, a more complex treatment method leads to higher energy use, use of additional excipients, water loss, and the production of waste materials, which will lead to a higher water tariff and to a higher environmental impact (Napoli and Garcia-Tellez, 2016). The results of the analysis are presented in Appendix B.

Illustration case 2: groundwater quality development

In the 1980s, the Dutch government implemented regulations to protect water quality by limiting the growing nitrate and phosphate surplus due to overuse of livestock manure. This

¹Raw water is the (untreated) water that is treated to produce drinking water. This can be abstracted groundwater or surface water, depending on the available water resource.

resulted in a decrease in the nitrate surplus from 1985 on. However, due to the long travel times in groundwater, it took years before the impact of these regulations became visible in the groundwater quality. Figure 2 illustrates the period of time in which the nitrate concentration in an abstraction well still increased despite the 1985 regulations on reduction in the nitrate surplus at surface level. The nitrate concentration in this well increased until 2005 before the nitrate level started to decrease. Only since 2014 has the concentration dropped below the nitrate standard for groundwater of 50 mg L^{-1} .

2.5 Case 3: drinking water demand growth

Due to drinking-water-saving strategies, the drinking water use in the Netherlands per person has decreased from 137 litre per person per day in 1992 to 119 litre per person per day in 2016 (Van Thiel, 2017). This development resulted in a decreasing total yearly drinking water demand volume in that same period, despite the population growth in the Netherlands (Baggelaar and Geudens, 2017). However, 2013 was a turning point at which the total yearly drinking water demand volume in the Netherlands started to grow again (Baggelaar and Geudens, 2017). The trend in the period 2013–2019 shows a strong increase in drinking water demand (see Illustration case 3). Delta scenarios have been developed for the Netherlands, projecting a drinking water demand development varying between a decrease of 10 % to an increase of 35 % in 2050 compared to 2015 (Wolters et al., 2018).

The drinking water demand growth rate for the period 2013–2019, as is seen within the Vitens supply area, compares to the growth rate in the maximum delta scenario of 35 % growth from 2015 to 2050 (See Illustration case 3).

Illustration case 3: drinking water demand growth

The increase in normalized drinking water supply volume as supplied by Vitens between 2015 and 2019 is 4.5 % (Fig. 3). Due to this recent demand growth, the reserve capacity within the existing drinking water supply infrastructure is already limited. The drinking water demand growth rate for the period 2015–2019 compares to the growth rate in the maximum Delta scenario of 35 % growth from 2015 to 2050 (Fig. 3). If this growth rate is not tempered through a significant reduction in the drinking water use, this would require a large extension of the drinking water supply infrastructure.

If this strong growth rate continues, it will put serious pressure on the drinking water supply. This will partially be due to limitations in the technical infrastructure but also partially due to limitations in the water resource availability caused by insufficient abstraction permits or a possibly negative impact on the hydrological system and stakeholders. Given the inflexibility of drinking water supply infrastructure to change,

an integrated strategy is necessary to meet this uncertain development in the drinking water demand. To find sustainable solutions for the future, not only the technical infrastructure aspects must be solved. It also requires strategies on water saving, expansion of permits, development of new abstraction concepts using other water resources, as well as stakeholder processes in the design and use of the local drinking water supply system. This case is basically an extension of the first two cases in that the growing water demand amplifies the aspects caused by the drought in 2018 and the groundwater quality development. The results of the analysis of this case study are presented in Appendix C.

3 Sustainability characteristics of drinking water supply

In this section, the sustainability characteristics are presented, each elaborated further into five sustainability criteria. A detailed description of the resulting sustainability criteria can be found in Appendix E.

3.1 Hydrological sustainability characteristics

The following three hydrological sustainability characteristics are proposed that summarize the hydrological aspects affecting the drinking water supply as found in the case studies: water quality, water resource availability, and impact of drinking water abstraction (Table 1).

Water quality includes the monitoring and evaluation of current water quality and the trends and expected future development of the water quality and emerging contaminants, as described in the case of “groundwater quality development”. In the WHO Guidelines for Drinking-water Quality (WHO, 2017), the importance of microbial aspects as a global water quality aspect with a health impact is additionally monitored, such as bacteriological contamination due to untreated wastewater or emergencies. The WHO Guidelines for Drinking-water Quality (WHO, 2017) also require monitoring of water quality aspects without a health impact, such as salinization, water hardness, and colour, which affect the acceptability of the drinking water (WHO and UNICEF, 2017).

Water resource availability for drinking water supply can be differentiated into the surface water and groundwater availability, as illustrated in case 1 – “2018 Summer drought”. Other sustainability aspects are the vulnerability of the surface and/or groundwater system to the water quality being permanently affected by land use, as illustrated in the case of “groundwater quality development”. The water resource availability can also be limited due to small- or large-scale emergencies caused by natural hazards, such as droughts, floods, earthquakes, or forest fires (WHO and UNICEF, 2017) that will put the sustainability of the local drinking water supply under pressure.

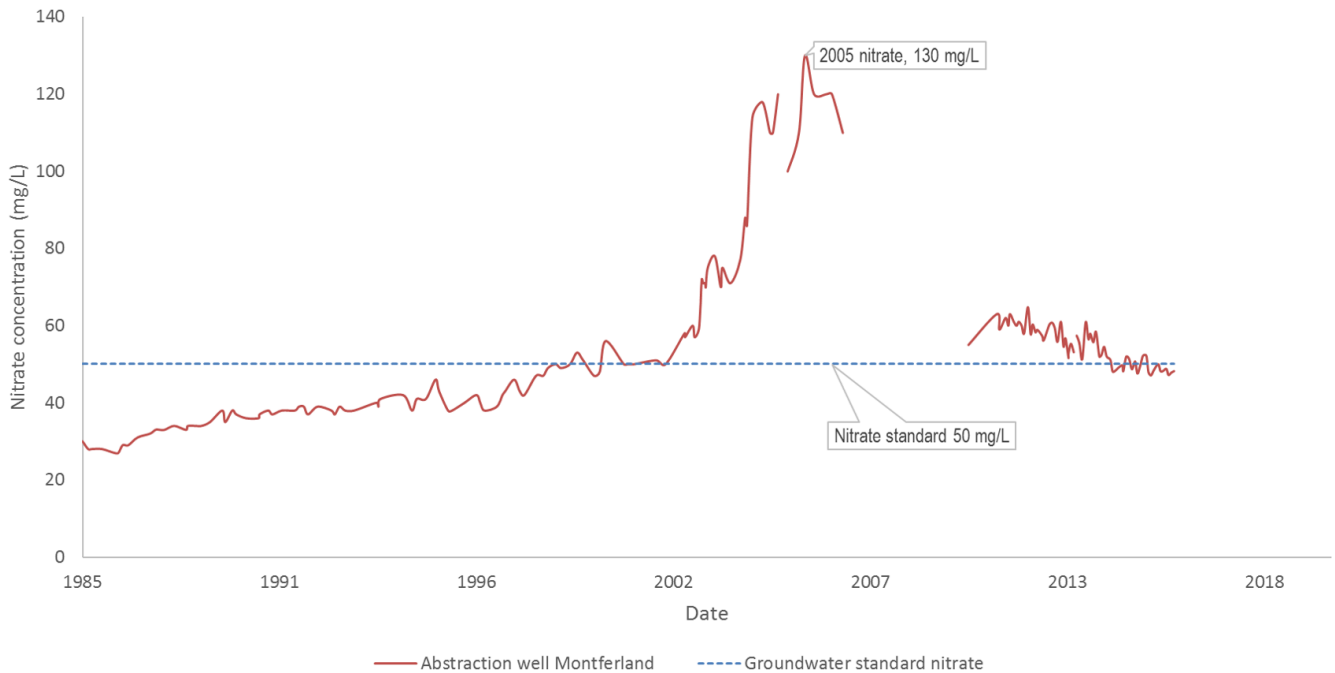


Figure 2. Development of nitrate in an abstraction well in Montferland (HEE-P07-07.0; coordinates – X213.540–Y434.761) in the province of Gelderland, the Netherlands (Van Engelenburg et al., unpublished, 2020), compared to the Dutch standard for nitrate concentration in groundwater (50 mg L^{-1}).

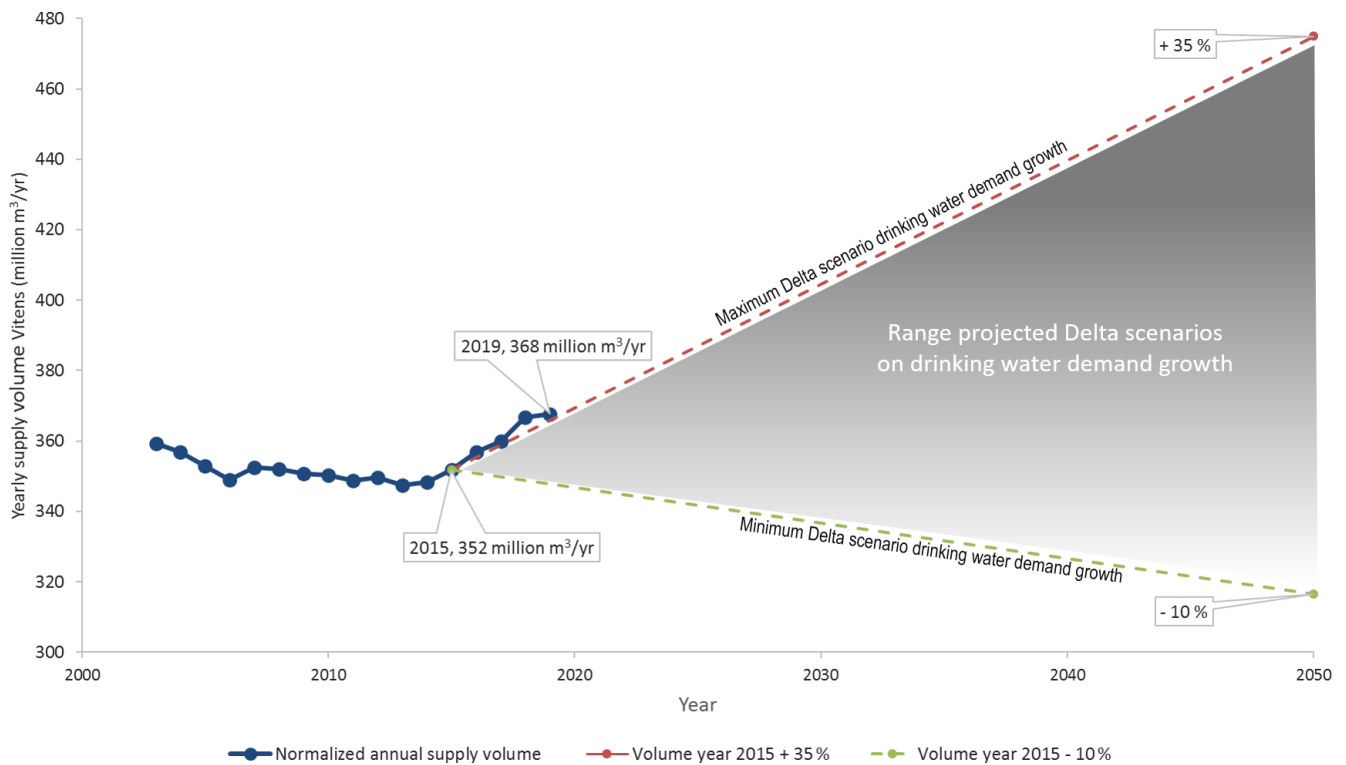


Figure 3. Development of the normalized annual drinking water volume supplied by Vitens (drinking water supplier), the Netherlands, 2003–2019 (Van Engelenburg et al., unpublished, 2020), compared to the projected Delta scenarios on drinking water demand growth (Wolters et al., 2018), ranging between a decrease of 10 % and an increase of 35 % in 2050 compared to 2015. The normalized annual drinking water supply volume excludes the impact of extreme weather conditions on the actual supplied annual volumes of drinking water.

Table 1. Summary of proposed hydrological sustainability characteristics, hydrological aspects from case studies (see Appendices A–C), relevant SDG* indicators and WHO Guidelines for Drinking-water Quality (WHO, 2017) aspects, and hydrological sustainability criteria.

Hydrological sustainability characteristics	Water quality	Water resource availability	Impact of drinking water abstraction
Sustainability aspects from case studies	Monitoring and evaluation Sources of pollution Contaminants Emerging contaminants Groundwater quality Surface water quality Raw water quality	Other water resources Surface water quantity Groundwater quantity Vulnerability of the water system Drought impact Water discharge	Impact of abstraction Groundwater levels Abstraction volume Balance between annual recharge and annual abstraction Hydrological compensation
SDG 6 targets*	6.3; 6.5	6.4; 6.5	6.4; 6.6
WHO Guidelines for Drinking-water Quality (WHO, 2017)	Health risks from microbial contamination Acceptability of the drinking water (salinization, hardness, and colour)	Small- or large-scale emergencies caused by natural hazards such as droughts, floods, earthquakes, or forest fires	–
Sustainability criteria	Current raw water quality Chemical aspects of water quality Microbial aspects of water quality Acceptability aspects of water quality Monitoring and evaluation of water quality trends	Surface water quantity Groundwater quantity Other available water resources Vulnerability of used water system for contamination Natural hazards and emergencies risk	Impact on surface water system Impact on groundwater system Balance between annual recharge and abstraction Hydrological compensation Spatial impact of abstraction facility/ storage/reservoir

* SDG –Sustainable Development Goal; see Appendix V for a summary of SDG 6 targets and indicators related to sustainability characteristics (UN, 2015).

The impact of the drinking water abstraction on the hydrological system entails the impact on both the surface water system and the groundwater system and also the balance between the annual drinking water abstraction volume and the annual recharge of the (local) water system. Whether the impact of the abstraction is or can possibly be hydrologically compensated is another sustainability aspect. The spatial impact of the local drinking water abstraction facility may also be a sustainability aspect because a drinking water facility requires a certain water storage area or reservoir, which might have a significant spatial impact in the area and, thus, might affect local stakeholders.

3.2 Technical sustainability characteristics

The following three technical sustainability characteristics are proposed that summarize the technical aspects for the drinking water supply as found in the case studies: reliability and resilience of the technical infrastructure and energy use and environmental impact of the drinking water supply (Table 2).

The reliability of the supply system is defined in this research as “the (un)likeliness of the technical system to fail” (Hashimoto et al., 1982). The current technical state of the

drinking water production facility and the distribution infrastructure and the complexity of the water treatment are important technical sustainability criteria for the local drinking water supply system. Other technical criteria that should be considered are the supply continuity of the facility, which stands for the capability to meet the set legal standards for drinking water supply under all circumstances and the operational reliability to solve technical failures without any disturbance of the drinking water supply.

In this research, the resilience of the drinking water supply system is defined as “the possibility to respond to short- and long-term changes in water demand or water quality” (Hashimoto et al., 1982). Climate change and other developments in water demand and quality call for the use of more resilient technologies and processes and may require upgrades of water treatment and storage capacity (WHO and UNICEF, 2017). The cases of “2018 summer drought” and “drinking water demand growth” emphasize the importance of the available abstraction permits and the treatment and distribution capacity compared to the annual and peak water demand, respectively, for the resilience of the local drinking water supply system. Furthermore, the flexibility of the treatment method determines whether a drinking water supply system can deal with variation in, or deterioration of, wa-

Table 2. Summary of proposed technical sustainability characteristics, technical aspects from case studies (see Appendices A–C), relevant SDG* indicators and WHO Guidelines for Drinking-water Quality (WHO, 2017) aspects, and technical sustainability criteria.

Technical sustainability characteristics	Reliability of technical infrastructure	Resilience of technical infrastructure	Energy use and environmental impact
Sustainability aspects from case studies	Drinking water pressure Drinking water treatment Reliability of abstraction, treatment, and distribution infrastructure	Abstraction capacity Treatment capacity Treatment methods Distribution capacity Resilience of technical infrastructure	Energy use Environmental impact Additional excipients Wastewater Waste materials
SDG 6 targets*	6.1; 6.4	6.1; 6.4	6.4
WHO Guidelines for Drinking-water Quality (WHO, 2017)	Safely managed drinking water services, i.e. improved drinking water source on premises, available when needed, and free from contamination	Resilient technologies and processes Upgrades of water treatment and storage capacity	Reliability of the energy supply Renewability of the energy
Sustainability criteria	Technical state abstraction and treatment facility Technical state distribution infrastructure Complexity of water treatment Supply continuity for customers Operational reliability	Abstraction permit compared to annual drinking water demand Production capacity compared to peak demand Flexibility of treatment method Technical innovations to improve resilience Technical investments to improve resilience	Energy use of abstraction and treatment Energy use of distribution Environmental impact (additional excipients, wastewater, and waste materials) Reliability of the energy supply Use of renewable energy

* SDG – Sustainable Development Goal; see Appendix V for a summary of SDG 6 targets and indicators related to sustainability characteristics (UN, 2015).

ter quality and emerging contaminants, which are the sustainability aspects found in the case of “groundwater quality development”.

Energy use and environmental impact include the sustainability aspects from the cases of “groundwater quality development” and “drinking water demand growth”. This entails the energy use of abstraction, treatment, and distribution and the environmental impact of additional excipients, wastewater, and other waste products of the treatment. Especially when the raw water quality deteriorates, the required water treatment methods become more complex. In general, this leads to large investments and an increased energy use and environmental impact, e.g. when advanced membrane filtration methods are required. Additional global sustainability aspects are the reliability of the energy supply and the renewability of the energy that is used (WHO, 2017).

3.3 Socio-economic sustainability characteristics

A total of three socio-economic sustainability characteristics are proposed that summarize the socio-economic aspects affecting the drinking water supply as found in the case studies, namely drinking water availability, water governance, and land and water use (Table 3).

The drinking water availability can be quantified by the percentage of households connected to the drinking water supply. A sustainable local drinking water supply provides sufficient drinking water of a quality that meets the national or international drinking water standards at a tariff that is affordable to all households (UN, 2015). In the Netherlands, by law the drinking water tariff must be built on a cost-recovery, transparent, and non-discriminatory basis (Dutch Government, 2009). Water-saving strategies will reduce the drinking water demand growth and, therefore, will contribute to the sustainability. Drinking water safety is a prerequisite for public health and sustainable drinking water supply. The WHO guidelines consider water safety plans essential for providing the basis for system protection and process control and for ensuring that water quality issues present a negligible risk to public health and that the drinking water is acceptable to consumers. Therefore, the WHO Guidelines for Drinking-water Quality (2017) monitor the availability of water safety plans, including emergency plans on how to act in case of drinking water supply disturbances, shortages, or drinking water quality emergencies (WHO and UNICEF, 2017). A water safety plan can be built on various safety protocols.

Water governance focuses on policies and legislation, enforcement, and compliance of regulations. Good governance also includes decision-making processes that consider differ-

Table 3. Summary of proposed socio-economic sustainability characteristics, socio-economic aspects from case studies (see Appendices A–C), relevant SDG* indicators and WHO Guidelines for Drinking-water Quality (WHO, 2017) aspects, and socio-economic sustainability criteria.

Socio-economic sustainability characteristics	Drinking water availability	Water governance	Land and water use
Sustainability aspects from case studies	Customers Drinking water availability Drinking water demand Drinking water tariff Drinking water quality Drinking water volume Drinking water shortage Emergencies and disturbances Water saving	Abstraction permits Drinking water standards Water authorities Water legislation, policy, and regulations Drinking water suppliers Compliance Stakeholders	Water use Land use Agriculture Nature and groundwater-dependent ecosystems Financial compensation Spatial impact
SDG 6 targets*	6.1	6.3; 6.4; 6.5; 6.6; 6.a; 6.b	6.3; 6.4
WHO Guidelines for Drinking-water Quality (WHO, 2017)	Water safety plan	Small- or large-scale emergencies for the drinking water supply caused by human activities or conflicts	–
Sustainability criteria	Percentage of connected households Drinking water service quality Drinking water tariff Water-saving strategy Water safety protocols	Availability of (drinking) water legislation and policies Compliance of drinking water supplier Decision-making process by (local) authorities Local stakeholder interests Emergency risk caused by human activities or conflicts	Land use (including subsurface use) Water use for purposes other than drinking water Regulations on land and water use Limitations on land or water use Financial compensation for economic damage from the impact of abstraction or limitations on land use

* SDG – Sustainable Development Goal; see Appendix V for a summary of SDG 6 targets and indicators related to sustainability characteristics (UN, 2015).

ent stakeholder interests to ensure accountable, transparent, and participatory governance (UNESCAP, 2009). The availability of (inter-) national and local policies and legislation on drinking water supply as well as on water management, including regulations and permits, and the level of compliance of the drinking water supplier to these policies and legislation, is important for socio-economic sustainability. The sustainability of the local drinking water supply is also characterized by the stakeholders' interests related to the presence of a local drinking water abstraction and by how local authorities weigh these interests in their decision-making processes. A final aspect in water governance that reaches further than local stakeholder interests is the risk of small- or large-scale emergencies for the drinking water supply caused by human activities or conflicts (WHO and UNICEF, 2017).

The local land and water use, at surface and subsurface level, affects the water quality and quantity. It may have resulted in historical contaminant sources, causing point or non-point water pollution, but it may also lead to emerging contaminants that provide new risks to water quality. Addi-

tionally, water use for other purposes may limit the availability of water resources for drinking water. Regulations to protect water quality or water quantity may cause limitations on local land and water use. Financial compensation for suffered economic damage due to the impact of the abstraction or the limitations caused by protection regulations can be an important aspect for the sustainability of the drinking water supply system.

4 Discussion

4.1 Use of DPSIR systems approach

In this study, we used an integrated systems approach to analyse the local drinking water supply system, combining hydrological, technical, and socio-economic aspects of the system. The analysis of the three selected cases with DPSIR supported the identification of the aspects that shape the sustainability of the local drinking water supply system. The case analysis did indeed help to account for differences between

short-term and long-term developments and for the impact of external influences that come from the national and international scale.

The applied DPSIR approach is a linear socio-ecological framework originally developed to identify the impact of human activities on the state of the environmental system (Binder et al., 2013). However, the local drinking water supply system is a complex rather than linear system because the impact of pressure on one system element could lead to pressure on another system element. This complicated the identification of pressures and impacts. For instance, high temperatures and lack of precipitation caused a higher drinking water demand and surface water quality deterioration. Both consequently presented pressures with an impact on the resilience and reliability of the technical drinking water supply infrastructure. Although this hampered the analysis, the use of DPSIR supported a systematic analysis of the local drinking water supply cases and helped to identify the sustainability aspects. Use of a different integrated systems approach would not have led to a significantly different outcome for the case analysis. A next step could potentially be to use the identified system characteristics for system dynamics analysis and modelling. However, this is beyond the scope of this current research.

4.2 General applicability of the sustainability characteristics

To increase the general applicability of the results from the analysis of the Dutch cases on drinking water supply, the identified sustainability aspects were related to worldwide acknowledged sustainability aspects by cross-checking with international policies on drinking water supply. This put the aspects in a broader perspective, which may contribute to the transferability of the proposed sustainability characteristics and criteria to other areas.

Assessments to understand the sustainability challenges and the impact of future developments and adaptation options are seen as powerful tools for policy-making (Ness et al., 2007; Singh et al., 2012). The sustainability characteristics, as proposed in this research, may be used to develop a sustainability assessment for the local drinking water supply system that can help to identify sustainability challenges and trade-offs of adaptation strategies. Trade-off analysis supports decision-making processes and makes these processes more transparent to local stakeholders (Hellegers and Leflaive, 2015). Based on the local situation and data availability, adequate indicators and indices can be selected to quantify the sustainability characteristics in a certain area (Van Engelenburg et al., 2019).

5 Conclusions

The aim of this study was to identify a set of characteristics that describe the sustainability of a local drinking water supply system in the Netherlands to support policy- and decision-making on sustainable drinking water supply. The use of the DPSIR systems approach was an adequate method for the analysis of the cases. The results of the analysis of the three cases confirmed the hypothesis that sustainability is contextual, resulting in different sustainability aspects in the various cases. The combined results of the analysis of three different practice cases contributed to a better understanding of drinking water supply in the Netherlands. Cross-checking of the results of case analysis with international policies on drinking water supply provided a wider context than the Netherlands and has thus contributed to the general applicability of the identified sustainability characteristics.

Based on the presented analysis, the following set of hydrological, technical, and socio-economic sustainability characteristics is proposed, respectively: (1) water quality, water resource availability, and impact of drinking water abstraction; (2) reliability and resilience of the technical system and energy use and environmental impact; (3) drinking water availability, water governance, and land and water use. An elaboration of the sustainability characteristics into more detailed criteria may further increase the value of the results of this research in the process of the development of policies on sustainable drinking water supply in the Netherlands.

Appendix A: Results of analysis case 1: 2018 summer drought

Table A1. Summary of the impact, short- and long-term response, and sustainability aspects in case 1 – 2018 summer drought. In the subsequent Table A2, the full results of the case study are presented.

<i>Impact</i>	<i>Short-term response</i>	<i>Long-term response</i>	<i>Sustainability aspects</i>
Extreme drinking water use; high drinking water demand.	Drinking water suppliers' increased abstraction volume.	Development of water-saving strategies.	Drinking water use, drinking water demand, drinking water suppliers, abstraction volumes, and water saving.
Drought, falling water discharges and groundwater levels, and damage to groundwater-dependent ecosystems and agriculture.	Water use limitations, water authorities apply existing drought water policy, and risks for water quality.	Development of additional water shortage policy for water management and water governance.	Drought, water discharge, groundwater levels, groundwater-dependent ecosystems, agriculture, water use, water authorities, water policy, water management, water governance, and water availability.
Customers worried about drinking water availability.	Drinking water suppliers called on customers to save drinking water.	Societal support for drinking-water-saving strategies.	Customers, drinking water availability, drinking water suppliers, and water saving.
Declining surface water discharge and quality.	Drinking water suppliers took measures to safeguard raw water quality.	Development of additional policies on water quality protection.	Surface water discharge, surface water quality, drinking water suppliers, raw water quality, water management policies, and water use.
Groundwater quality deterioration.	No response possible due to a lack of water.	Development of additional policies on water quality protection.	Groundwater quality, surface water quality, water shortage, surface water discharge, and water management policies
Drinking water quality at risk due to rising water temperature in pipelines.	Sufficient refreshment due to high demand.	Changing the design standard of distribution pipelines to limit risk of temperature rise.	Drinking water quality, treatment method, and distribution infrastructure.
Increasing abstraction volume, resulting in increasing impact to land use.	Stakeholder complaints by agriculture and nature.	Increased societal pressure on the reduction of the impact of drinking water abstraction.	Drinking water demand, abstraction volume, impact of abstraction, land use, stakeholders, agriculture, nature, and drinking water suppliers.
Exceedance of abstraction permits and limiting the resilience of the technical infrastructure.	Enforcement procedures by legal authorities.	Extension of drinking water abstraction permits and water-saving strategies.	Drinking water demand, abstraction volume, abstraction capacity, abstraction permit, resilience of abstraction, legal authorities, water regulations, water legislation, and saving drinking water.
Shortage of drinking water during peak demand due to insufficient resilience of treatment infrastructure.	Reduced drinking water supply volume.	Adjustment of resilience and reliability of treatment infrastructure.	Treatment volume, treatment capacity, drinking water shortage, reliability of the treatment, resilience of the treatment, drinking water standards, drinking water demand, and drinking water suppliers.

Table A1. Continued.

<i>Impact</i>	<i>Short-term response</i>	<i>Long-term response</i>	<i>Sustainability aspects</i>
Insufficient distribution capacity.	Lowering drinking water pressure to reduce drinking water volume.	Adjustment of resilience and reliability of distribution infrastructure.	Distribution capacity, resilience and reliability of distribution, drinking water suppliers, drinking water volume, and drinking water standards.
Major disturbances could cause a serious disruption of the supply.	Maximum personnel deployment by drinking water suppliers.	Investments to improve the resilience and reliability of technical infrastructure by drinking water suppliers.	Drinking water demand, reliability of technical infrastructure, and drinking water suppliers.
High energy use and environmental impact of extreme drinking water production.	–	Incorporating impact to energy use and environmental impact in the design of measures to improve the resilience and reliability of technical infrastructure.	Drinking water demand, energy use, environmental impact, and drinking water suppliers.

Table A2. Results analysis of case 1 – “2018 summer drought”. For each pressure, the response to and impacts on the state of the local drinking water supply system are described. The cells in italics refer to Table A1.

Driver	Pressure	Impact	Short-term response	Long-term response	Sustainability aspects
<i>Extreme weather event</i>	<i>High temperature, high evaporation, and no precipitation.</i>	<i>Extreme drinking water use; high drinking water demand.</i>	<i>Drinking water suppliers increased abstraction volume.</i>	<i>Development of water-saving strategies.</i>	<i>Drinking water use, drinking water demand, drinking water suppliers, abstraction volume, and water saving.</i>
		The summer affected the drinking water use as follows: filling of swimming pools, watering gardens, and extra showering all led to a very high drinking water demand. Additionally, there also were requests from concerned citizens about adding drinking water to refill ponds that dried up due to the extreme drought.	Drinking water suppliers increased the abstraction volume to meet the increased drinking water demand.	The drought (re-)initiated a discourse on water-saving strategies, including controversial measures such as progressive drinking water tariffs and differentiation between high-grade (household and sanitation and food production) and low-grade (pools, gardens, and process water) use.	
<i>Extreme weather event</i>	<i>High evaporation and no precipitation.</i>	<i>Drought, falling water discharges and groundwater levels, and damage to groundwater-dependent ecosystems and agriculture.</i>	<i>Water use limitations, water authorities applied existing drought water policy, and risks in water quality.</i>	<i>Development of additional water shortage policy for water management and water governance.</i>	<i>Drought, water discharge, groundwater levels, groundwater-dependent ecosystems, agriculture, water use, water authorities, water policy, water management, water governance, and water availability.</i>
		The drought caused falling water discharges and groundwater levels; thus, river discharges declined, springs and brooks dried up, and vegetation withered or even died due to low groundwater levels and high temperatures. Groundwater-dependent ecosystems such as wetlands and agricultural produce suffered due to the drought.	Limitations in water use from water system. Water authorities applied the special water policy that was developed for periods with low water availability. Drinking water supply has a high ranking because of its high societal relevance.	Discourse and policy development for water management and water governance, aiming at a further prioritization and limitations of water use during water shortage and retention of surface water and groundwater during periods with sufficient water availability.	
			In some ecologically vulnerable areas, there is a water policy to resolve local surface water shortages by supplementing them from larger water bodies such as rivers. This affects the local surface water quality and may also affect the groundwater quality.		

Table A2. Continued.

Driver	Pressure	Impact	Short-term response	Long-term response	Sustainability aspects
<i>Extreme weather event</i>	<i>High evaporation and no precipitation.</i>	<i>Customers worried about drinking water availability.</i> Because of the visible damage to vegetation due to the drought, customers started to worry about the drinking water availability.	<i>Drinking water suppliers communicated that there still was sufficient drinking water, but people were asked to spread the drinking water use to reduce the peak demand. Later that summer, there was a call for customers to save water.</i>	<i>Societal support for drinking-water-saving strategies.</i>	<i>Customers, drinking water suppliers, and water saving.</i>
<i>Extreme weather event</i>	<i>No precipitation.</i>	<i>Declining surface water discharge and quality.</i> Due to the lack of rain, the share of industrial wastewater and treated sewage water in the surface water discharge increased, which caused the water quality in surface waters to deteriorate.	<i>Drinking water suppliers took measures to safeguard raw water quality.</i>	<i>Development of additional policies on water quality protection.</i>	<i>Surface water discharge, surface water quality, drinking water suppliers, raw water quality, water management policies, and water use.</i>
<i>Extreme weather event</i>	<i>Declining surface water quality.</i>	<i>Groundwater quality deterioration.</i> The impact of an incidental warm and dry summer on the groundwater quality is limited, but when comparable droughts happen frequently, the groundwater quality may deteriorate due to the impact of a declining surface water quality.	<i>No response possible due to lack of water.</i> In some surface water bodies, refreshment was required to guard the surface water quality, but due to the lack of precipitation, there was a water shortage, so insufficient water was available for this refreshment.	<i>Development of additional policies on water quality protection.</i>	<i>Groundwater quality, surface water quality, water shortage, surface water discharge, and water management policies.</i>

Table A2. Continued.

Driver	Pressure	Impact	Short-term response	Long-term response	Sustainability aspects
<i>Extreme weather event</i>	<i>High temperature.</i>	<i>Drinking water quality at risk due to rising water temperature in pipelines.</i>	<i>Ensuring sufficient refreshment due to high demand.</i>	<i>Changing the design standard of distribution pipelines to limit risk of temperature rise.</i>	<i>Drinking water quality, treatment method, and distribution infrastructure.</i>
<i>Extreme weather event</i>	<i>High drinking water demand.</i>	<i>Increasing abstraction volume resulting in increasing impact on land use.</i>	<i>Stakeholder complains by agriculture and nature.</i>	<i>Increased societal pressure on the reduction of the impact of drinking water abstraction.</i>	<i>Drinking water demand, abstraction volume, impact of abstraction, land use, stakeholders, agriculture, nature, and drinking water suppliers.</i>
		<p>The extreme temperatures led to an increased surface water temperature, and soil temperature, that may have affected the drinking water temperature in the distribution infrastructure. This introduces a drinking water quality risk.</p>	<p>When surface water is the main resource for drinking water, the water quality risk will be limited by a treatment method that ensures the bacteriological quality of the drinking water. Sufficient refreshment within storage and high stream velocities in pipelines reduces the risk of temperature rise in the distribution infrastructure.</p>	<p>The risk of drinking water quality aspects caused by increased drinking water temperature due to climate change may have consequences for the design of the distribution infrastructure.</p>	
		<p>To meet the high drinking water demand, the abstraction volume rose to a high level. In some local areas, the impact of the abstraction added up due to the extreme drought and high temperatures, affecting the land use.</p>	<p>Stakeholders in agriculture and nature complained about the impact of the extra abstraction on their land use.</p>	<p>The drought impact enlarged the societal pressure on drinking water suppliers to reduce the impact of local drinking water abstraction on the water system.</p>	

Table A2. Continued.

Driver	Pressure	Impact	Short-term response	Long-term response	Sustainability aspects
<i>Extreme weather event</i>	<i>High drinking water demand.</i>	<i>Exceedance of abstraction permits, limiting the resilience of the technical infrastructure.</i> To meet the high drinking water demand, the abstraction volume rose to a high level. The available abstraction capacity, combined with the high abstraction volumes, led to the exceedance of the abstraction permits. Some local drinking abstractions exceeded the monthly permitted volume, and some abstractions even exceeded the yearly permitted volume, failing drinking water regulations. This compromised the resilience of the abstractions.	<i>Enforcement procedures by legal authorities.</i> Legal authorities (provinces and water boards) started enforcement procedures to meet the water regulations. The legal authority urged the drinking water supplier to stay within these limits. However, the drinking water legislation also had to be met to ensure a continuous supply of good quality drinking water at all times.	<i>Extension of drinking water abstraction permits and water-saving strategies.</i> The exceedance of the abstraction permit limits set off enforcement actions by the government, resulting in an increased need for additional abstraction permits and drinking-water-saving strategies to reduce the drinking water demand.	<i>Drinking water demand, abstraction volume, abstraction capacity, abstraction permit, resilience of abstraction, legal authorities, water regulations, water legislation, and saving drinking water.</i>
<i>Extreme weather event</i>	<i>High peak demand for drinking water.</i>	<i>Shortage of drinking water during peak demand due to insufficient resilience of treatment infrastructure.</i> To meet the high peak demand, the treatment volume rose to a high level. In some parts of the drinking water supply, there was insufficient treatment capacity, causing a temporary shortage in drinking water during peak demand, compromising the reliability of the treatment. These limitations showed that the treatment is not resilient for this extreme peak demand.	<i>Reduced drinking water supply volume.</i> There is no response available when the treatment capacity is insufficient, except by reducing the drinking water supply volume. Exceeding the treatment capacity (by, for example, increasing the filter flow velocity or reducing the cleansing frequency of the filters) would introduce the risk of not meeting the drinking water standards.	<i>Adjustment of resilience and reliability of treatment infrastructure.</i> The drought identified various locations in the technical infrastructure where the treatment capacity was not reliable at the peak drinking water demand, which led to drinking water suppliers solving these local treatment aspects. To adjust all aspects will take several years.	<i>Treatment volume, treatment capacity, drinking water shortage, reliability of the treatment, resilience of the treatment, drinking water standards, drinking water demand, and drinking water suppliers.</i>

Table A2. Continued.

Driver	Pressure	Impact	Short-term response	Long-term response	Sustainability aspects
<i>Extreme weather event</i>	<i>High peak demand for drinking water.</i>	<i>Insufficient distribution capacity.</i>	<i>Lowering drinking water pressure to reduce drinking water volume.</i>	<i>Adjustment of resilience and reliability of distribution infrastructure.</i>	<i>Distribution capacity, resilience and reliability of distribution, drinking water suppliers, drinking water volume, and drinking water standards.</i>
<i>Extreme weather event</i>	<i>High peak demand for drinking water.</i>	<i>In some parts of the drinking water supply there was insufficient distribution capacity due to hydraulic limitations, insufficient storage capacity, or age and quality of the pipelines. In some areas, this caused unintended low drinking water pressures. These limitations put the reliability of the distribution under pressure and showed that the distribution capacity was not resilient for this extreme peak demand.</i>	<i>To reduce the drinking water volume that was supplied, drinking water suppliers lowered the drinking water pressure intentionally in some areas. The impact of this pressure reduction is a decreased drinking water volume from taps. By reducing the drinking water pressure, the distributed drinking water volume was reduced; however, this also led to a falling short of the mandatory drinking water standards in some areas.</i>	<i>The drought identified locations in the technical infrastructure where the distribution capacity was not reliable at peak demand, which led to drinking water suppliers solving these local distribution aspects. To adjust all aspects will take several years.</i>	<i>Drinking water demand, reliability of technical infrastructure, and drinking water suppliers.</i>
<i>Extreme weather event</i>	<i>High peak demand for drinking water.</i>	<i>Major disturbances could cause a serious disruption of the supply.</i>	<i>Maximal personnel deployment by drinking water suppliers.</i>	<i>Investments to improve resilience and reliability of technical infrastructure by drinking water suppliers.</i>	<i>Drinking water demand, reliability of technical infrastructure, and drinking water suppliers.</i>
		<i>The high peak demand required a maximal exploitation of the technical infrastructure. To ensure the reliability of the drinking water supply, many parts of the infrastructure are designed to be redundant, which limits the impact of disturbances for customers. However, a major disturbance in the infrastructure, such as the failure of a large transportation pipeline, could have led to a disruption in the supply because the resilience was limited due to limited reserve capacity and reduced maintenance during the extreme drinking water demand period.</i>	<i>To ensure the reliability of the drinking water supply, disturbances are always solved with top priority. During the extreme peak period, drinking water suppliers had all personnel put on standby to immediately solve any disturbances.</i>	<i>The drought identified locations in the technical infrastructure that were not reliable at peak demand, which led to drinking water suppliers solving these local aspects and, where necessary, creating redundancy to decrease the risk of disturbances and, thus, improve the reliability.</i>	

Table A2. Continued.

Driver	Pressure	Impact	Short-term response	Long-term response	Sustainability aspects
Extreme weather event	High peak demand for drinking water.	High energy use and environmental impact of extreme drinking water production.	–	Incorporating impact on energy use and environmental impact in the design of measures to improve the resilience and reliability of technical infrastructure.	Drinking water demand, energy use, environmental impact, and drinking water suppliers.
		The magnitude and duration of the peak demand forced a maximal exploitation of the technical infrastructure, causing a maximal energy use and environmental impact.	There was no short-term response available to reduce the energy use and environmental impact.	The drought identified locations in the technical infrastructure that were not reliable at peak demand, which lead to drinking water suppliers solving these local aspects. Energy use and environmental impact are important aspects that are considered in the design of the solutions for these aspects.	

Appendix B: Results of analysis case 2: groundwater quality development

Table B1. Summary of the impact, short- and long-term response, and sustainability aspects in case 2 – groundwater quality development (for complete results of the case study, see Table B2).

Impact	Short-term response	Long-term response	Sustainability aspects
Surface water quality deteriorates due to limited surface water discharge.	Monitoring and evaluation of water quality development.	Water legislation on water quality and quantity protection and drinking-water-saving strategies.	Surface water quality, surface water discharge, monitoring and evaluation, water legislation, water quality and quantity, and saving drinking water.
Groundwater quality deteriorates due to deteriorating surface water quality.	Monitoring and evaluation of water quality development.	Improvement of sewage and wastewater treatment, and water-saving strategies.	Groundwater quality, surface water quality, monitoring and evaluation, and water saving.
Soil energy systems may affect groundwater quality.	Monitoring and evaluation of water quality development and research.	Groundwater protection regulations.	Groundwater quality, groundwater pollution, research, monitoring and evaluation, regulations, and groundwater quality protection.
Local and upstream land and water use affects the surface water quality.	Monitoring and evaluation of water quality development.	Policy and measures to meet water legislation to protect and improve water quality and quantity.	Surface water quality, land and water use, contaminants, monitoring and evaluation, water legislation, and water quantity.
Diffuse and point sources of pollution affect surface water and groundwater quality.	Monitoring and evaluation of water quality development.	Measures to remove historical sources of pollution and to prevent new sources of pollution.	Groundwater quality, nutrients, organic micro-pollutants, other contaminants, surface water quality, monitoring and evaluation, water legislation, and water quality protection.
Emerging contaminants in surface and groundwater require new drinking water treatment methods.	Enforcement of groundwater protection regulations on pollution incidents and monitoring and evaluation.	Development of treatment methods to remove emerging contaminants from sewage, industrial wastewater, and/or drinking water.	Emerging contaminants, groundwater quality, surface water quality, resilience and reliability of the drinking water treatment, groundwater protection, land and water use, water legislation, sources of pollution, drinking water treatment methods, energy use, environmental impact, and drinking water tariff.
Land use (change) may cause groundwater quality deterioration.	Enforcement of groundwater protection regulations on land use change and monitoring and evaluation.	Combination of extensive land use functions with drinking water abstraction.	Land use change, groundwater quality, sources of pollution, groundwater protection regulations, water use, enforcement of regulations, monitoring and evaluation, drinking water abstraction, extensive land use, nature, agriculture, and water system.

Table B1. Continued.

Impact	Short-term response	Long-term response	Sustainability aspects
Surface water and groundwater quality deterioration determine the required drinking water treatment.	Monitoring of drinking water quality; in case of emergencies, measures are taken to safeguard the drinking water quality.	Adjustment of treatment methods to be able to continue to meet the drinking water standards.	Raw water quality, drinking water standards, water quality, vulnerability of the water system for contamination, treatment methods, reliability and resilience of treatment, drinking water quality, emergencies, energy use, environmental impact, and drinking water tariff.
Variations in raw water quality can only be handled if the treatment method is resilient to these variations.	Monitoring and evaluation of water quality development.	Increase in resilience and reliability of drinking water treatment.	Surface water quality, groundwater quality, resilience and reliability of the treatment, monitoring and evaluation, raw water quality, energy use, environmental impact, and drinking water tariff.

Table B2. Results analysis of case 2 – “groundwater quality development”. The cells in italics refer to Table B1.

Drivers	Pressure	Impact	Short-term response	Long-term response	Sustainability aspects
<i>Changing climate variability</i>	<i>Less summer precipitation and higher summer temperatures.</i>	<i>Surface water quality deteriorates due to limited surface water discharge.</i>	<i>Monitoring and evaluation of water quality development.</i>	<i>Water legislation on water quality and quantity protection and drinking-water-saving strategies.</i>	<i>Surface water quality, surface water discharge, monitoring and evaluation, water legislation, water quality and quantity, and saving drinking water.</i>
		In summer, the surface water quality deteriorates due to limited surface water discharge combined with increasing contributions of industrial and treated sewage water recharges compared to natural discharges due to the lack of summer precipitation.	Monitoring and evaluating water quality development is necessary to be able to respond timeously to a changing surface water quality.	Land and water use must meet water legislation as set by the European Water Framework Directive and national water legislation to protect and improve water quality and quantity. Further improvement in sewage and wastewater treatment will reduce the impact on the surface water quality. Drinking-water-saving strategies can also lead to reduction in treated sewage water recharges and industrial recharges.	
<i>Changing climate variability</i>	<i>Surface water quality deterioration.</i>	<i>Groundwater quality deteriorates due to deteriorating surface water quality.</i>	<i>Monitoring and evaluation of water quality development.</i>	<i>Improvement of sewage and wastewater treatment and water-saving strategies.</i>	<i>Groundwater quality, surface water quality, monitoring and evaluation, and water saving.</i>
		Groundwater quality may be affected by the deteriorating surface water quality during summer periods through natural or artificial infiltration of surface water.	Monitoring and evaluating water quality development is necessary to be able to respond timeously to a changing surface water quality.	Further improvement in sewage and wastewater treatment will reduce the impact on the surface water quality. (Drinking-) water-saving strategies can also lead to reduction in treated sewage water recharges and industrial recharges.	

Table B2. Continued.

Driver	Pressure	Impact	Short-term response	Long-term response	Sustainability aspects
<i>Socio-economic developments</i>	<i>Increase in the use of soil energy systems.</i>	<i>Soil energy systems may affect groundwater quality.</i>	<i>Monitoring and evaluating water quality development and research.</i>	<i>Groundwater protection regulations.</i>	<i>Groundwater quality, groundwater pollution, research, monitoring and evaluation, regulations, and groundwater quality protection.</i>
		There is a transition towards renewable energy resources, not only wind and solar energy but also towards using soil energy. Groundwater quality may be affected by the use of soil energy due to the risk of groundwater pollution by soil energy systems and the risk of leakage through aquitards that protect aquifers.	Research on, and monitoring and evaluating of, the impact of soil energy on the groundwater quality (including temperature impact) is necessary to avoid the introduction of new sources of pollution by soil energy systems.	Regulations on soil energy help to limit the risk for groundwater quality. A policy is developed to exclude vulnerable groundwater systems that are used for drinking water supply from soil energy use for groundwater quality protection.	
<i>Population growth, industrial developments</i>	<i>Increasing sewage and wastewater discharges.</i>	<i>Local and upstream land and water use affects the surface water quality.</i>	<i>Monitoring and evaluating water quality development.</i>	<i>Policy and measures to meet water legislation and to protect and improve water quality and quantity.</i>	<i>Surface water quality, land and water use, contaminants, monitoring and evaluation, water legislation, and water quantity.</i>
		Surface water quality is affected by local and upstream land and water use activities. Discharge of treated sewage water and industrial wastewater discharges introduce contaminants in the water system.	Monitoring and evaluating the water quality development is necessary to be able to respond timeously to a changing surface water quality.	Land and water use must meet water legislation as set by the European Water Framework Directive and national water legislation to protect and improve water quality and quantity. According to the water legislation in the European Water Framework Directive, additional measures must be taken to reach the set goals in 2027.	

Table B2. Continued.

Driver	Pressure	Impact	Short-term response	Long-term response	Sustainability aspects
<i>Population growth and industrial developments</i>	<i>Historical pollution and increasing sewage and wastewater discharges (change).</i>	<i>Diffuse and point sources of pollution affect surface water and groundwater quality.</i>	<i>Monitoring and evaluation of water quality development.</i>	<i>Measures to remove historical sources of pollution and to prevent new sources of pollution.</i>	<i>Groundwater quality, nutrients, organic micro-pollutants, other contaminants, surface water quality, monitoring and evaluation, water legislation, and water quality protection.</i>
		Groundwater quality is affected by diffuse and point sources of pollution such as nutrients, organic micro-pollutants, and other contaminants caused by historic land and water use. Groundwater can be influenced by (historic and current) surface water quality through natural or artificial infiltration of surface water.	The impact of historical contaminations will proceed further into the groundwater system and cannot be undone – unless soil processes help to break down contaminants. Monitoring and evaluating are necessary to be able to respond timeously to a changing water quality.	Historical contaminations from past land use will affect the groundwater quality for a long period of time due to the low stream velocity of groundwater. Some historical point pollution may be removed through soil and groundwater remediation, but diffuse pollution cannot be removed. However, according to the water legislation in the European Water Framework Directive, additional measures must be taken to reach the set goals on water quality protection in 2027.	

Table B2. Continued.

Driver	Pressure	Impact	Short-term response	Long-term response	Sustainability aspects
Population growth and industrial developments	Increasing sewage and wastewater discharges.	Emerging contaminants in surface and groundwater require new drinking water treatment methods.	Enforcement of groundwater protection regulations on pollution incidents and monitoring and evaluating.	Development of treatment methods to remove emerging contaminants from sewage, industrial wastewater, and/or drinking water.	Emerging contaminants, groundwater quality, surface water quality, resilience and reliability of the drinking water treatment, groundwater protection, land and water use, water legislation, sources of pollution, drinking water treatment methods, energy use, and environmental impact, and drinking water tariffs.
		Emerging contaminants, such as new industrial pollutants, medicine residues, and microplastics, may pose new threats to the groundwater and surface water quality and, consequently, the raw water quality, especially when they cannot be removed using the currently available treatment methods. The changes limit the resilience and reliability of the drinking water treatment.	Groundwater protection regulations on land and water use aim to reduce the risk of pollution to avoid groundwater quality deterioration. This includes regulations for small incidents with point pollution such as those caused by a car accident, for example, which are to be reported and solved immediately by removing the source of pollution. Continuous enforcement of these regulations is essential. Monitoring and evaluating are necessary to be able to respond timeously to a changing water quality.	According to the water legislation in the European Water Framework Directive, known sources of pollution must be reduced and new sources of pollution must be prevented. This may include prohibition by law or measures for reducing the use of specific chemical products. To deal with emerging contaminants, it is essential to limit or remove the contaminant source. If all these measures fail, the contaminants must be removed by the drinking water treatment. Other or new drinking water treatment methods may be required. New treatment methods may cause an increase in energy use and environmental impact (excipients, wastewater, and waste materials). This may lead to a higher drinking water tariff.	

Table B2. Continued.

Driver	Pressure	Impact	Short-term response	Long-term response	Sustainability aspects
<i>Population growth and industrial developments</i>	<i>Land use change.</i>	<i>Land use (change) may cause groundwater quality deterioration.</i>	<i>Enforcement of groundwater protection regulations on land use change and monitoring and evaluating.</i>	<i>Combination of extensive land use functions with drinking water abstraction.</i>	<i>Land use change, groundwater quality, sources of pollution, groundwater protection regulations, water use, enforcement of regulations, monitoring and evaluating, drinking water abstraction, extensive land use, nature, agriculture, and water system.</i>
		Land use change may cause groundwater quality deterioration due to the risk of the diffusion of point sources of pollution. The impact may be limited if land use changes towards less polluting land use functions.	Groundwater protection regulations on land and water use aim to reduce the risk of pollution to avoid groundwater quality deterioration. This includes regulations on land use change developments. Continuous enforcement of these regulations is essential. Monitoring and evaluating is necessary to be able to respond timeously to a changing water quality.	Combining extensive land use functions, such as nature and sustainable agriculture, with drinking water abstraction in local areas to reduce the groundwater quality deterioration rate, depending on the land use and hydrological and chemical characteristics of the water system.	

Table B2. Continued.

Driver	Pressure	Impact	Short-term response	Long-term response	Sustainability aspects
Changing climate variability, population growth and industrial developments	Surface water and groundwater quality deterioration determine the required drinking water treatment.	Surface water and groundwater quality deterioration determine the required drinking water treatment.	Monitoring of drinking water quality; in case of emergencies, measures are taken to safeguard the drinking water quality.	Adjustment of treatment methods to be able to continue to meet the drinking water standards.	Raw water quality, drinking water standards, water quality, vulnerability of the water system for contamination, treatment methods, reliability and resilience of treatment, drinking water quality, emergencies, energy use, environmental impact, and drinking water tariffs.
		The raw water quality of the abstracted groundwater or surface water determines the treatment that is necessary to meet the legal drinking water standards. When water quality deteriorates in general, due to the vulnerability of the water system for contamination, different and more complex treatment methods become necessary to ensure the reliability of the treatment in order to meet the drinking water standards. The resilience of the treatment method or capacity may be insufficient to respond to variability in raw water quality.	The drinking water quality is constantly monitored and checked with drinking water standards. In the case of drinking water quality emergencies, local measures are taken, such as temporary boiling instructions to customers or temporary additional treatment to safeguard the drinking water quality.	A deteriorating raw water quality may require the adjustment of treatment methods to meet the drinking water standards and to ensure the resilience and reliability of the treatment. In general, a more complex treatment method leads to a higher energy use and a higher environmental impact due to additional use of excipients, water loss, and waste materials, which will lead to a higher drinking water tariff. If the raw water quality is under extreme pressure, adjustment of treatment methods may not be possible. This can ultimately lead to the decision to close the local drinking water abstraction and force the drinking water supplier to find and develop a replacing abstraction location.	

Table B2. Continued.

Driver	Pressure	Impact	Short-term response	Long-term response	Sustainability aspects
<i>Population growth and industrial development</i>	<i>Incidental changes in surface water and ground-water quality.</i>	<i>Variations in raw water quality can only be handled if the treatment method is resilient to these variations.</i>	<i>Monitoring and evaluating water quality development.</i>	<i>Increase in resilience and reliability of drinking water treatment.</i>	<i>Surface water quality, groundwater quality, resilience and reliability of the treatment, monitoring and evaluating, raw water quality, energy use, environmental impact, and drinking water tariffs.</i>
		Especially surface water quality can show strong water quality variations. They can enforce a temporary interruption of the surface water intake. Groundwater quality is more stable and, therefore, less vulnerable to incidental changes. However, incidents can cause a permanent change in the groundwater quality. It depends on the resilience and reliability of the treatment whether sudden variations in raw water quality can be handled well.	Monitoring and evaluating is necessary to be able to respond timeously to changing water quality.	To handle a varying or deteriorating raw water quality, the resilience and reliability of the drinking water treatment must be extended. This may require innovations in treatment, which can lead to large investments, and higher energy use and an increase in the environmental impact of the treatment. This may lead to a higher drinking water tariff.	

Appendix C: Results of analysis case 3: drinking water demand growth

Table C1. Summary of the impact, short- and long-term response, and sustainability aspects in case 3 – drinking water demand growth (for complete results of the case study, see Table C2).

Impact	Short-term response	Long-term response	Sustainability aspects
A limited water resource availability will affect the drinking water availability.	See Table A2.	See Table A2.	Water resource availability, drinking water availability, resilience of drinking water supply, drinking water demand, and water legislation.
A water quality deterioration affects the resilience and reliability of the drinking water treatment.	See Table B2.	See Table B2.	Water quality, drinking water treatment, reliability of treatment, and drinking water standards.
A growing drinking water demand will put the reliability and resilience of the technical infrastructure under pressure.	See Table A2.	Drinking water suppliers must adapt the technical infrastructure to the growing water demand. Water-saving strategies may reduce the growth rate, which will limit the required extension of the technical infrastructure.	Drinking water demand, reliability of technical infrastructure, drinking water suppliers, drinking water availability, treatment, energy use, environmental impact, and drinking water tariff.
A declining drinking water demand may also put the resilience of the technical infrastructure under pressure.	Research on the potential risks of a decline in drinking water demand.	Adaptation strategies that increase the resilience of the infrastructure to growth and a decline in the drinking water demand.	Drinking water demand, reliability, and resilience of technical infrastructure.

Table C2. Results of the analysis of case 3, drinking water demand growth, were additional to the analysis of the first two cases. The cells in italics refer to Table C1.

Driver	Pressure	Impact	Short-term response	Long-term response	Sustainability aspects
<i>Changing climate variability, population growth and industrial developments</i>	<i>Limited water resource availability due to extreme weather events, other water use, or limited abstraction permits.</i>	<i>A limited water resource availability will affect the drinking water availability.</i>	<i>See Table A2.</i>	<i>See Table A2.</i>	<i>Water resource availability, drinking water availability, resilience of drinking water supply, drinking water demand, and water legislation.</i>
		A limited water resource availability will affect the drinking water availability. The abstraction permits may be insufficient to meet the drinking demand, and possibilities to extend the permits will be minimal. This will put the resilience of drinking water supply to respond to changes in drinking water demand under pressure. This may cause frequent exceedance of permit conditions or failure to adhere to the drinking water legislation.	See Table A2.	See Table A2.	

Table C2. Continued.

Driver	Pressure	Impact	Short-term response	Long-term response	Sustainability aspects
<i>Changing climate variability, population growth, industrial developments</i>	<i>Growing drinking water demand.</i>	<i>A growing drinking water demand will put the reliability and resilience of the technical infrastructure under pressure.</i>	<i>See Table A2.</i>	<i>Drinking water suppliers must adapt the technical infrastructure to the growing water demand. Water-saving strategies may reduce the growth rate, which will limit the required extension of the technical infrastructure.</i>	<i>Drinking water demand, reliability of technical infrastructure, drinking water suppliers, drinking water availability, treatment, energy use, environmental impact, and drinking water tariffs.</i>
		<p>The overall capacity of the technical infrastructure determines whether the supply is resilient in response to a higher drinking water demand. The drought in 2018 displayed the technical limitations in parts of the drinking water supply system, putting the reliability of the technical infrastructure under pressure.</p>	<p>See Table A2.</p>	<p>Depending on the effectiveness of the water-saving strategies that are developed, the technical limitations must be solved to meet the growing drinking water demand. Drinking water suppliers must solve the local aspects to ensure drinking water availability. Because these adjustments take time, drinking water suppliers must start solving the aspects now. This requires substantial investment and also leads to an increased energy use and environmental impact, which may result in an increased drinking water tariff.</p>	

Table C2. Continued.

Driver	Pressure	Impact	Short-term response	Long-term response	Sustainability aspects
Socio-economic developments	Decrease in drinking water demand.	A declining drinking water demand may also put the resilience of the technical infrastructure under pressure.	Research on potential risks of a decline in drinking water demand.	Adaptation strategies that increase the resilience of the infrastructure to growth and a decline in the drinking water demand.	Drinking water demand, reliability, and resilience of technical infrastructure.
		If, at some point, the socio-economic developments reverse the drinking water demand growth, the reliability and resilience of the technical infrastructure will be put under pressure. Especially when the focus is on dealing with a growing water demand, there is the risk of an over-dimensioning of the technical infrastructure. This will put the drinking water quality under pressure in the case of a decreasing drinking water demand.	While working on solutions for the growing drinking water demand, it is important to consider the potential risks of a decreasing demand.	The chosen adaptation strategies for a growing drinking water demand must also be resilient and reliable under a decreasing drinking water demand.	

Appendix D: Summary of Sustainable Development Goal 6 targets and indicators related to sustainability characteristics

Table D1. Summary of the Sustainable Development Goal 6 targets and indicators related to sustainability characteristics.

Target	Indicator	Hydrological system			Technical system			Socio-economic system		
		Water quality	Water resource availability	Impact of drinking water abstraction	Reliability of technical infrastructure	Resilience of technical infrastructure	Energy use and environmental impact	Drinking water availability	Water governance	Land and water use
6.1 By 2030, achieve universal and equitable access to safe and affordable drinking water for all.	6.1.1 Proportion of population using safely managed drinking water services.				×	×		×		
6.2 By 2030, achieve access to adequate and equitable sanitation and hygiene for all and end open defecation, paying special attention to the needs of women and girls and those in vulnerable situations.	6.2.1 Proportion of the population using safely managed sanitation services, including a hand-washing facility with soap and water.									
6.3 By 2030, improve water quality by reducing pollution, eliminating dumping, and minimizing the release of hazardous chemicals and materials, halving the proportion of untreated wastewater and substantially increasing recycling and safe reuse globally.	6.3.1 Proportion of wastewater safely treated. 6.3.2 Proportion of bodies of water with good ambient water quality.	×	×					×	×	×
6.4 By 2030, substantially increase water use efficiency across all sectors, and ensure sustainable withdrawals and supply of freshwater to address water scarcity and substantially reduce the number of people suffering from water scarcity.	6.4.1 Change in water-use efficiency over time. 6.4.2 Level of water stress – freshwater withdrawal as a proportion of available freshwater resources.		×	×	×	×	×	×	×	×

Table D1. Continued.

Target	Indicator	Hydrological system			Technical system			Socio-economic system		
		Water quality	Water resource availability	Impact of drinking water abstraction	Reliability of technical infrastructure	Resilience of technical infrastructure	Energy use and environmental impact	Drinking water availability	Water governance	Land and water use
6.5 By 2030, implement integrated water resources management at all levels, including through trans-boundary cooperation, as appropriate.	6.5.1 Degree of integrated water resources management implementation (0–100). 6.5.2 Proportion of trans-boundary basin area with an operational arrangement for water cooperation.	×	×					×	×	
6.6 By 2020, protect and restore water-related ecosystems, including mountains, forests, wetlands, rivers, aquifers, and lakes.	6.6.1 Change in the extent of water-related ecosystems over time.			×					×	
6.a By 2030, expand international cooperation and capacity-building support to developing countries in water and sanitation-related activities and programmes, including water harvesting, desalination, water efficiency, wastewater treatment, and recycling and reuse technologies.	6.a.1 Amount of water- and sanitation-related official development assistance that is part of a government-coordinated spending plan.								×	
6.b Support and strengthen the participation of local communities in improving water and sanitation management.	6.b.1 Proportion of local administrative units with established and operational policies and procedures for participation of local communities in water and sanitation management.								×	

Appendix E: Overview of sustainability characteristics and criteria

This section is an extended and updated version of Appendix A of Van Engelenburg et al. (2019).

Table E1. Summarizes the hydrological, technical, and socio-economic sustainability characteristics and criteria for a local drinking water supply system from Sect. 3.

System	Sustainability characteristics	Sustainability criteria	General description	Sustainable	Under pressure	Unsustainable	Suggestions for general data sources	Reference for general data sources
Hydrological system	Water quality	Current raw water quality	To which extent does the current raw water quality meet set standards?	Current raw water quality meets set standards.	Occasionally the current raw water quality exceeds set standards.	Current raw water quality is permanently exceeding set standards.	E.g. status of water bodies according to European Water Framework Directive.	European Union (2000).
		Chemical aspects of water quality	Which trends are found in chemical water quality development?	Chemical water quality is improving.	Consistent chemical water quality.	Deteriorating chemical water quality.	European Union (2000).	European Union (2000).
		Microbial aspects of water quality	To which extent is microbial pollution a threat to the raw water quality?	No risk of microbial pollution.	Microbial pollution is a potential risk, but the microbiological quality is sufficient.	Microbial pollution is an actual risk, and the microbiological quality is insufficient.	European Union (2000).	European Union (2000).
		Acceptability aspects of water quality	Are there aspects of water quality that limit the acceptability of the drinking water (salinization, hardness, and/or colour)?	No issues with the acceptability of the drinking water.	Salinization, hardness, or colour cause a minor acceptability issue.	Salinization, hardness, and/or colour cause serious acceptability issues.	European Union (2000).	European Union (2000).
		Monitoring and evaluation of water quality trends	Is there sufficient and adequate monitoring and evaluating of water quality trends available?	Sufficient and adequate monitoring and evaluating of water quality trends.	There is monitoring available, but the evaluation of data is limited, resulting in a limited understanding of water quality trends.	There is limited or no monitoring available, and water quality trends are not investigated.	European Union (2000).	European Union (2000).
Water resource availability	Surface water quantity	Are there current limitations or future threats to the abstracted surface water volume?	Sufficient availability all year round or no surface water abstraction.	Surface water availability varies during the year and may occasionally be limited in the case of dry weather conditions.	There is regularly insufficient surface water volume available in the dry season.	E.g. status of water bodies according to European Water Framework Directive.	European Union (2000).	
		Groundwater quantity	Are there current limitations or future threats to the abstracted groundwater volume?	Abstraction is not limited because groundwater is recharged sufficiently (yearly abstraction < annual recharge minus environmental streamflow) or no groundwater abstraction.	Abstraction is not limited but exceeds annual recharge minus environmental streamflow.	Abstraction volume is limited because groundwater is abstracted from a confined aquifer that is not recharged (mining).	E.g. status of water bodies according to European Water Framework Directive.	European Union (2000).

Table E1. Continued.

System	Sustainability characteristics	Sustainability criteria	General description	Sustainable	Under pressure	Unsustainable	Suggestions for general data sources	Reference for general data sources
		Other available water resources	Are there water resources available for drinking water production other than currently used?	There are sufficient water resources available that could replace the currently used water resource with minor adjustments to the drinking water treatment method.	There are other water resources available that could replace the currently used water resource, but this will require major adjustments to the drinking water treatment method.	There are no water resources available that could replace the current used water resource.	E.g. status of water bodies according to European Water Framework Directive.	European Union (2000).
		Vulnerability of used water system to contamination	To which extent is the used water system vulnerable to contamination?	The water system is hardly vulnerable to contamination because the used water resource is protected by an aquitard (groundwater in confined aquifers).	The water system is vulnerable to soil and groundwater pollution (phreatic groundwater).	The water system is vulnerable to calamities and diffuse contamination (surface water).	E.g. status of water bodies according to European Water Framework Directive.	European Union (2000).
		Natural hazards and emergencies risk	To which extent are natural hazards (droughts, floods, earthquakes, and forest fires) threatening the water resources availability?	Limited risk of natural hazards (< 1 per 25 years).	Minor risk of a natural hazards (< 1 per 10 years).	Natural hazards occur frequently (> 1 per 10 years) and are a serious threat to water resources availability.	E.g. national flood risk inventory and Commission on Sustainable Development (CSD) Indicator of Sustainable Development (percentage of population living in hazard-prone areas).	UN (2007).
	Impact of drinking water abstraction	Impact on surface water system	The scale of impact of the abstraction to the surface water system.	Small (groundwater abstraction below aquitard).	Medium (riverbank abstraction; phreatic groundwater abstraction).	Large (surface water abstraction).	E.g. status of water bodies according to European Water Framework Directive.	European Union (2000).
		Impact to groundwater system	The scale of impact of the abstraction to the groundwater system.	Small (surface water abstraction).	Medium (riverbank abstraction; groundwater abstraction below aquitard).	Large (phreatic groundwater abstraction).	E.g. groundwater footprint.	Gleeson and Wada (2013).
		Balance between annual recharge and abstraction	The balance between abstraction and recharge of the water system.	The net abstraction volume is less than 10 % of the average annual recharge in the recharge area.	The net abstraction volume is 10 %–40 % of the average annual recharge in the recharge area.	The net abstraction volume is > 40 % of the average annual recharge in the recharge area.	Sustainable Society Index (SSI; renewable water resources).	Van der Kerk and Manuel (2008).
		Hydrological compensation	The extent to which the impact of abstraction is compensated hydrologically.	Small impact or impact is hydrologically compensated with a technical measure.	There are possibilities for hydrological compensation of the impact on the abstraction, but they are not operational yet.	There is a significant impact on the abstraction, but there are no possibilities for hydrological compensation.	Local hydrological knowledge; hydrological modelling results.	E.g. Van Engelenburg et al. (2018, 2020).

Table E1. Continued.

System	Sustainability characteristics	Sustainability criteria	General description	Sustainable	Under pressure	Unsustainable	Suggestions for general data sources	Reference for general data sources	
		Spatial impact of abstraction facility, storage, and/or reservoir	Size of required working area for abstraction facility.	Small (groundwater abstraction with basic treatment facility).	Medium (groundwater abstraction with medium treatment facility).	Large (surface water abstraction with storage basins and extended treatment facility).	Drinking water company's information; map.		
Technical system	Reliability of technical infrastructure	Technical state of abstraction and treatment facility	Is the technical state of the drinking water production facility sufficient and fully deployable?	The technical state of the drinking water production facility is sufficient and fully deployable.	Production capacity is sufficient but not fully deployable due to restrictions in permit or technical limitations.	Production capacity is insufficient due to technical limitations.	International Water Association (IWA; pH1 treatment plant utilization).	Alegre et al. (2006).	
		Technical state distribution infrastructure	Are there issues that complicate the drinking water distribution?	The distribution infrastructure is adequate to meet the required distribution capacity and water pressure.	The distribution infrastructure is adequate in general but, at extreme peak demand, limitations in the drinking water distribution cause reduced water pressure and limited drinking water supply.	The distribution infrastructure is insufficient and major disruptions of the drinking water supply occur regularly.	Performance data of water utilities.	E.g. Dutch Government (2009a).	
		Complexity of water treatment	How complex is the required treatment, and is the treatment effective to meet the water quality issues?	Technical water quality issues (iron/manganese removal and pH correction); requires only basic treatment.	Water quality issues such as hardness require medium complex treatment (decalcification).	Serious water quality issues (chemical and microbiological) require a complex treatment (ultra-filtration and reverse osmosis).	Performance data of water utilities.	E.g. Dutch Government (2009a).	
		Supply continuity for customers	Are there frequent drinking water supply interruptions?	Drinking water supply interruptions < 1 h per year.	Drinking water supply interruptions < 10 d per year.	Drinking water supply interruptions > 10 d per year.	Performance data of water utilities; IWA (QS17 days with restrictions to water service).	Alegre et al. (2006).	
		Operational reliability	Is the facility operationally reliable?	Facility meets corporate standard for operational reliability.	The facility does not fully meet corporate standard for operational reliability, but investments are planned to increase the operational reliability < 5 years.	Facility is not operationally reliable, and there are no investments planned to improve the reliability within 5 years.	Performance data of water utilities.	E.g. Dutch Government (2009a).	
		Resilience of technical infrastructure	Abstraction permit compared to annual drinking water demand	Are the permitted abstraction volumes sufficient to meet the annual drinking water demand?	The permitted abstraction volumes are sufficient to meet the current and future annual drinking water demand (operational reserve > 10 %).	The permitted abstraction volumes are sufficient to meet the current annual drinking water demand but cannot meet the future demand (operational reserve < 10 %).	The permitted abstraction volumes are insufficient to meet the current or future annual drinking water demand.	Performance data of water utilities.	E.g. Dutch Government (2009b).

Table E1. Continued.

System	Sustainability characteristics	Sustainability criteria	General description	Sustainable	Under pressure	Unsustainable	Suggestions for general data sources	Reference for general data sources
		Production capacity compared to peak demand	Is the production capacity per hour sufficient to meet extreme peak demand?	The production capacity per hour is sufficient to meet extreme peak demand.	The production capacity is < 5 % below the predicted extreme peak demand and, therefore, is not fully sufficient.	The production capacity is > 5 % below the predicted extreme peak demand and, therefore, is insufficient to meet peak demand.	Performance data of water utilities; IWA (pH1 treatment plant utilization).	Alegre et al. (2006)
		Flexibility of treatment method for changing raw water quality	Is the treatment method flexible in response to a changing raw water quality?	The treatment method removes a broad spectrum of pollutants and can therefore also handle various new pollutants (e.g. membrane treatment methods).	The treatment method is flexible when concentrations of the currently removed elements change but cannot remove other pollutants (e.g. decalcification).	The treatment method is not flexible in response to large changes in concentrations or pollutants (e.g. sand filtration).	Performance data of water utilities.	
		Technical innovations to improve resilience	Have technical innovations been developed to improve resilience?	Within society there is ongoing research to find technical innovations on drinking water use or supply to improve resilience.	Within the drinking water company there is ongoing research to find technical innovations for drinking water supply to improve resilience.	There is no or limited research on technical innovations for drinking water supply.	Data of water utilities (annual report).	
		Technical investments to improve resilience	Are technical investments being made to improve resilience?	Technical investments are being made to improve the resilience of the drinking water infrastructure, including investments in technical innovations.	There is a limited budget for technical investments to improve the resilience of the drinking water infrastructure.	There is no budget for technical investments.	Financial data of water utilities.	
	Energy use and environmental impact	Energy use of abstraction and treatment	Energy use for abstraction and treatment of water per square metre.	Low (shallow groundwater abstraction, short distance to treatment, and basic treatment),	Average (deep groundwater abstraction, short distance to treatment, and medium treatment groundwater).	High (long transport distance to treatment and complex treatment).	IWA; pH5 standardized energy consumption.	Alegre et al. (2006).
		Energy use of distribution	Energy use for distribution.	Low (average transport distances < 15 km).	Average (average transport distances < 30 km).	High (average transport distances > 30 km).	European Benchmark (EBC; electricity use).	European Benchmarking Co-operation (2017).
		Environmental impact (additional excipients, wastewater, and waste materials)	Are there materials used or produced in the treatment with an environmental impact?	No use or production of materials with high environmental impact.	Use of additional excipients with high environmental impact in the treatment.	Production of waste materials and wastewater with high environmental impact.	EBC (climate footprint).	European Benchmarking Co-operation (2017).
		Reliability energy supply	Is the energy supply reliable?	Reliable energy supply and emergency energy backup.	Average reliable energy supply and no emergency energy backup.	Unreliable energy supply and no emergency energy backup.	EBC (electricity use).	

Table E1. Continued.

System	Sustainability characteristics	Sustainability criteria	General description	Sustainable	Under pressure	Unsustainable	Suggestions for general data sources	Reference for general data sources
		Use of renewable energy	Use of renewable energy sources (generated or acquired green energy).	All used energy is renewable energy.	A total of > 50 % renewable energy is used.	A total of < 50 % renewable energy.	IWA; pH7 energy recovery.	Alegre et al. (2006).
Socio-economic system	Drinking water availability	Percentage of connected households	Households directly connected to drinking water supply system.	A total of > 95 %.	A total of 80–95 %.	A total of < 80 %.	IWA; QS3 population coverage.	Alegre et al. (2006).
		Drinking water service quality	Continuity and quality of supply (local scale).	Continuity and quality of drinking water supply guaranteed 24/7.	Continuity of drinking water supply or quality under pressure at peak demand.	Drinking water quality and supply continuity not guaranteed.	IWA QS12 continuity of supply; QS18 quality of supplied water.	Alegre et al. (2006).
		Drinking water tariff	Average water charges without public charges (company scale).	A total of < EUR 1 m ⁻³ .	A total of EUR 1–2 m ⁻³ .	A total of > EUR 2 m ⁻³ .	IWA; Fi28 average water charges for direct consumption.	Alegre et al. (2006).
		Water-saving strategy	Water-saving strategy to reduce average water demand in litre per person per day (national scale).	Effective water-saving strategy resulting in an average water demand < 100 l per person per day.	Water-saving strategy aiming to reduce the average water demand of 100–200 l per person per day.	No water-saving strategy.	SSI (sufficient to drink).	Van der Kerk and Manuel (2008).
		Water safety protocols	Are there water safety protocols or water safety plans to safeguard the drinking water supply?	Water safety protocols fully cover the drinking water supply, and the organization is performing accordingly.	There are safety protocols, but these only cover part of the drinking water supply or are not fully performed.	There are no safety protocols.	Drinking water company's information.	E.g. Dutch Government (2009a).
Water governance	Availability of (drinking) water legislation and policies	Is there adequate legislation on drinking water supply, and is there enforcement of this legislation?	There is adequate legislation on drinking water supply combined with sufficient enforcement by legal authorities.	There is legislation on drinking water supply but limited or no enforcement by legal authorities.	There is no legislation and enforcement on drinking water supply.	SSI (good governance); national and local legislation.	Van der Kerk and Manuel (2008).	
		Compliance of drinking water supplier	Are the required permits available, and is the facility compliant with the permit requirements?	All permits are available, and the facility is compliant with the permit requirements.	The permits are available, but the facility is not fully compliant with the permit requirements.	There is a lack of adequate drinking water supply legislation, and drinking water suppliers only follow their company's standard.	SSI (good governance); permits; TRUST framework for Urban Water Cycle Systems (UWCS) sustainability (G1-G4).	Van der Kerk and Manuel (2008).
		Decision-making process by (local) authorities	Are local stakeholders involved in decisions on drinking water supply or the water system?	Local stakeholders are involved in the planning process and can participate in licensing procedures.	Local stakeholders are not involved in the planning process and cannot participate in licensing procedures.	Local stakeholders cannot easily be involved in the decision-making process.	SDG 6.b.	UN (2015).

Table E1. Continued.

System	Sustainability characteristics	Sustainability criteria	General description	Sustainable	Under pressure	Unsustainable	Suggestions for general data sources	Reference for general data sources
		Local stakeholder interests	Does the local authority actively weigh stakeholder interests in the decision-making process?	Stakeholders are involved in the decision-making process and stakeholder interests must legally be taken into account in the licensing process.	Stakeholder interests must be taken into account in the licensing process.	The interests of (some) local stakeholders are not accounted for by the local authorities.	SDG 6.b; national or local legislation.	UN (2015).
		Emergency risk caused by human activities or conflicts	Is there emergency risk caused by human activities or conflicts?	There is, in general, no serious emergency risk caused by human activities or conflicts.	There is a low emergency risk caused by human activities.	There is an evident emergency risk caused by human activities or conflicts.	SDG 16.	UN (2015).
Land and water use	Land use (including subsurface use)	Is land or subsurface use in the area posing a threat to the drinking water supply?	The impact of land or subsurface use is limited due to low-risk use or because the drinking water supply is well protected against the impact.	The land or subsurface use forms a potential risk to the drinking water supply but is regulated.	The land or subsurface use is affecting the drinking water supply.	E.g. status of water bodies according to European Water Framework Directive.	European Union (2000).	
	Water use for other purposes than drinking water	Does water use in the area pose a threat to the drinking water supply?	In general, there is sufficient water available for all functions, and water quality is not affected by water use.	In extreme situations, the available water resources are limited and must be fairly distributed between water users or water quality deteriorates.	There is constantly insufficient water available for all water users, and/or water quality deterioration occurs due to various water uses.	E.g. status of water bodies according to European Water Framework Directive.	European Union (2000).	
	Regulations on land and water use	Are there regulations on land use and underground activities to protect the local drinking water abstraction?	There are regulations to remove unwanted activities from the recharge area to protect the local drinking water abstraction.	There are regulations to prevent new unwanted activities by using the stand still/step forward principle.	There are no regulations to protect the local drinking water abstraction.	(Inter-) national legislation; TRUST Framework for UWCS sustainability (G1-G4).	E.g. Dutch Government (2009b).	
	Limitations in land or water use	Is the presence of the facility a significant impediment for current or future land use or underground activities?	The drinking water supply does not present a significant impediment for land or subsurface use.	The drinking water supply limits future land use or underground activities.	The drinking water supply is a significant impediment for current and future land use or underground activities.	E.g. status of water bodies according to European Water Framework Directive.	European Union (2000).	
	Financial compensation for economic damage from the impact of abstraction or limitations in land use	Is there financial compensation of economic damage from the impact of abstraction or limitations to land use?	Financial compensation of economic damage caused by the drinking water supply is organized based on legislation.	Drinking water suppliers financially compensate for economic damage based on bilateral agreements.	There is financial compensation of economic damage caused by the drinking water supply company.	National or local legislation.	E.g. Dutch Government (2009b).	

Data availability. The source data used for the illustrations of the cases are available upon request.

Author contributions. JvE, PH, and EvS conceptualized the study and developed the methodology. JvE curated the data, generated the visualizations, led the investigation, and wrote the original draft. All co-authors reviewed and edited the paper. PH, EvS, AJT, and RU supervised the research (see the CRediT taxonomy for explanations of terms).

Competing interests. The first author performed the research and was partially funded by Vitens, where she is employed. She had carte blanche with respect to the content of the research.

Acknowledgements. We are indebted to Vitens staff, Maarten Fleuren and Martin de Jonge, for their data collection for the illustrations of the analysed drinking water supply cases, and to Vitens staff, Mark de Vries, Henk Hunneman, and Rian Kloosterman, for cross-checking the results of the case analysis. We thank the two anonymous referees for their comments that helped to further improve the paper.

Review statement. This paper was edited by Luuk Rietveld and reviewed by two anonymous referees.

References

- Alegre, H., Baptiste, J. M., Cabrera Jr., E., Cubillo, F., Duarte, P., Hirner, W., Merkel, W., and Pareno, R.: Performance Indicators for Water Supply Services, in: *Manual of Best Practice*, IWA Publishing, London, UK, 2006.
- Baggelaar, P. K. and Geudens, P. J. G.: Prognoses en scenario's drinkwatergebruik in Nederland (Prognoses and scenarios for drinking water use in the Netherlands), ICASAT, VEWIN, The Hague, the Netherlands, 2017.
- Bauer, J. M. and Herder, P. M.: *Designing Socio-Technical Systems. Philosophy of Technology and Engineering Sciences*, North-Holland, Amsterdam, the Netherlands, 2009.
- Binder, C. R., Hinkel, J., Bots, P. W. G., and Pahl-Wostl, C.: Comparison of frameworks for analyzing social-ecological systems, *Ecol. Soc.*, 18, 26–45, 2013.
- Carr, E. R., Wingard, P. M., Yorty, S. C., Thompson, M. C., Jensen, N. K., and Roberson, J.: Applying DPSIR to sustainable development, *Int. J. Sust. Dev. World*, 14, 543–555, 2009.
- Cohen, D. A.: *The Rationed City: The Politics of Water, Housing, and Land Use in Drought-Parched Sao Paulo*, *Public Culture*, 28, 261–289, 2016.
- Dutch Government: Drinkwaterwet (Dutch Drinking water Decree), BWBR0026338, The Hague, the Netherlands, 2009a.
- Dutch Government: Waterwet (Dutch Decree on Water), BWBR0025458, The Hague, the Netherlands, 2009b.
- Ekins, P., Gupta, J., and Boileau, P.: *Global Environment Outlook GEO-6: Healthy Planet, Healthy People*. Global Environment Outlook, United Nations Environment Programme, Cambridge, UK, 2019.
- European Benchmarking Co-operation: *Learning from international best practices; 2017 Water and Wastewater Benchmark*, EBC, The Hague, the Netherlands, 2017.
- European Environment Agency: *European waters Assessment of status and pressures 2018*, Luxembourg, 2018.
- European Union: *EU Water Framework Directive*, in: *Official Journal of the European Communities*, edited by: EUROPEAN UNION, Brussels, Belgium, 2000.
- Eurostat: *Environmental indicators: Typology and overview*, Technical Report No. 25, European Environment Agency, Copenhagen, Denmark, 1999.
- Gleeson, T. and Wada, Y.: Assessing regional groundwater stress for nations using multiple data sources with the groundwater footprint, *Environ. Res. Lett.*, 8, 044010, <https://doi.org/10.1088/1748-9326/8/4/044010>, 2013.
- Hashimoto, T., Stedinger, J. R., and Loucks, D. P.: Reliability, Resiliency, and Vulnerability Criteria For Water Resource System Performance Evaluation, *Water Resour. Res.*, 18, 14–20, 1982.
- Hellegers, P. and Leflaive, X.: Water allocation reform: what makes it so difficult?, *Water Int.*, 40, 273–285, 2015.
- Janza, M.: A decision support system for emergency response to groundwater resource pollution in an urban area (Ljubljana, Slovenia), *Environ. Earth Sci.*, 73, 3763–3774, 2015.
- Jorgensen, L. F. and Stockmarr, J.: Groundwater monitoring in Denmark: Characteristics, perspectives and comparison with other countries, *Hydrogeol. J.*, 17, 827–842, 2009.
- Kools, S., Van Loon, A., Sjerps, R., and Rosenthal, L.: *The quality of drinking water resources in the Netherlands*, edited by: KWR, KWR Report, KWR, Nieuwegein, the Netherlands, 2019.
- Liu, J., Mooney, H., Hull, V., Davis, S. J., Gaskell, J., Hertel, T., Lubchenco, J., Seto, K. C., Gleick, P., Kremen, C., and Li, S.: Sustainability. Systems integration for global sustainability, *Science*, 347, 1258832, <https://doi.org/10.1126/science.1258832>, 2015.
- Loucks, D. P.: Sustainable Water Resources Management, *Water Int.*, 25, 3–10, 2000.
- Loucks, D. P., Van Beek, E., Stedinger, J. R., Dijkman, J. P., and Villars, M. T.: *Water resource systems planning and management: an introduction to Methods, Models and Applications*, Springer, Deltares and UNESCO-IHE, Cham, Switzerland, 2017.
- Melese, Y. G., Heijnen, P. W., Stikkelman, R. M., and Herder, P. M.: Exploring for real options during CCS networks conceptual design to mitigate effects of path-dependency and lock-in, *Int. J. Greenh. Gas Con.*, 42, 16–25, 2015.
- Mendizabal, I., Baggelaar, P. K., and Stuyfzand, P. J.: Hydrochemical trends for public supply well fields in the Netherlands (1898–2008), natural backgrounds and upscaling to groundwater bodies, *J. Hydrol.*, 450–451, 279–292, 2012.
- Ministry of Infrastructure and Environment and Ministry of Economic Affairs and Climate Policy: *Nederland beter weerbaar tegen droogte; Eindrapportage Beleidstafel Droogte (the Netherlands more resilient to drought; final report policy table drought)*, The Hague, the Netherlands, 2019.
- Napoli, C. and Garcia-Tellez, B.: A framework for understanding energy for water, *Int. J. Water Resour. D*, 32, 339–361, 2016.

- Ness, B., Urbel-Piirsalu, E., Anderberg, S., and Olsson, L.: Categorising tools for sustainability assessment, *Ecol. Econ.*, 60, 498–508, 2007.
- Pahl-Wostl, C.: Towards sustainability in the water sector – The importance of human actors and processes of social learning, *Aquat. Sci.*, 64, 394–411, 2002.
- Pahl-Wostl, C.: *Water Governance in the Face of Global Change: From understanding to transformation*, Springer, London, UK, 2015.
- Pant, L. P., Adhikari, B., and Bhattarai, K. K.: Adaptive transition for transformations to sustainability in developing countries, *Curr. Opin. Env. Sust.*, 14, 206–212, 2015.
- Singh, R. K., Murty, H. R., Gupta, S. K., and Dikshit, A. K.: An overview of sustainability assessment methodologies, *Ecol. Indic.*, 15, 281–299, 2012.
- Smith, A. and Stirling, A.: The Politics of Social-ecological Resilience and Sustainable Socio-technical Transitions, *Ecol. Soc.*, 15, 11, available at: https://www.researchgate.net/publication/45227241_The_Politics_of_Social-ecological_Resilience_and_Sustainable_Socio-technical_Transitions (last access: 18 January 2021), 2010.
- Sorensen, P.: The chronic water shortage in Cape Town and survival strategies, *Int. J. Environ. Stud.*, 74, 515–527, 2017.
- Teuling, A. J.: A hot future for European droughts, *Nat. Clim. Change*, 8, 364–365, 2018.
- UN: Indicators of Sustainable Development: Guidelines and Methodologies, Economic and Social Affairs, United Nations, New York, USA, 2007.
- UN: Transforming our world: The 2030 Agenda for Sustainable Development, United Nations, New York, USA, 2015.
- UN: Sustainable Development Goal 6 Synthesis Report 2018 on Water and Sanitation, edited by: Water, U., United Nations, New York, USA, 2018.
- UNESCAP: Economic and social survey of Asia and the Pacific 2009; Addressing triple threats to development, edited by: United Nations Economic and Social Commission for Asia and the Pacific, ST/ESCAP/2522, United Nations Economic and Social Commission for Asia and the Pacific, Bangkok, Thailand, 2009.
- UNICEF and WHO: Progress on Sanitation and Drinking Water; 2015 Update and MDG Assessment, NLM classification: WA 670, UNICEF and World Health Organization, New York, USA, 2015.
- Van den Brink, C. and Wuijts, S.: Towards an effective protection of groundwater resources: putting policy into practice with the drinking water protection file, *Water Policy*, 18, 635–653, 2016.
- Van der Aa, N. G. F. M., Tangena, B. H., Wuijts, S., and De Nijs, A. C. M.: Scenario's drinkwatervraag 2015–2040 en beschikbaarheid bronnen; verkenning grondwatervoorraden voor drinkwater (Scenarios drinking water demand 2015–2040 and water resources availability; exploratory study on groundwater resources for drinking water), RIVM, Bilthoven, the Netherlands, 2015.
- Van der Kerk, G. and Manuel, A.: A comprehensive index for a sustainable society: The SSI – the Sustainable Society Index, *Ecol. Econ.*, 66, 228–242, 2008.
- Van Engelenburg, J., Hueting, R., Rijpkema, S., Teuling, A. J., Uijlenhoet, R., and Ludwig, F.: Impact of Changes in Groundwater Extractions and Climate Change on Groundwater-Dependent Ecosystems in a Complex Hydrogeological Setting, *Water Resour. Manag.*, 32, 259–272, 2018.
- Van Engelenburg, J., Van Slobbe, E., and Hellegers, P.: Towards sustainable drinking water abstraction: an integrated sustainability assessment framework to support local adaptation planning, *J. Integr. Environ. Sci.*, 16, 89–122, 2019.
- Van Engelenburg, J., De Jonge, M., Rijpkema, S., Van Slobbe, E., and Bense, V. F.: Hydrogeological evaluation of managed aquifer recharge in a glacial moraine complex using long-term groundwater data analysis, *Hydrogeol. J.*, 28, 1787–1807, 2020.
- Van Noordwijk, M., Speelman, E., Hofstede, G. J., Farida, A., Abdurrahim, A. Y., Miccolis, A., Hakim, A. L., Wamucii, C. N., Lagneaux, E., Andreotti, F., Kimbowa, G., Assogba, G. G. C., Best, L., Tanika, L., Githinji, M., Rosero, P., Sari, R. R., Satnarain, U., Adiwibowo, S., Ligtenberg, A., Muthuri, C., Pena-Claros, M., Purwanto, E., Van Oel, P., Rozendaal, D., Suprayogo, D., and Teuling, A. J.: Sustainable Agroforestry Landscape Management: Changing the Game, *Land*, 9, 243, <https://doi.org/10.3390/land9080243>, 2020.
- Van Thiel, L.: Watergebruik thuis 2016 (Domestic water use 2016). TNO Nipo Report C8732; Kantar Public, Amsterdam, the Netherlands, 2017.
- Vitens: Resiliently ahead; Long-term vision on our infrastructure 2016–2040, Vitens, Zwolle, the Netherlands, 2016.
- WHO: Guidelines for drinking-water quality: fourth edition incorporating the first addendum, World Health Organization, Geneva, Switzerland, 2017.
- WHO and UNICEF: Progress on drinking water, sanitation and hygiene, 2017 update and SDG Baselines, World Health Organization (WHO) and UNICEF, Geneva, Switzerland, 2017.
- Wolters, H. A., Van den Born, G. J., Dammers, E., and Reinhard, S.: Deltascenario's voor de 21e eeuw, actualisering 2017 (Delta scenarios for the 21st century, actualisation 2017), Deltares, Utrecht, the Netherlands, 2018.